


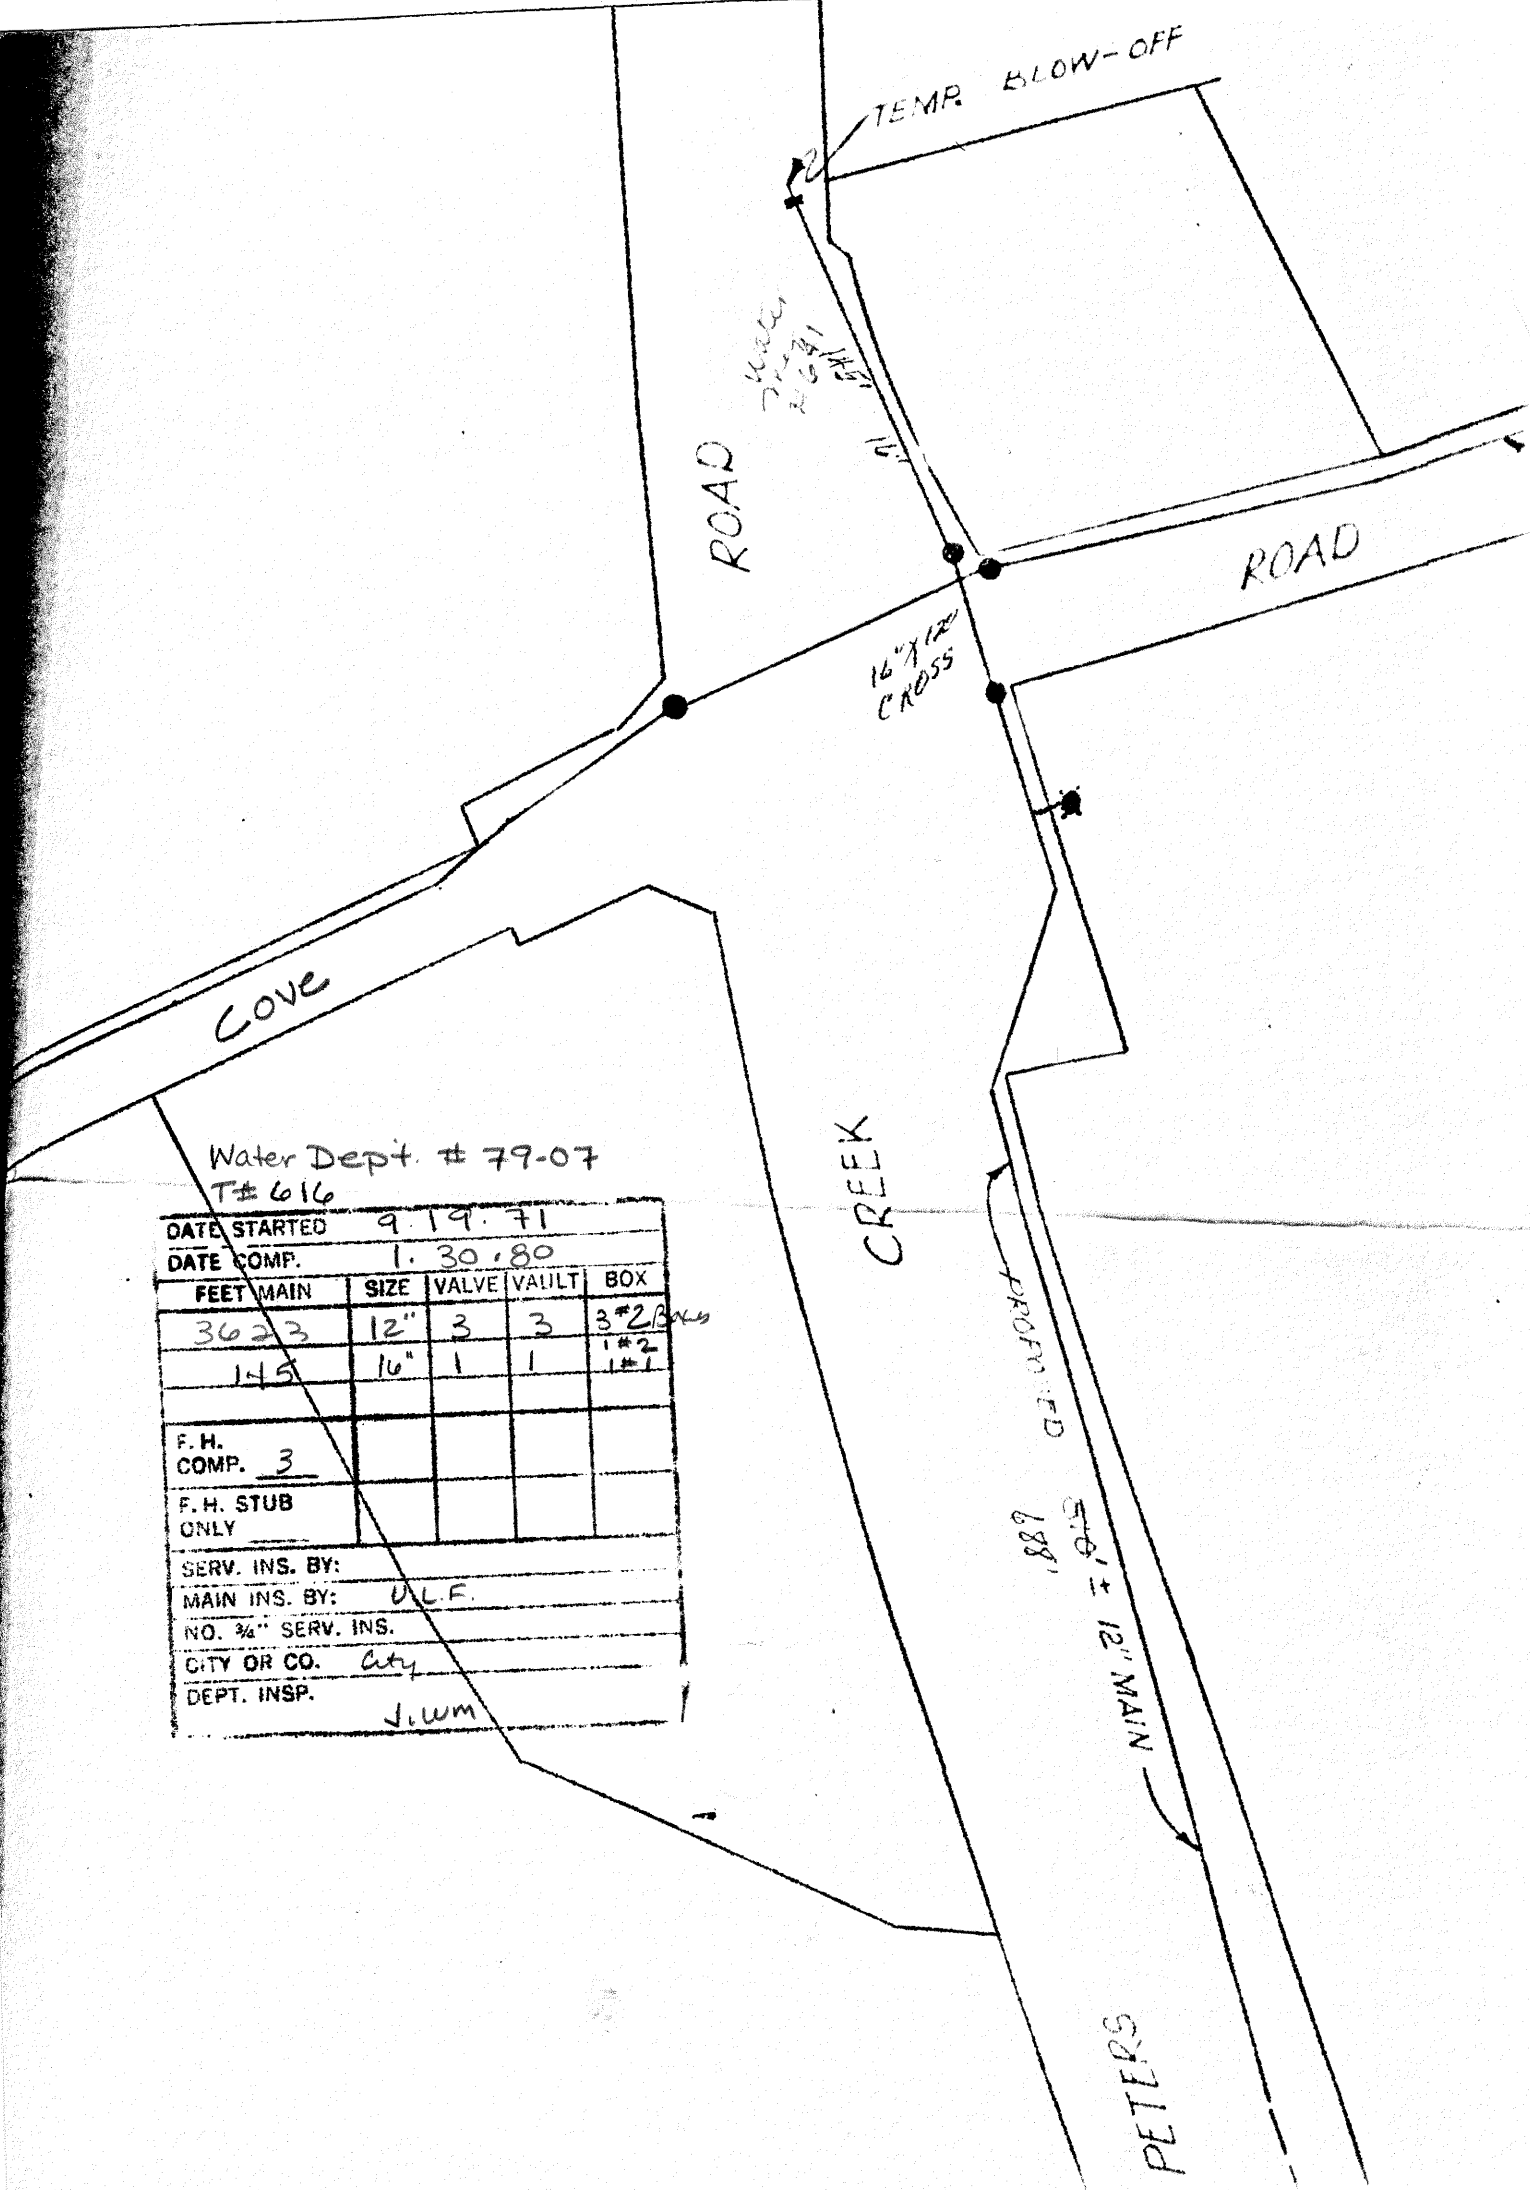

Water Dept. # 79-07
T# 616

DATE STARTED 9.19.71				
DATE COMP. 1.30.80				
FEET MAIN	SIZE	VALVE	VAULT	BOX
3623	12"	3	3	3#2 Boxes
145	16"	1	1	1#2 1#1
F.H. COMP. 3				
F.H. STUB ONLY				
SERV. INS. BY:				
MAIN INS. BY: U.L.F.				
NO. 3/4" SERV. INS.				
CITY OR CO. City				
DEPT. INSP. J.L.W.				

PROPOSED
SLOPE ± 12" MAIN
688'