



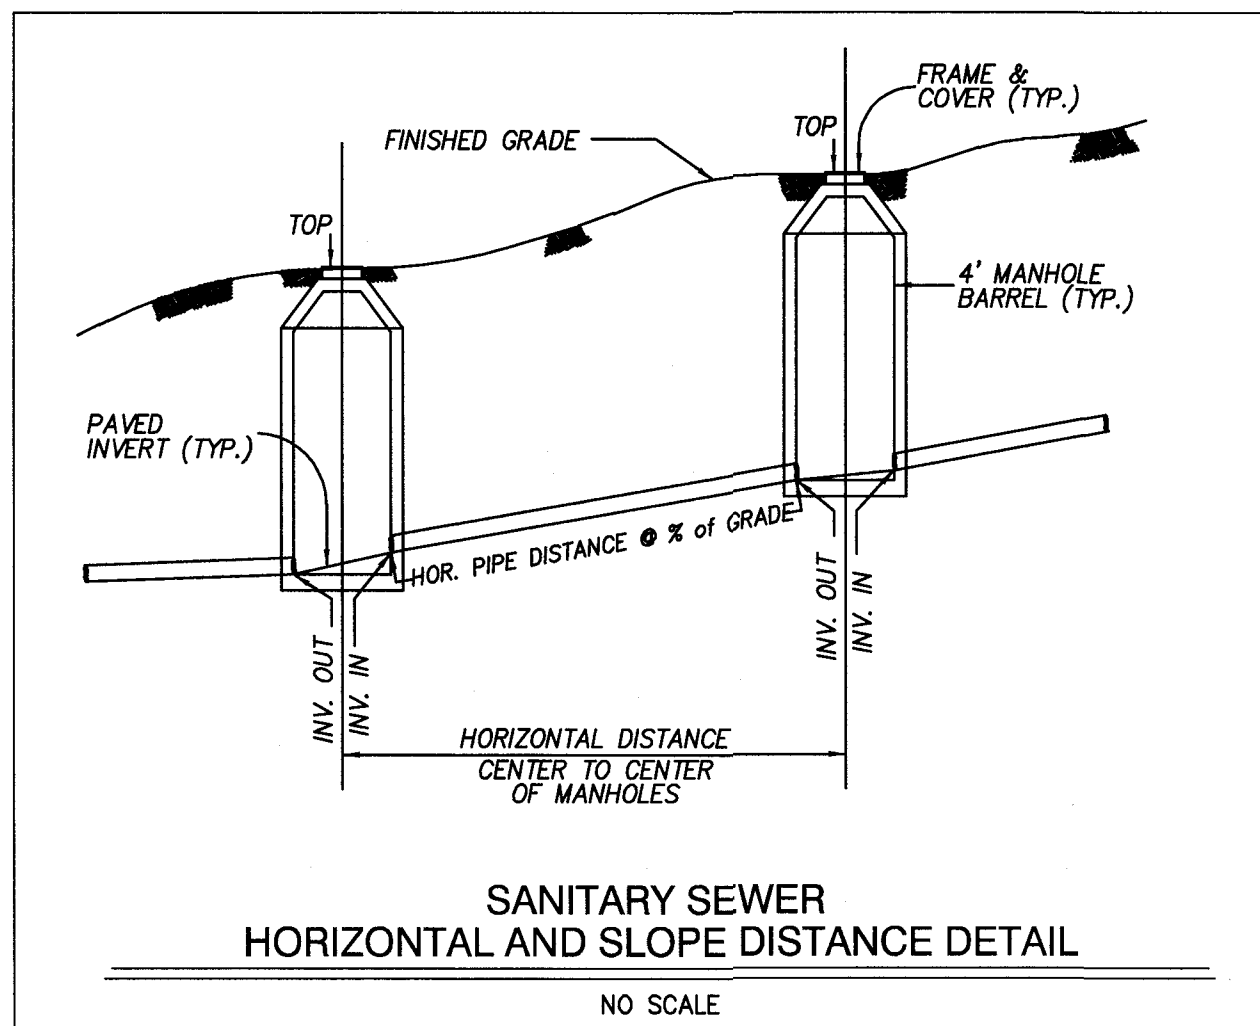

- SANITARY SEWER NOTES:**
1. ALL SANITARY SEWER LINES SHALL HAVE A MINIMUM OF 3.0 FEET OF COVER.
 2. MAINTAIN A MINIMUM OF 18" CLEARANCE FROM OUTSIDE OF PIPE TO OUTSIDE OF PIPE AT ALL WATER, SANITARY SEWER AND STORM DRAIN CROSSINGS. WHERE THIS CLEARANCE CANNOT BE ACHIEVED, CONCRETE PIERS SHALL BE UTILIZED IN ACCORDANCE WITH THE STANDARDS OF THE WESTERN VIRGINIA WATER AUTHORITY.
 3. SANITARY SEWER MAIN PIPE MATERIAL SHALL BE PVC, SDR-35, EXCEPT WHERE NOTED.
 4. ALL SANITARY SEWER CONNECTIONS TO EXISTING LINES SHALL BE COORDINATED WITH AN PERFORMED BY THE WESTERN VIRGINIA WATER AUTHORITY.

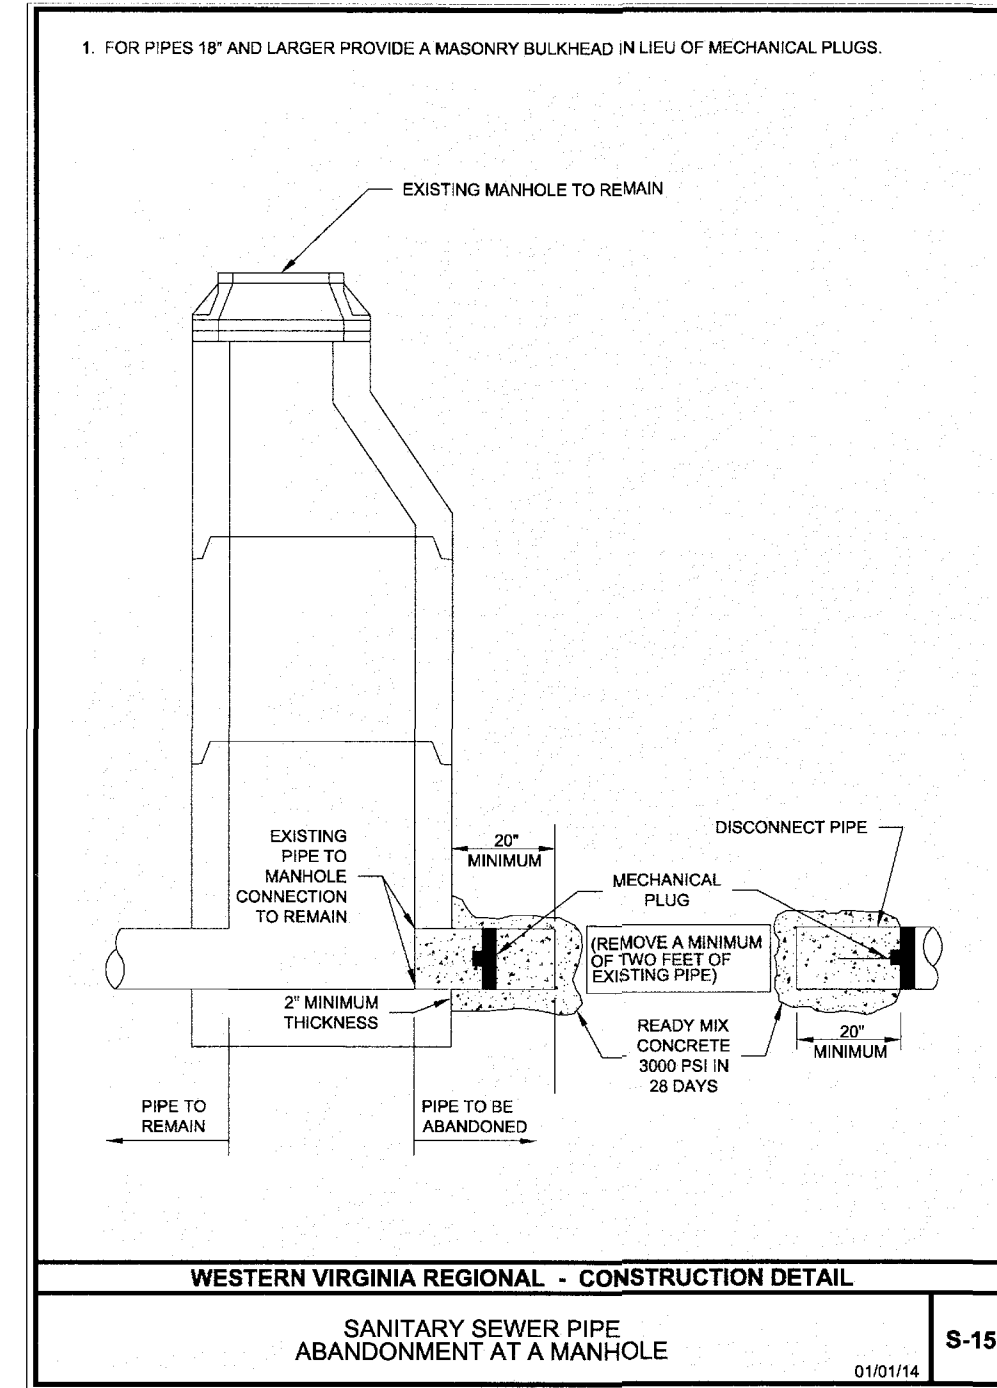