

1. DUCTILE IRON WATER AND SEWER LINES CROSSING STREAMS MUST BE CONCRETE ENCASED

WESTERN VIRGINIA REGIONAL - CONSTRUCTION DETAIL


CONCRETE ENCASED PIPE


UNLESS OTHERWISE SPECIFIED BY PARTICIPATING UTILITY.


READY MIX CONCRETE


3,000 P.S.I.


@ 28 DAYS

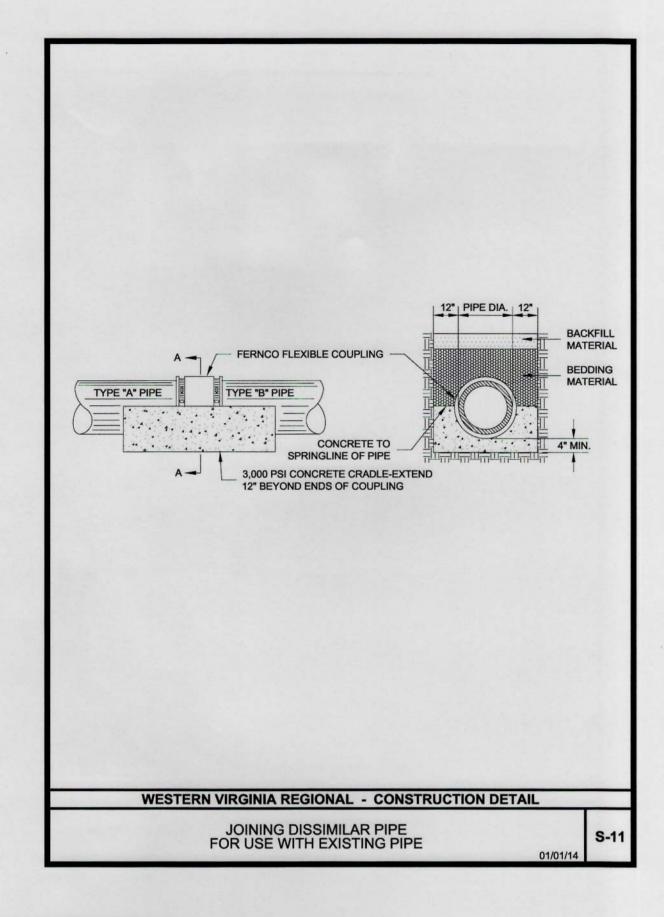









WESTERN VIRGINIA WATER AUTHORITY

PIEDMONT PARK SANITARY SEWER REPLACEMENT

No	Cubmittel / Devision	Annid	Du	Det
NO.	Submittal / Revision	Арр а.	Бу	Date
◬	BIDDING DOCUMENTS	EES	ACW	03/25
	No.			

CONSTRUCTION **DETAILS**

Designed By:	Drawn By:	Checked By
EES	ACW	DBH
Issue Date:	Project No:	Scale:
03/25/22	65825	AS NOTED

C-601

