

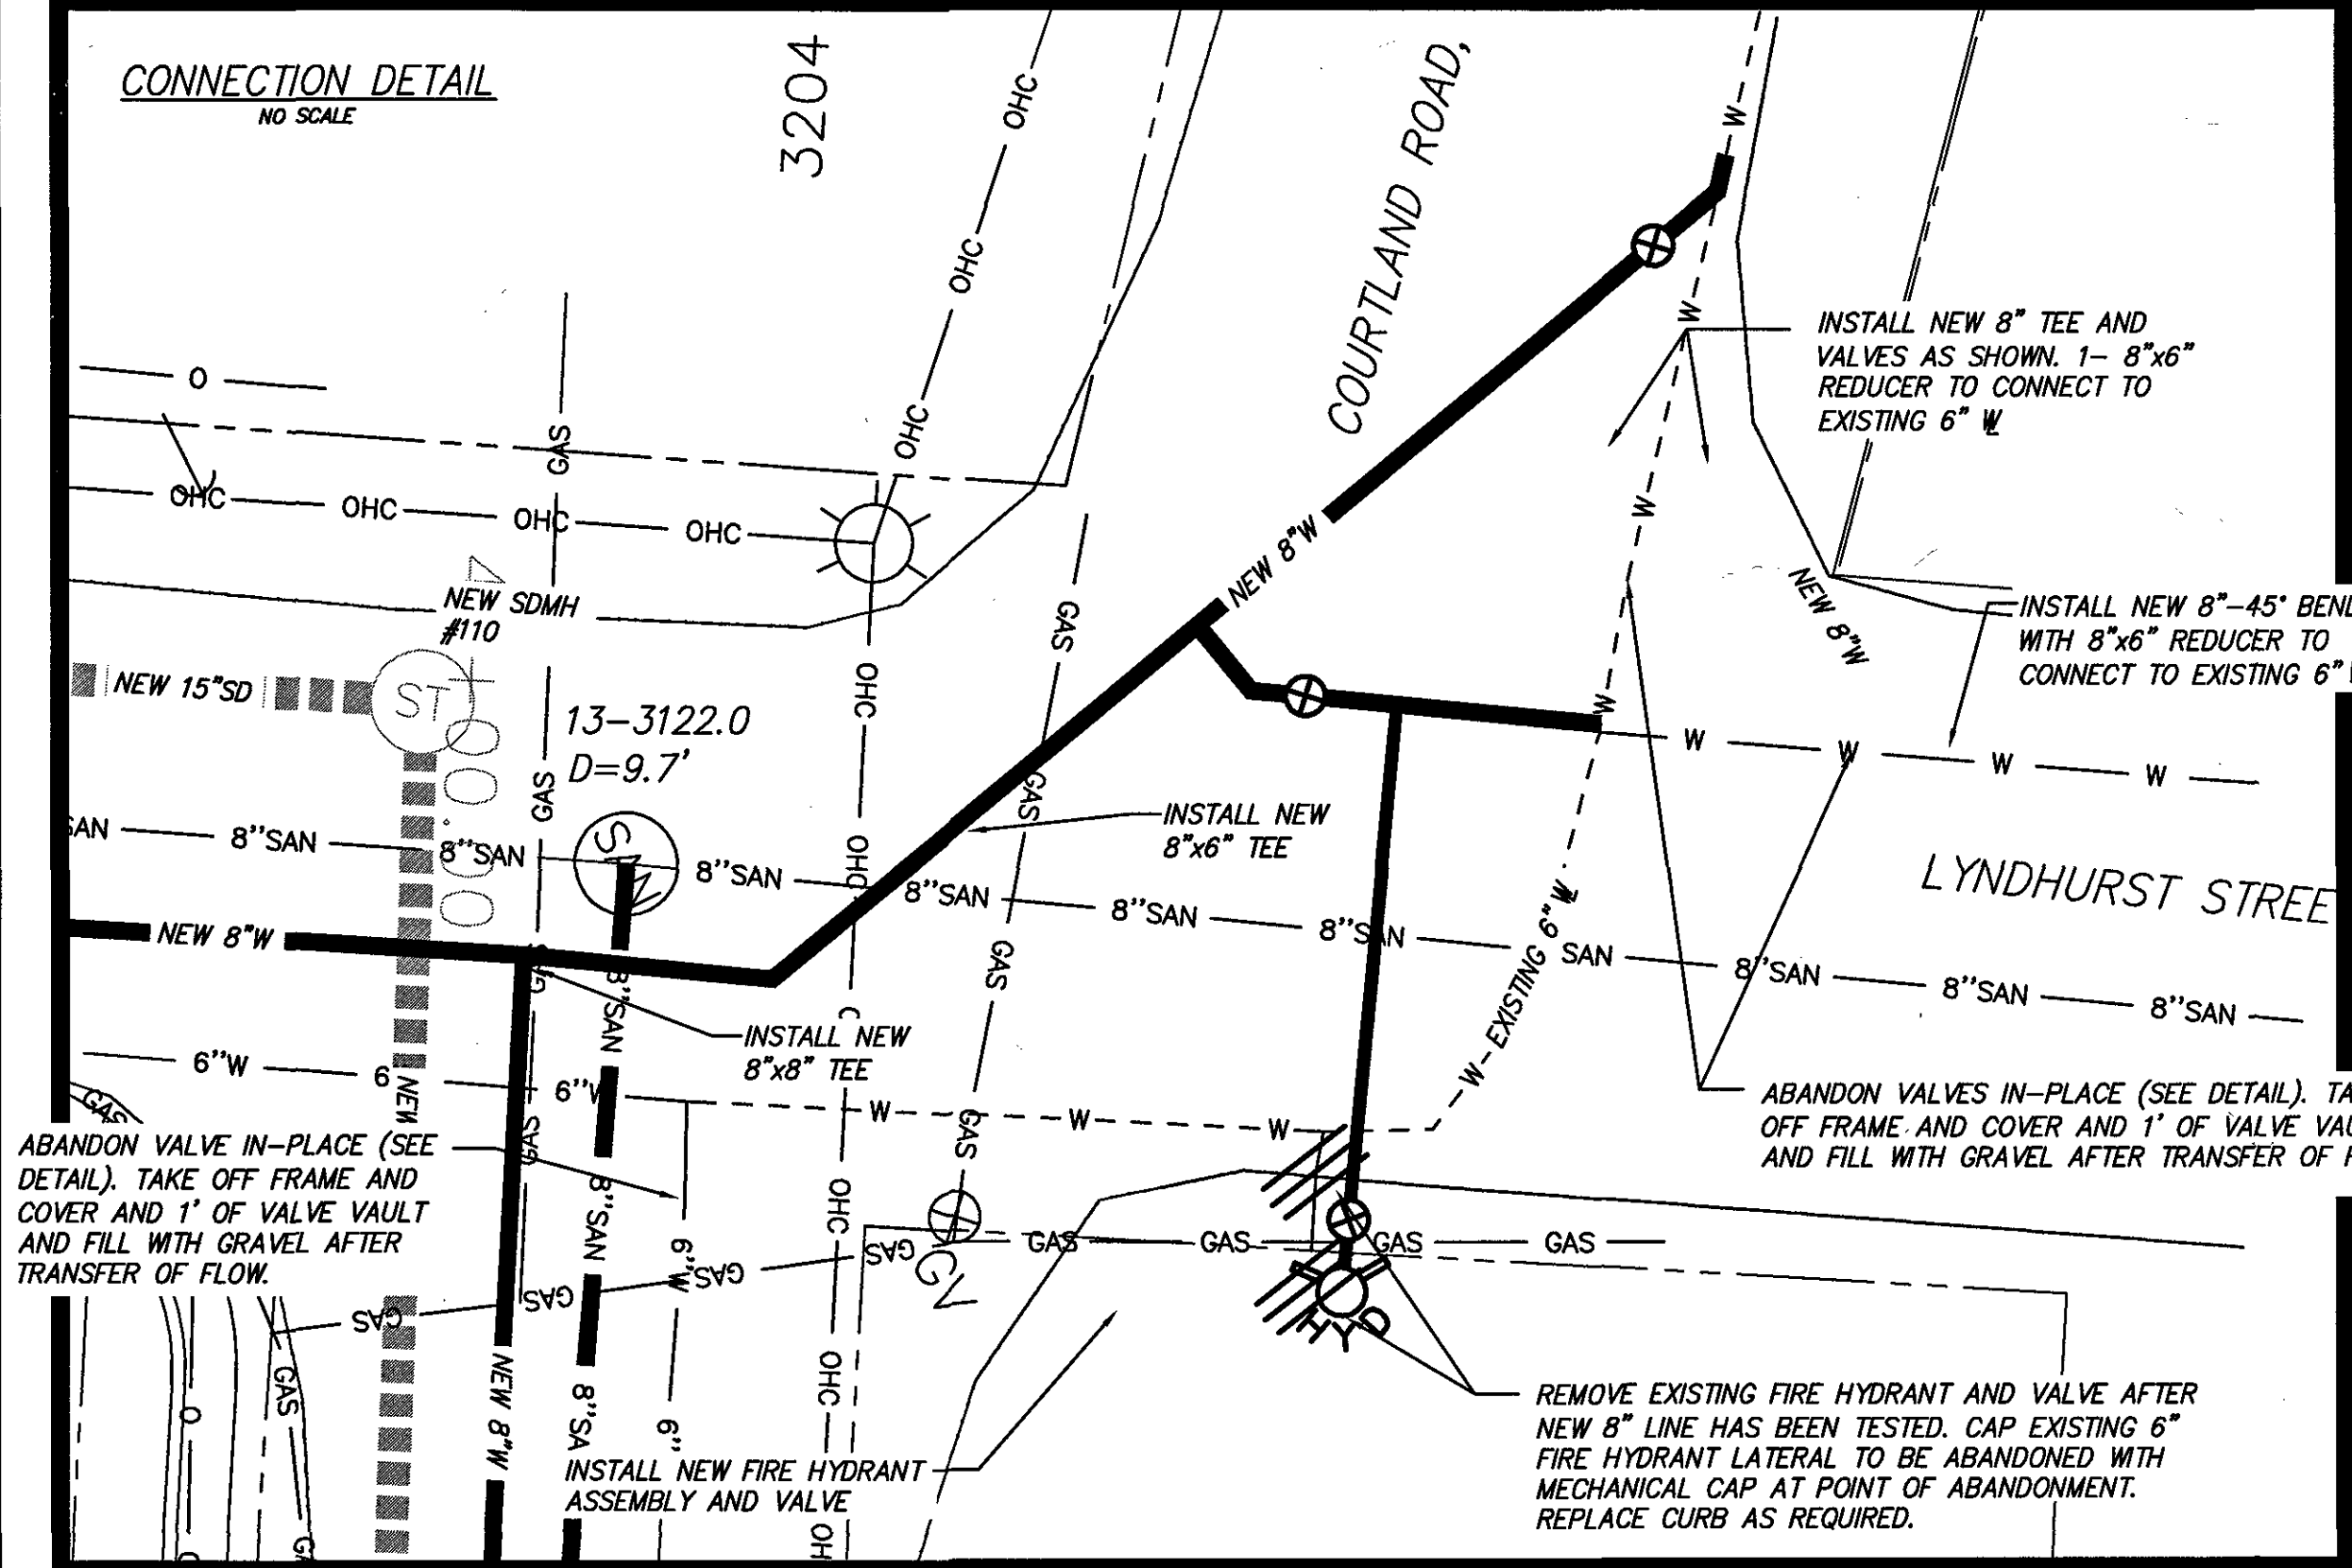


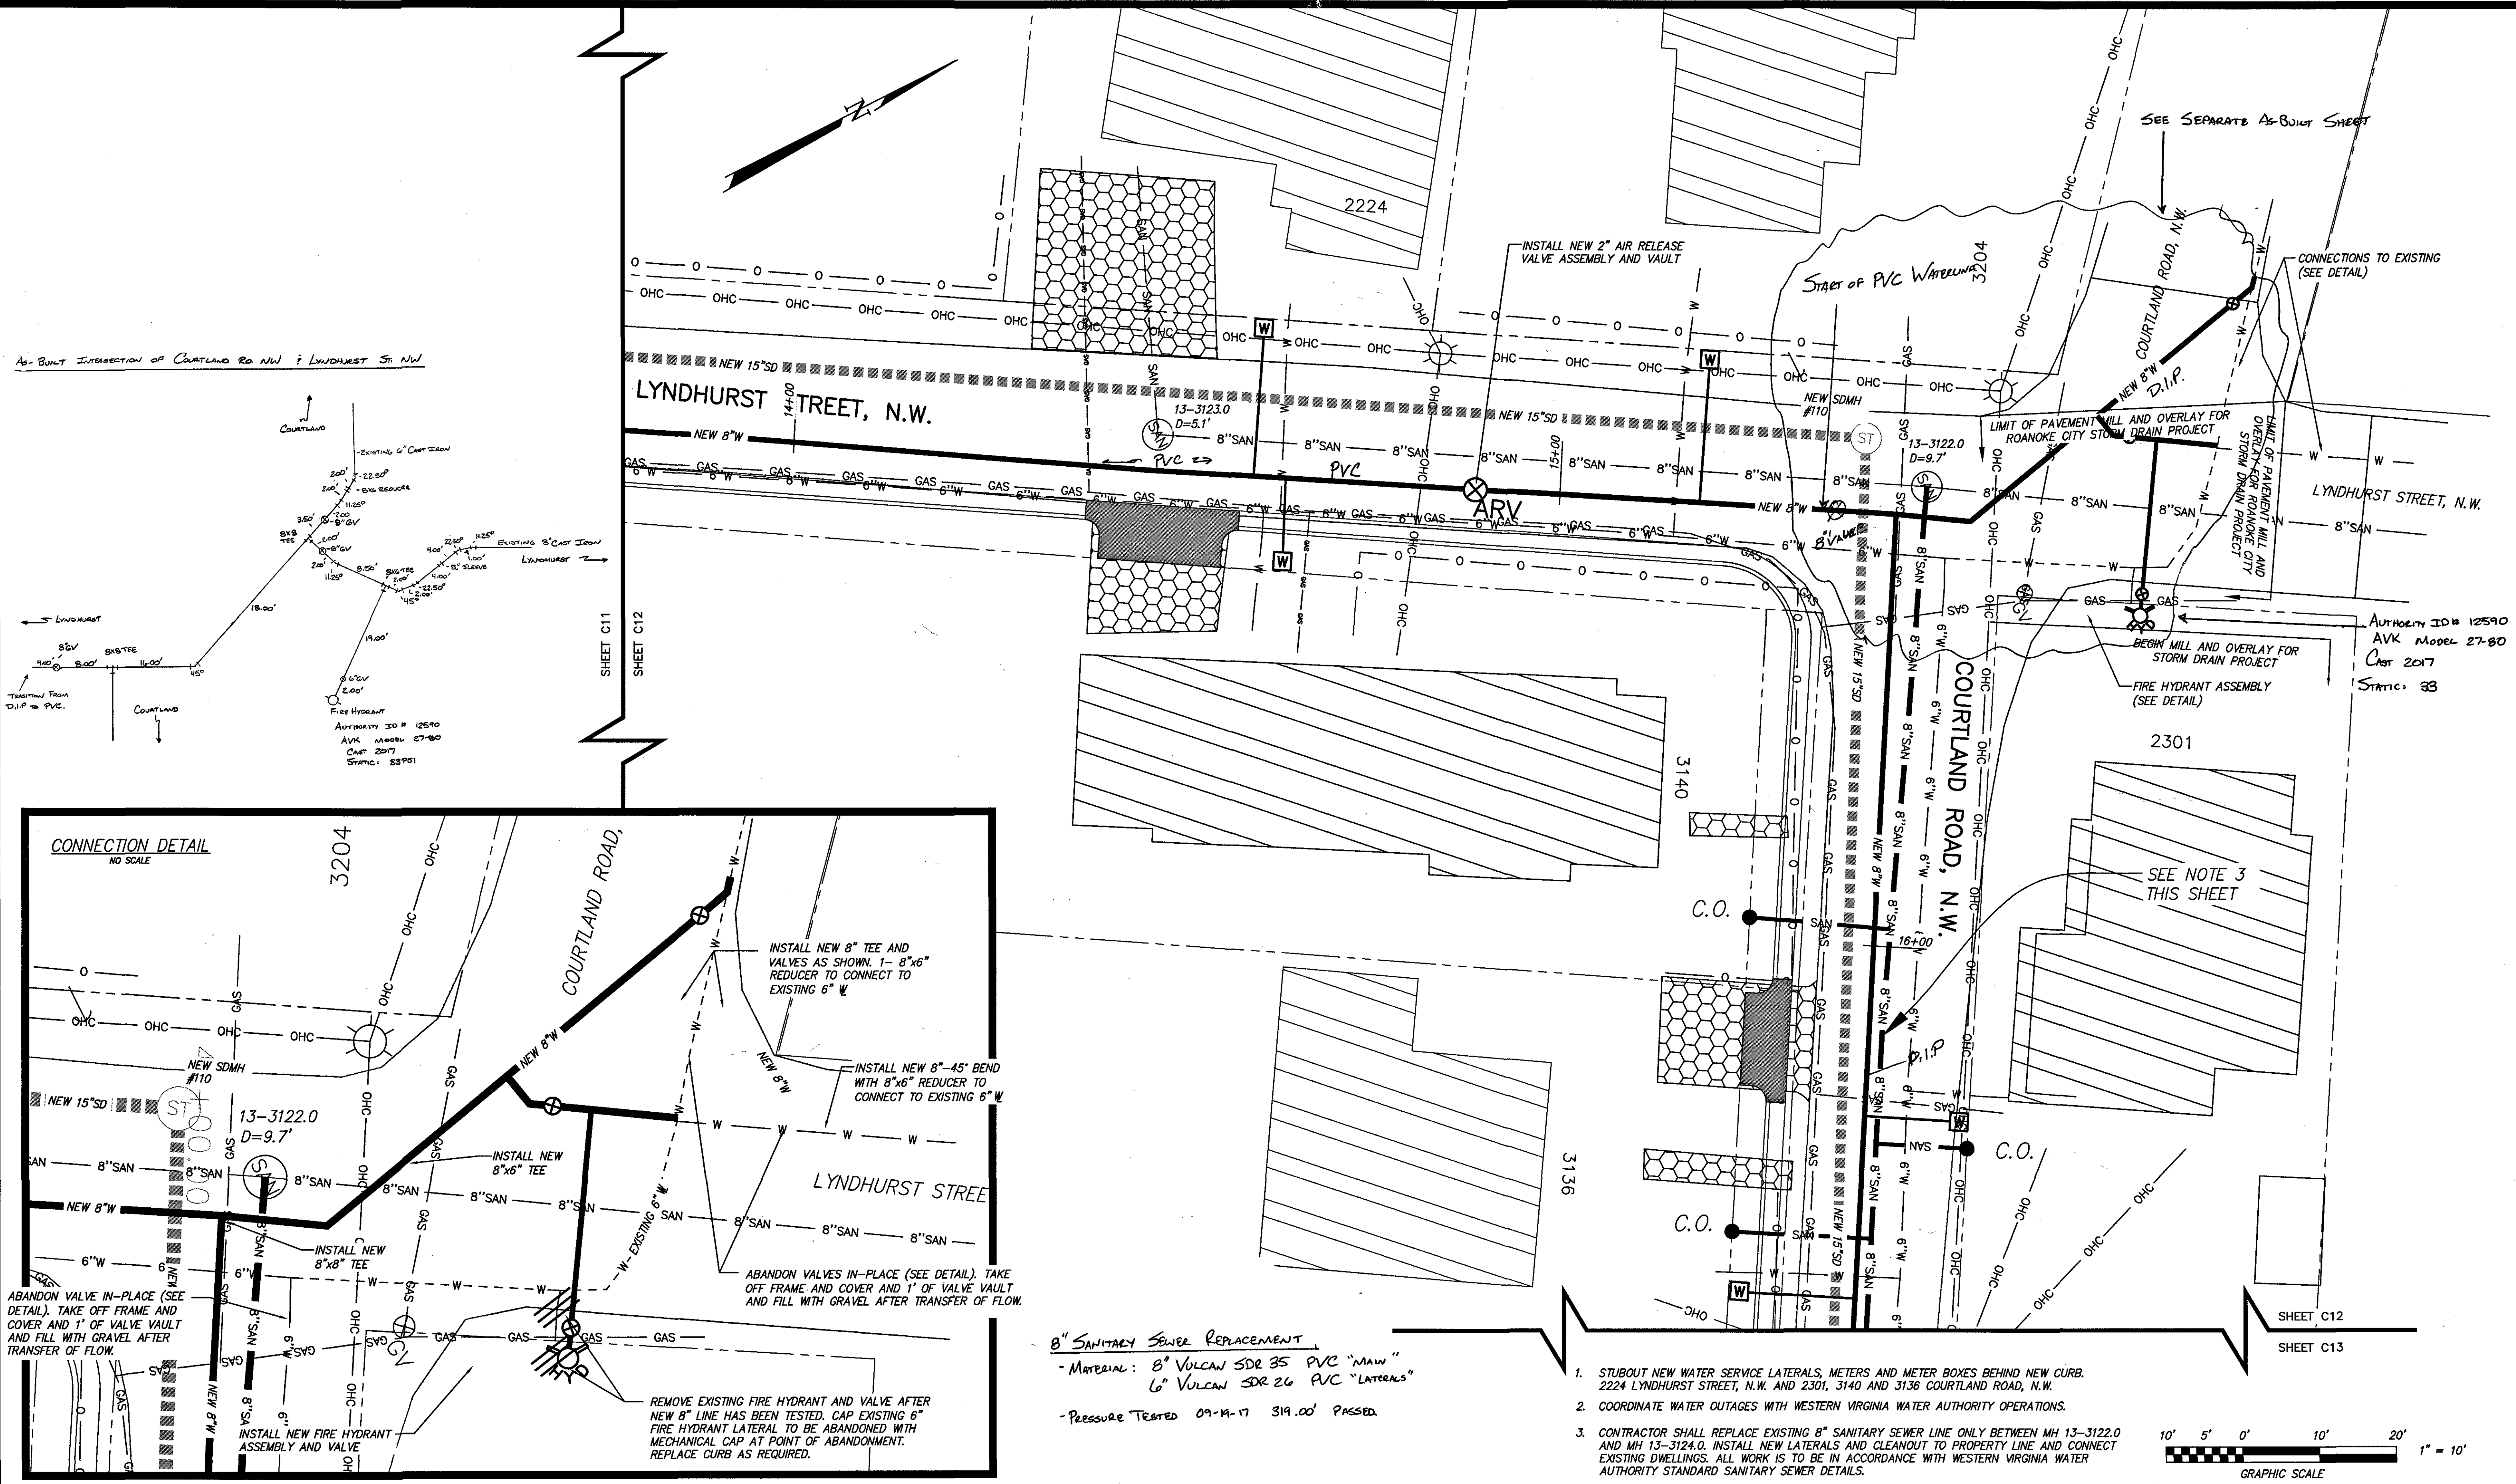


8" SANITARY SEWER REPLACEMENT
 - MATERIAL: 8" VULCAN SDR 35 PVC "MAIN"
 6" VULCAN SDR 26 PVC "LATERALS"
 - PRESSURE TESTED 09-14-17 319.00' PASSED

1. STUBOUT NEW WATER SERVICE LATERALS, METERS AND METER BOXES BEHIND NEW CURB. 2224 LYNDHURST STREET, N.W. AND 2301, 3140 AND 3136 COURTLAND ROAD, N.W.
2. COORDINATE WATER OUTAGES WITH WESTERN VIRGINIA WATER AUTHORITY OPERATIONS.
3. CONTRACTOR SHALL REPLACE EXISTING 8" SANITARY SEWER LINE ONLY BETWEEN MH 13-3122.0 AND MH 13-3124.0. INSTALL NEW LATERALS AND CLEANOUT TO PROPERTY LINE AND CONNECT EXISTING DWELLINGS. ALL WORK IS TO BE IN ACCORDANCE WITH WESTERN VIRGINIA WATER AUTHORITY STANDARD SANITARY SEWER DETAILS.

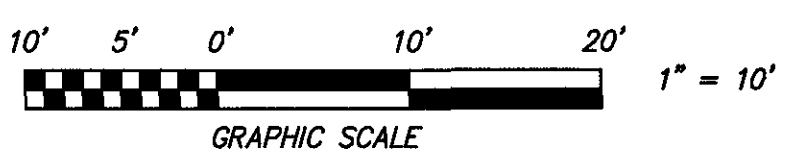

CWA
CALDWELL WHITE ASSOCIATES
 ENGINEERS / SURVEYORS / PLANNERS
 4203 MELROSE AVENUE, N.W. P.O. BOX 6260
 ROANOKE, VIRGINIA 24017-0260
 Telephone: (540) 366-3400 Fax: (540) 366-8702
 E-Mail: cwaroanoke@aol.com

DATE AUGUST 14, 2017
 PROJECT 17-0007
 DESIGNED CLH
 DRAWN CLH
 CHECKED FBC
 FIELD BOOK WYWA #1
 SCALE 1"=10'

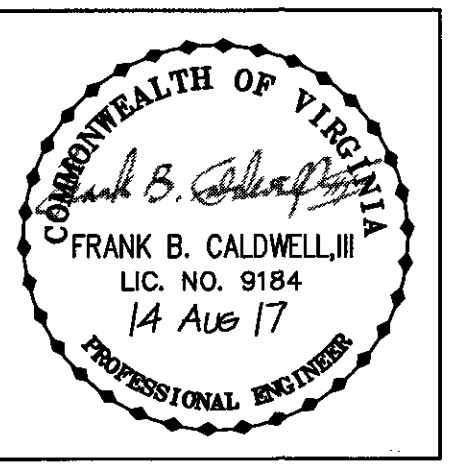

REV.	DATE	BY	DESCRIPTION

QUEEN AVENUE, N.W. - COURTLAND ROAD, N.W.
WATERLINE REPLACEMENT PROJECT
 PLAN SHEET