



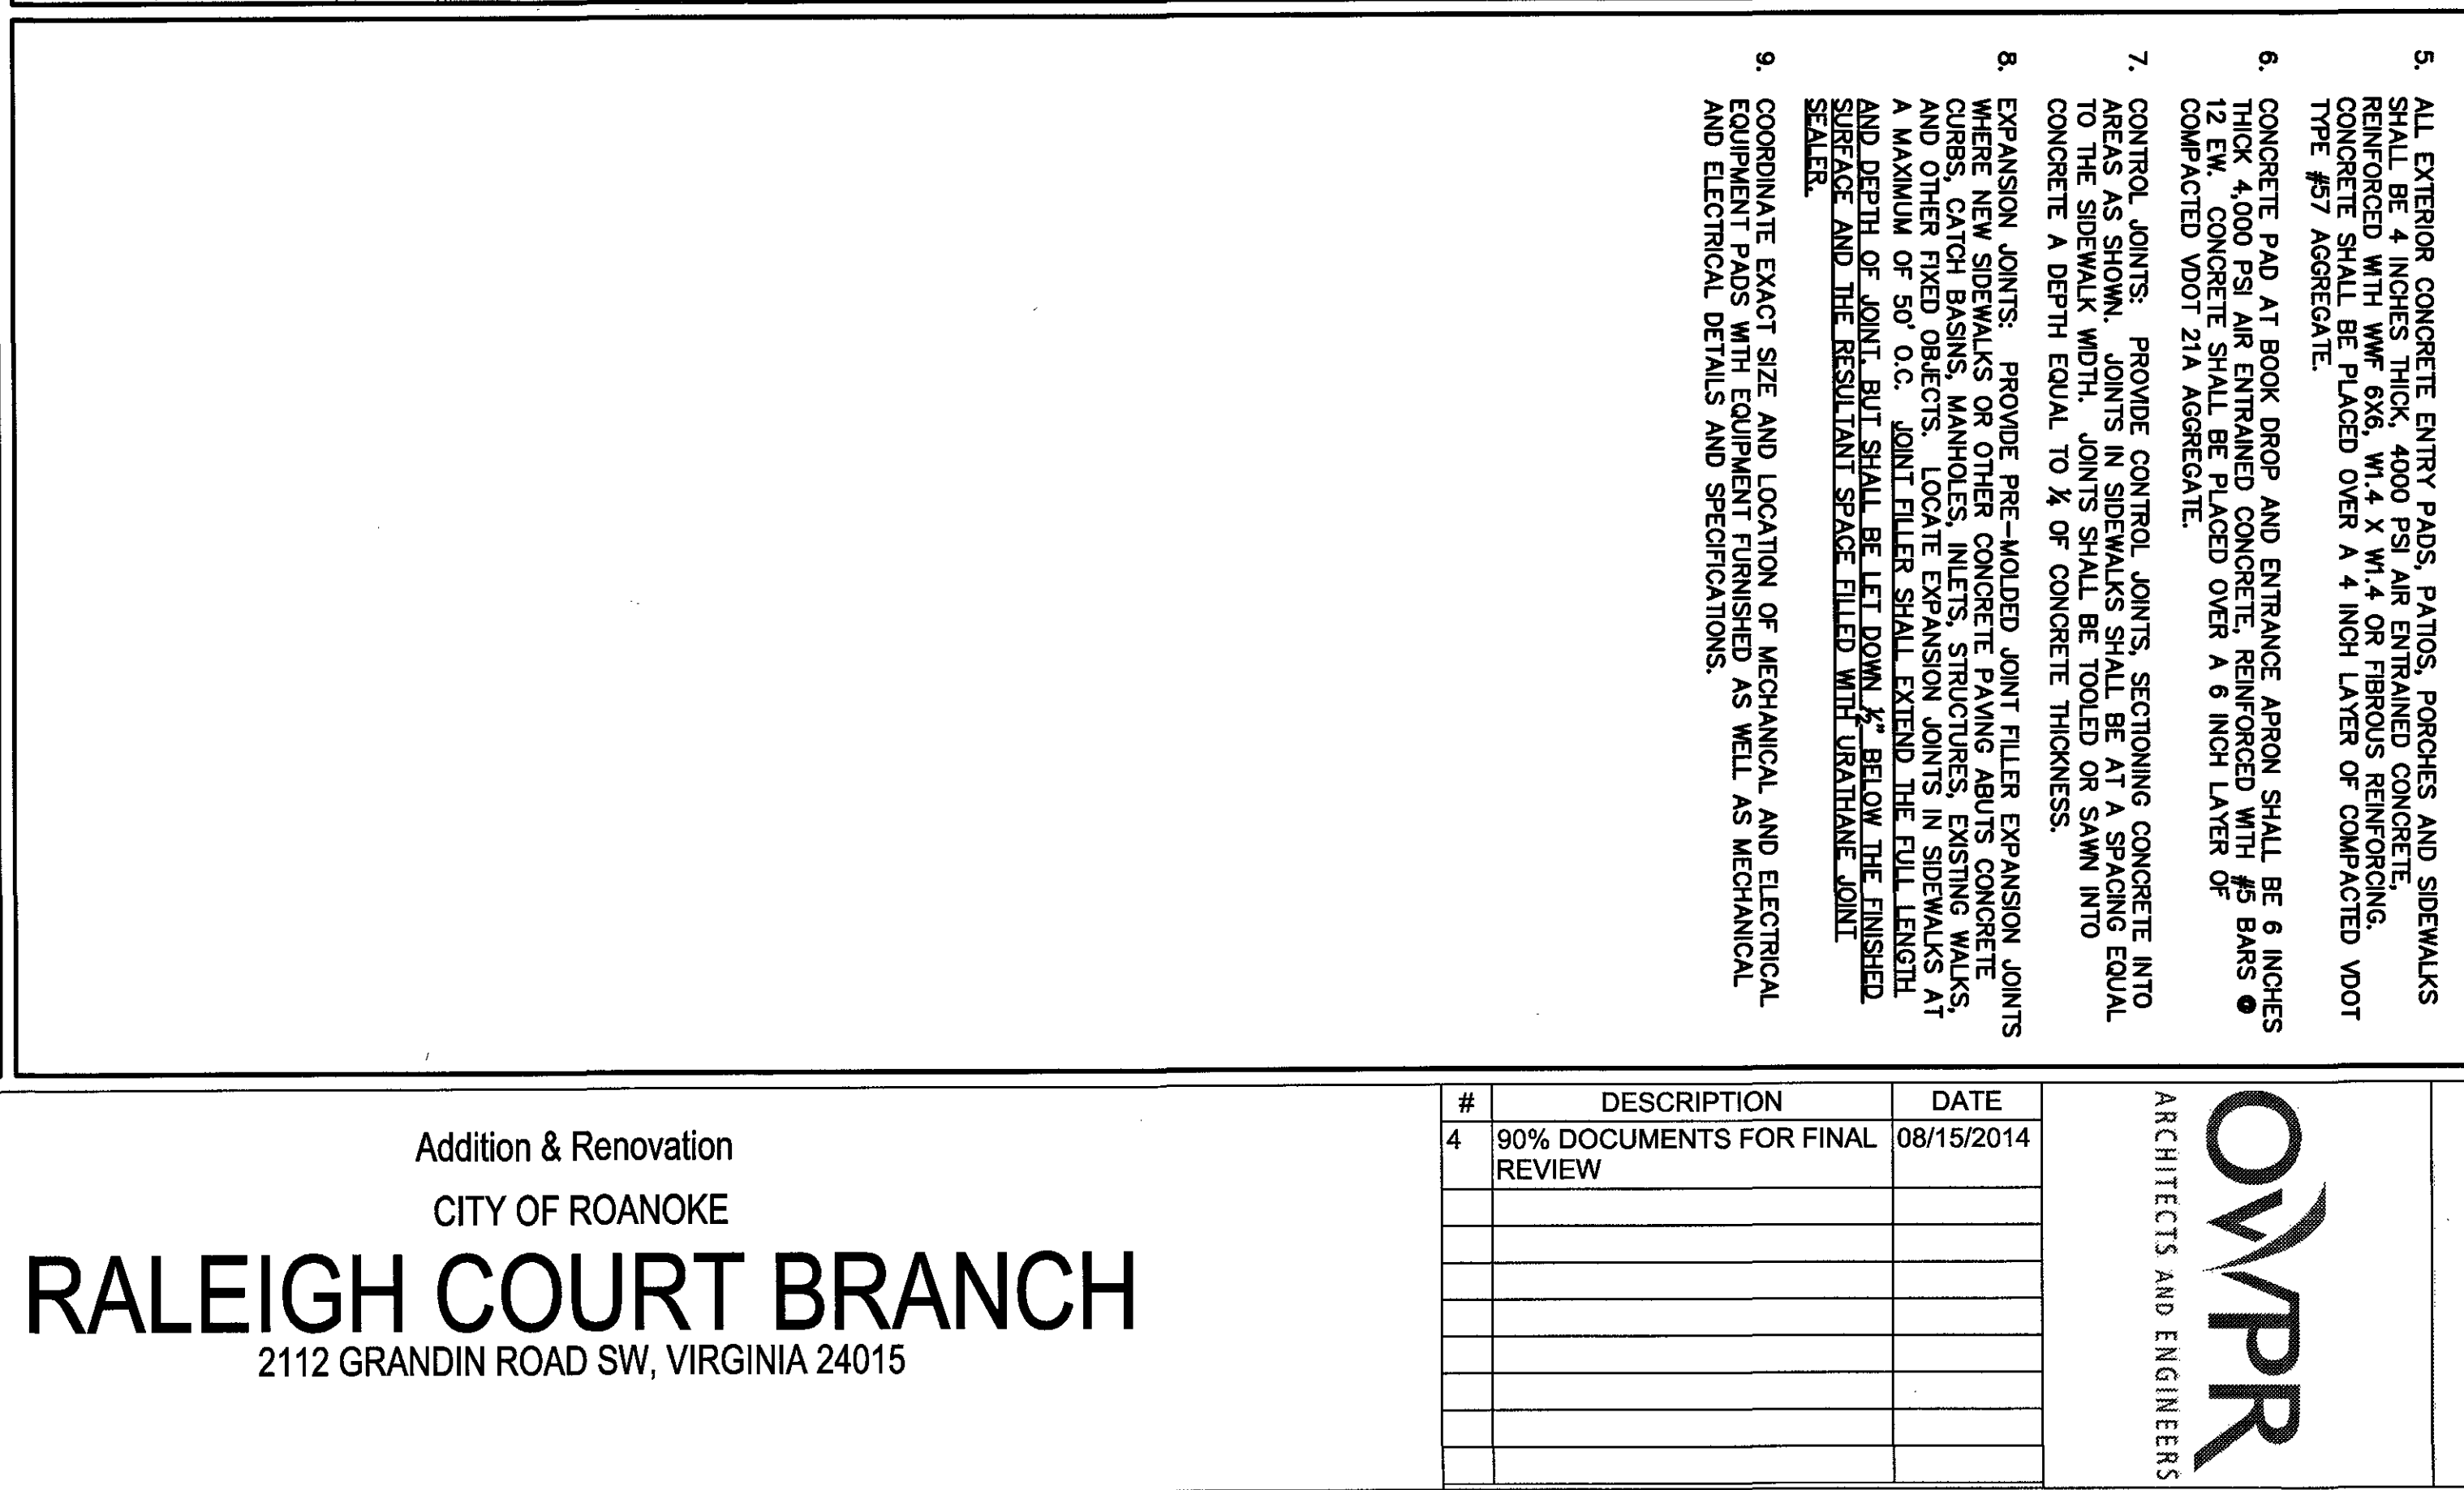

1. SEE ARCHITECTURAL SHEETS FOR BUILDING DIMENSIONS.
2. ALL DIMENSIONS SHOWN ARE TO FACE OF BUILDING, FACE OF CURB, EDGE OF PAVEMENT, AND PERPENDICULAR TO PROPERTY LINES.
3. ALL PARKING LOT AND SIDEWALK RADI SHALL BE 5 FEET UNLESS OTHERWISE NOTED.
4. PARKING SPACES SHALL BE 9'X18', UNLESS OTHERWISE NOTED, AND SHALL BE SEPARATED BY 4 INCH WIDE WHITE PAINTED LINES.
5. ALL EXTERIOR CONCRETE ENTRY PADS, PORCHES AND SIDEWALKS SHALL BE 4 INCHES THICK, 4000 PSI AIR ENTRAINED CONCRETE, REINFORCED WITH W#6 BARS, W/ 1 X W/ 4 OR TIEBARS REINFORCING. CONCRETE SHALL BE PLACED OVER A 4 INCH LAYER OF COMPACTED VDOT TYPE 1A40 AGGREGATE.
6. CONCRETE PAD AT BOOK DROP AND ENTRANCE APRON SHALL BE 6 INCHES THICK, 4000 PSI AIR ENTRAINED CONCRETE, REINFORCED WITH 6 BARS @ 12" ON CENTER. CONCRETE SHALL BE PLACED OVER A 6 INCH LAYER OF COMPACTED VDOT 21A AGGREGATE.
7. CONTROL JOINTS: PROVIDE CONTROL JOINTS SEPARATING CONCRETE INTO 12' MAXIMUM SPANS. IN SIDEWALKS SHALL BE A SPACING EQUAL TO THE SIDEWALK WIDTH. JOINTS SHALL BE TOoled OR SAWN INTO CONCRETE A DEPTH EQUAL TO 1/2 OF CONCRETE THICKNESS.
8. EXPANSION JOINTS: PROVIDE PRE-ADDED REINFORCED JOINT EXPANSION JOINTS WHERE NEW SIDEWALKS OR OTHER CONCRETE PAVING ADJUTS CONCRETE CURBS, CATCH BASINS, MANHOLES, INLETS, STRUCTURES, EXISTING WALKS, AND OTHER FIXED OBJECTS. LOCATE EXPANSION JOINTS AT 12' SPACING AND DEPTH OF JOINT, BUT SHALL BE LET DOWN 2" BELOW THE FINISHED SURFACE AND THE RESULTANT SPACE FILLED WITH URETHANE JOINT SEALER.
9. COORDINATE EXACT SIZE AND LOCATION OF MECHANICAL AND ELECTRICAL EQUIPMENT PADS WITH EQUIPMENT FURNISHED AS WELL AS MECHANICAL AND ELECTRICAL DETAILS AND SPECIFICATIONS.

[illegible]

OVP
ARCHITECTS AND ENGINEERS

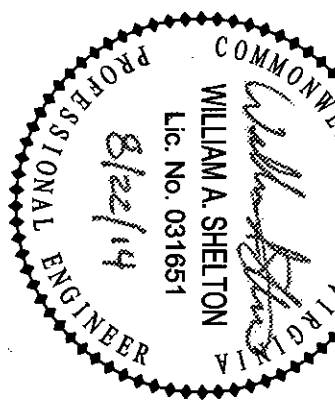

RALEIGH COURT BRANCH

2112 GRANDIN ROAD SW, VIRGINIA 24015

2112 GRANDIN ROAD SW, VIRGINIA 24015

PROJECT NO:
14001

SCALE:
AS INDICATED

DIMENSIONAL PLAN

DIMENSIONAL PLAN

C1.2

1382 West Ninth Street
Suite 300
Cleveland, Ohio

www.HBMarChitects.com

HBM