


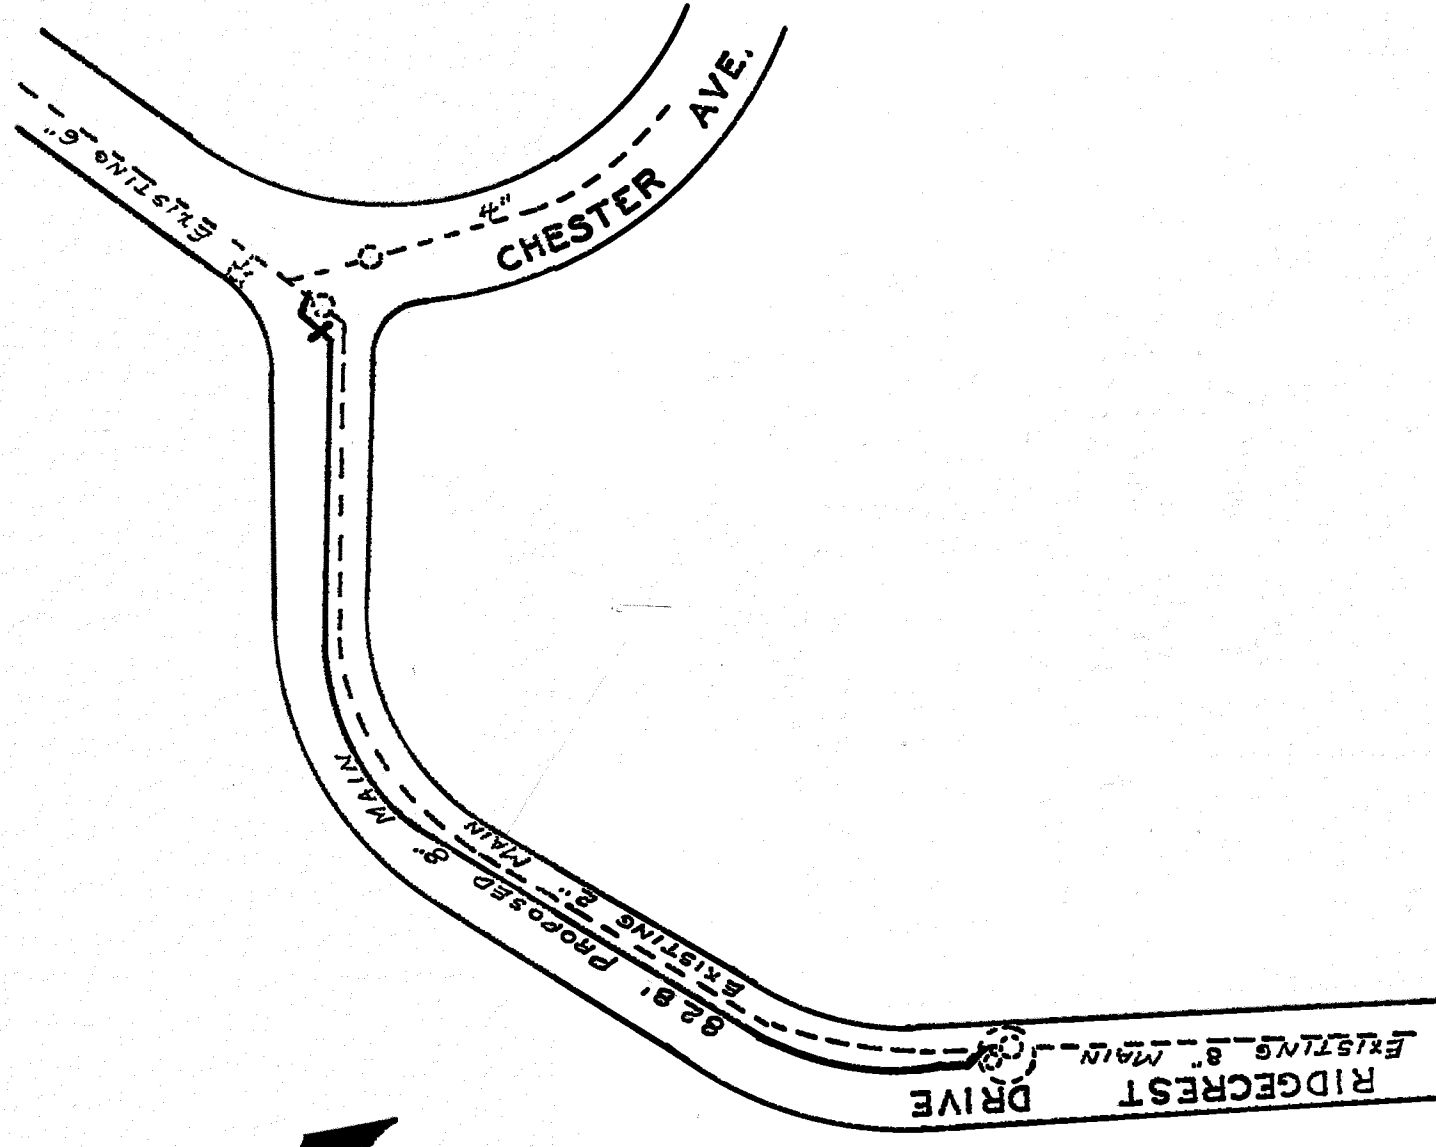

DATE STARTED		JUL 18 1967		
DATE COMP.		JUL 28 1967		
FEET MAIN	SIZE	VALVE	VAULT	BOX
828'	8"	1-0"	1	
3'	6"			
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: R. W. D.				
NO. 3/4" SERV. INS.				
CITY OR CO.		COUNTY		
DEPT. INSP.		D. T. M.		

WATER DEPARTMENT
CITY OF ROANOKE, VA.
RIDGECREST DRIVE N.E.

SCALE - 1"=100'
DRAWN BY E.L.A. JULY, 6, 1967