


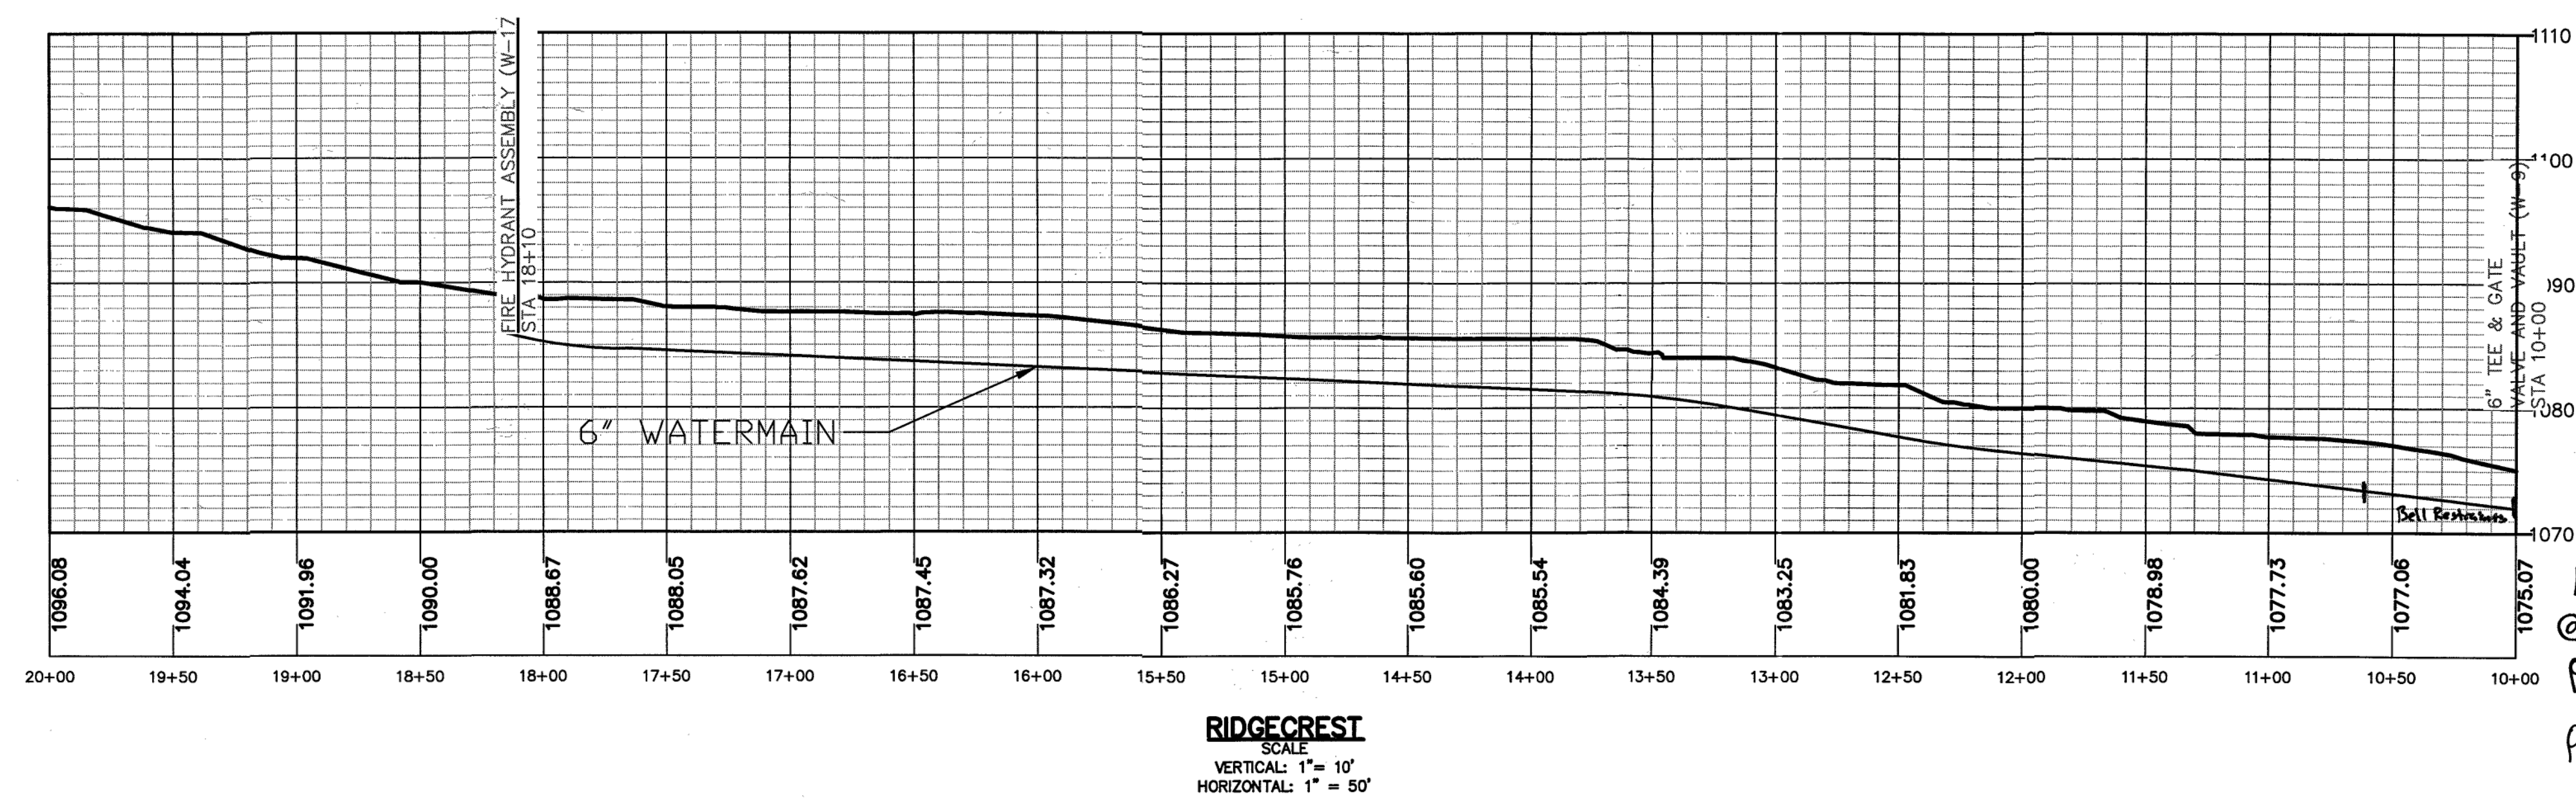

Pipe - Main - 6" PVC Vulcan C900  
U.S. 6" Ductile Iron 350  
Pipe

U.S. 6" Ductile Iron 350  
Pipe

Services - 1" Endot CTS Tubins

Valves - 6" AFC Resilant Seat  
Gate Valves

Gate Valves

Hydrants - AMERICAN ~~2016~~ 2016  
AFC-MODEL B-84-B-5

AFC-MODEL B-84-B-5

Line-tested on Thursday July 28, 2016  
@ 8:30 a.m. @ 200 PSI

@ 8:30 a.m @ 200 P.S.I

Passed 1<sup>st</sup> Attempt

Passed 1st Attempt  
put In Service on Aug. 3<sup>rd</sup> @ 3:00pm.

\*old 3" MAIN ABANDONED by FOD (WVWA)