

General Notes:

The material and construction of sanitary sewer mains, laterals and manholes to conform to standards and specifications of Engineering Department of City of Roanoke, Va.
Infiltration shall not exceed one gallon per linear foot of 8" main per day. Maximum infiltration of other size main in direct proportion to size of main.
6" laterals to be installed to street line from mains on 2% or 1/4" per foot fall.
Manhole lids to contain the writing
Roanoke Sewer/County

Approved: H. Clinton Bragley 4-16-58
Roanoke City Engineer date

Approved: J. R. Hildebrand Apr. 16, 1958
Agent for Roanoke Planning Comm. date

Approved: Jerry R. KeCo. Planning Comm. date

PLAN & PROFILE

Sanitary sewer in Edmund Park



owned by John A. Stoversky & B. L. Radtke
Roanoke County, Va.

Plan Scale: 1"=100' Mar. 22, 1958

By: T. F. Parker
S.C.E.

Existing Manhole Quantities req'd:

8" T.C. Main = 4703 ft
6" T.C. lateral = 2744 ft
Manholes = 20

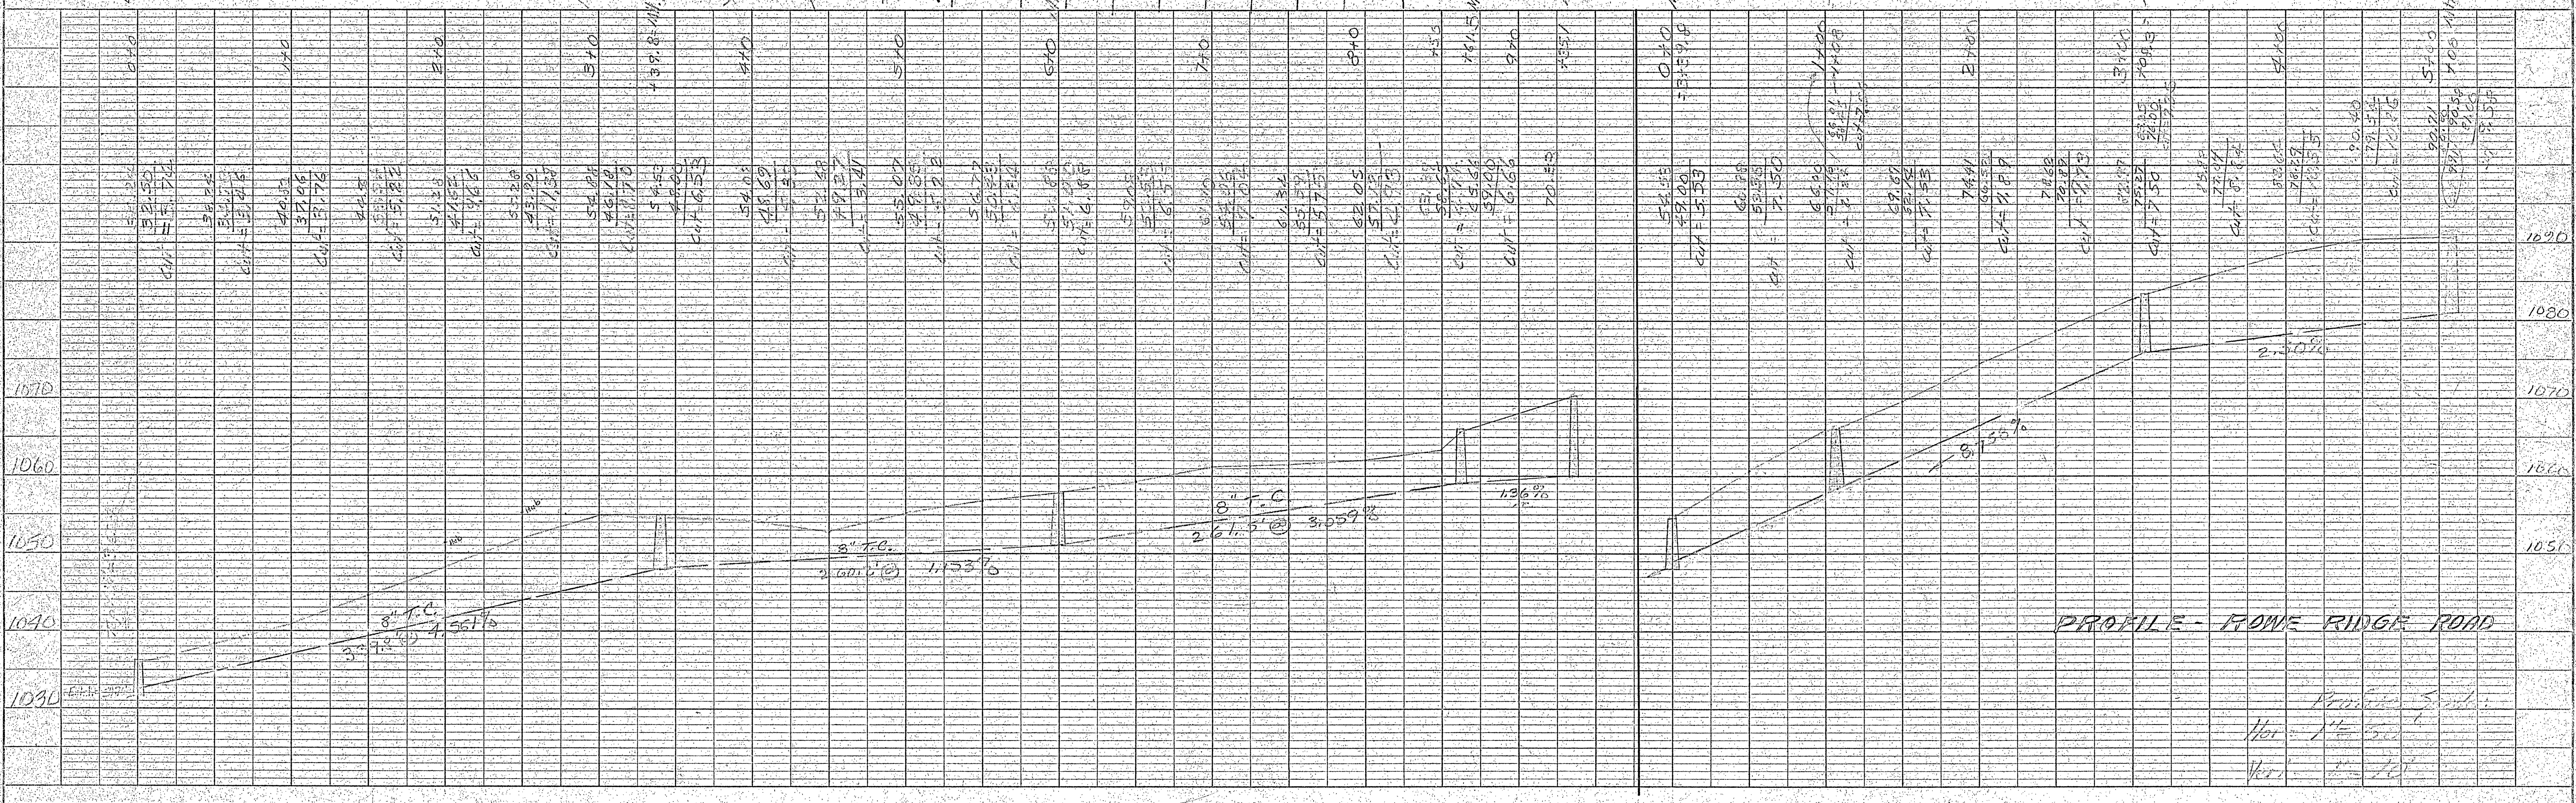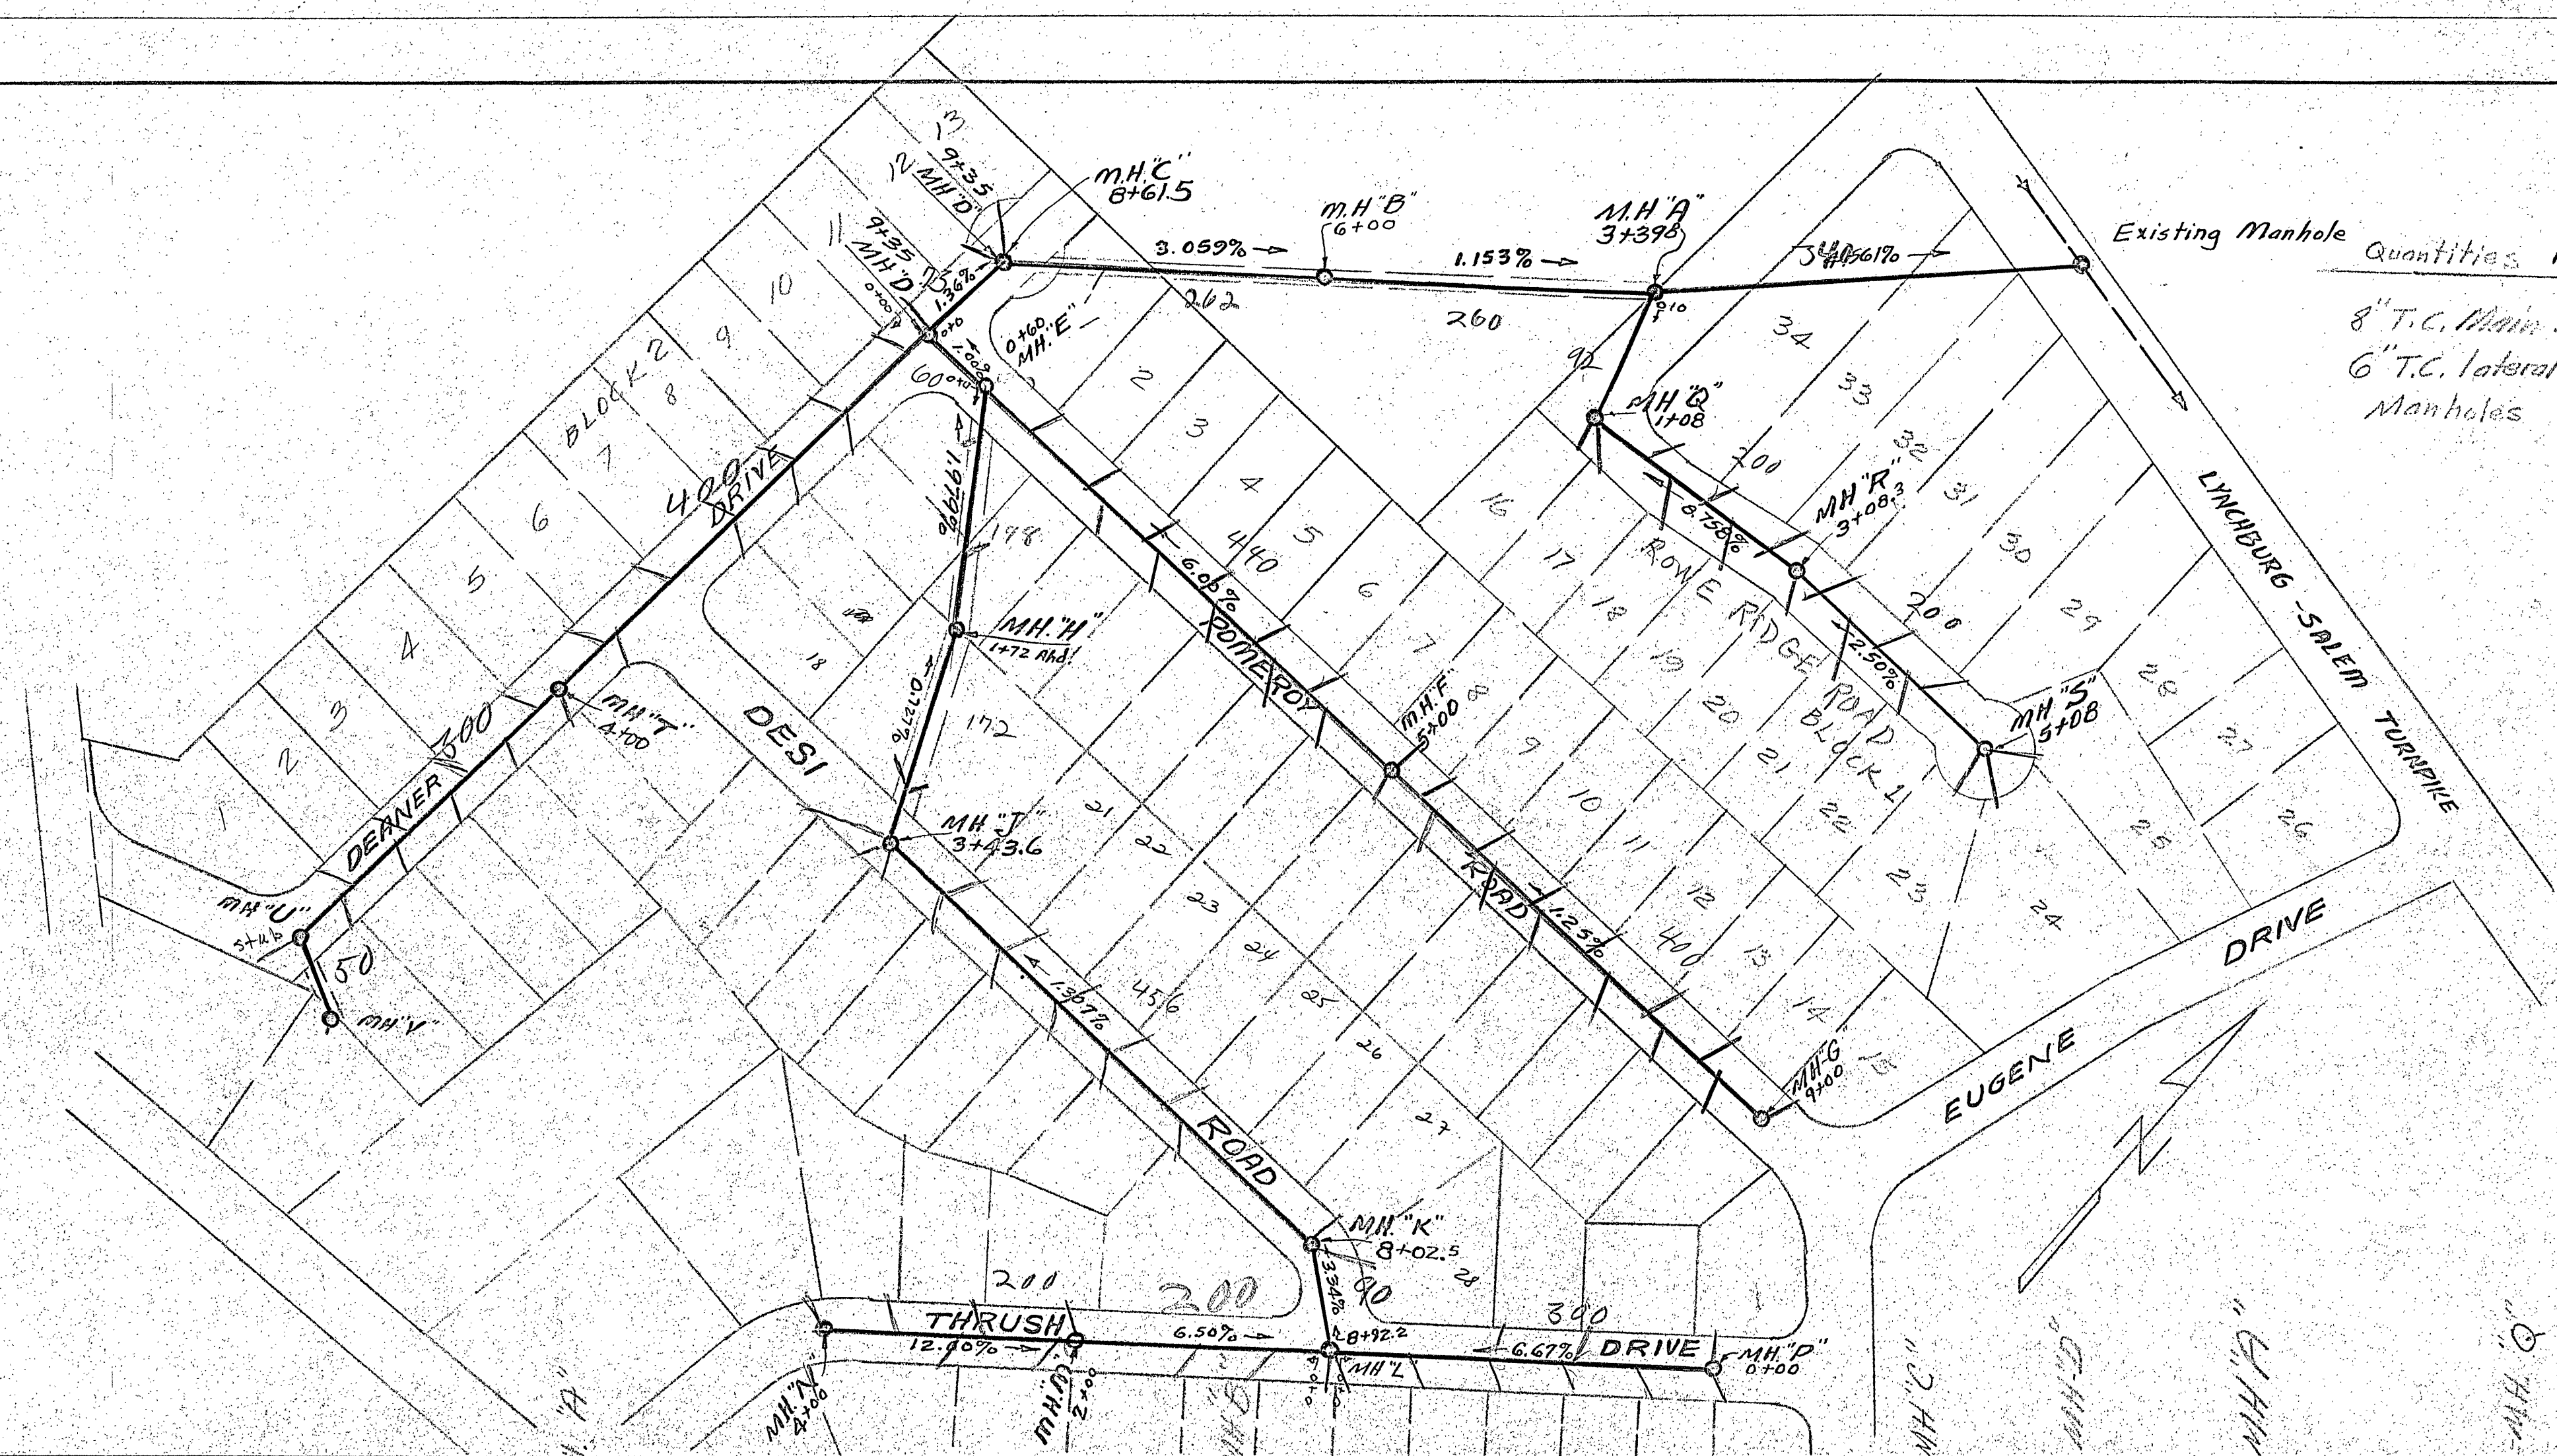

PROFILE - ROWE RIDGE ROAD

Profile Scale: 1"=10'
Hor. Scale: 1"=50'
Ver. Scale: 1"=10'