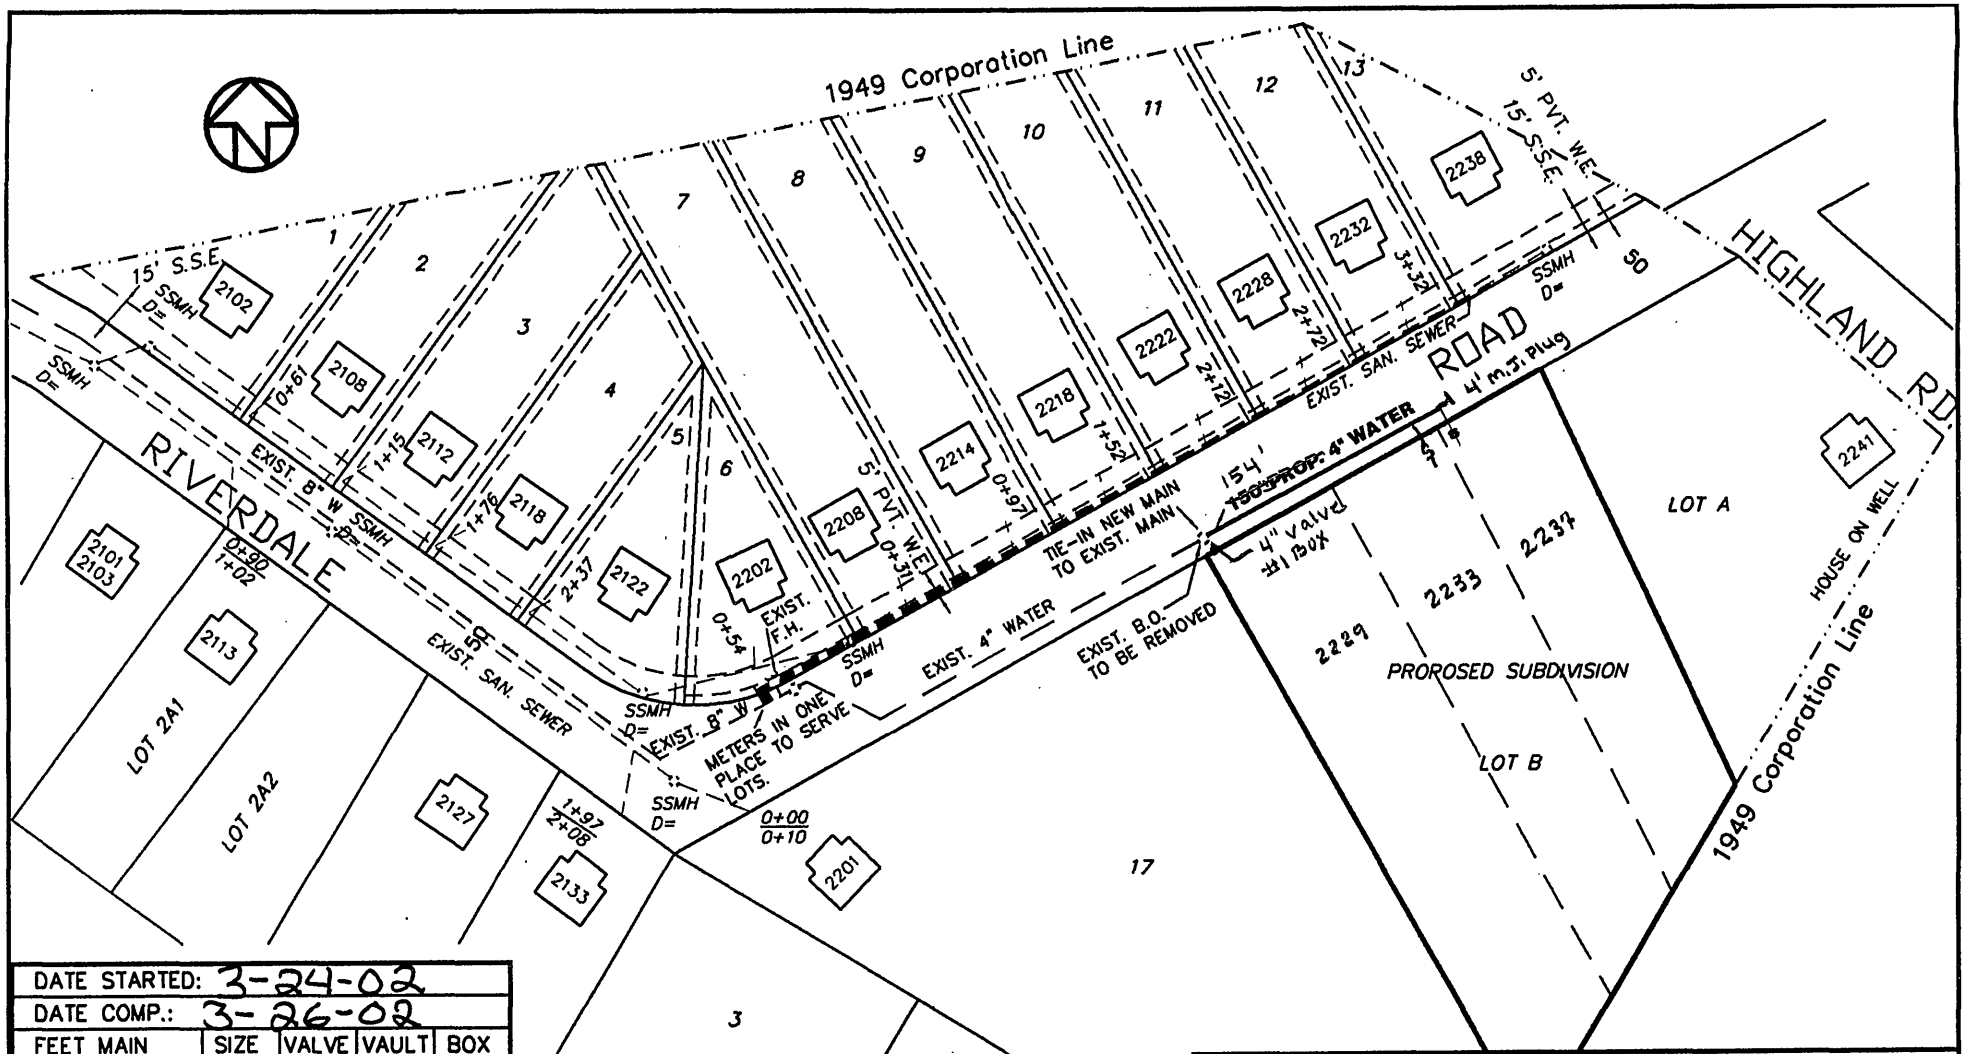

DATE STARTED: 3-24-02				
DATE COMP.: 3-26-02				
FEET MAIN	SIZE	VALVE	VAULT	BOX
154 FT	4"	1	0	#1
F.H. COMP. 0				
F.H. STUB ONLY 0				
SERV.INS.BY: R.W				
MAIN INS.BY: R.W				
NO.3/4"SERV.INS.: 2				
CITY OR CO.: City				
DEPT.INSP.				

NOTE: LOCATION OF ALL UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.

ROANOKE WATER DIVISION VIRGINIA

RIVERDALE ROAD, S.E.

SCALE:	1"=100'		
DATE:	10/19/2001	DIRECTOR OF UTILITIES	DATE 10/29/01
DIST. MAP:	T# 443 CAD# 0672	MANAGER OF WATER DIVISION	DATE
PLAN NO.:	01-10	SUPERINTENDENT OF UTILITY LINE SERVICES	DATE 10-22-01