


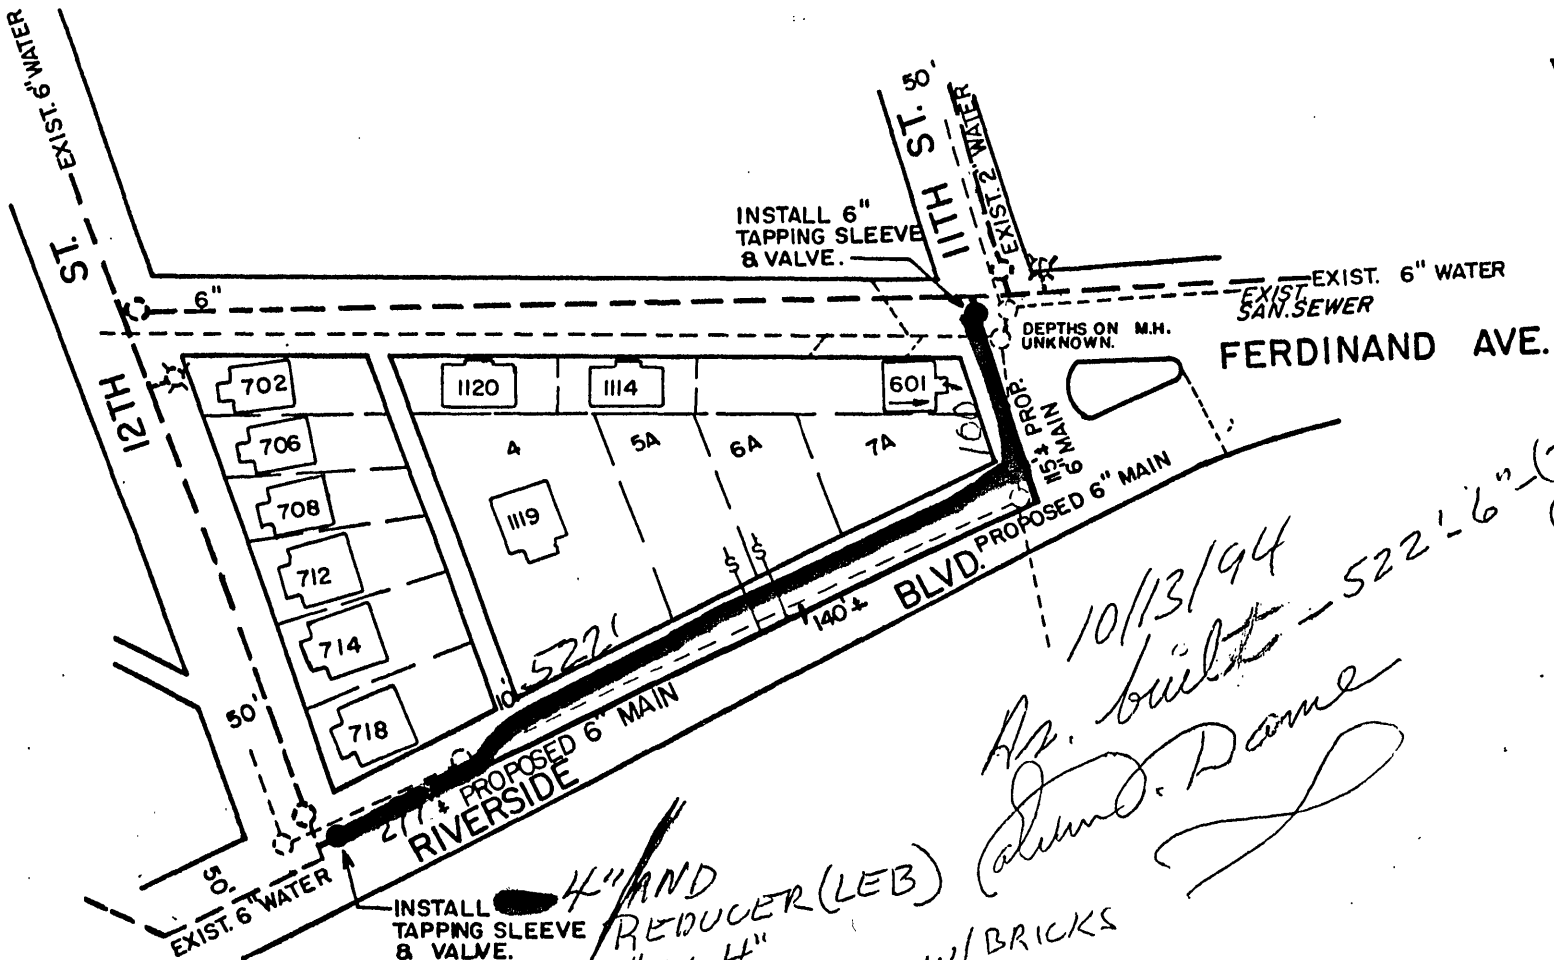

INSTALL TAPPING SLEEVE & VALVE.

4" AND REDUCER (LEB) 6" TO 4"

TWO M.H. - BUILT W/ BRICKS DUE TO ELEVATIONS.

NOTE: ALL EXISTING UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.

DATE 10-5-94
DATE COMP. 10-13-94

FEET MAIN	SIZE	VALVE	VAULT	BOX
522	6	2	2	

CH. COMP. 0
M.H. STUB ONLY 0

SERV. INS. BY:
MAN. INS. BY: *John D. Dams*
NO. 3/4" SLIP. INS.
DIP. OR 00
DEPT. INS.

John D. Dams
MANAGER UTILITY LINE SERVICES

10/13/94
As. built - 522'-6" - (2) BENDS
(2) M.H. VALUES

WATER DEPARTMENT	
ROANOKE VIRGINIA	
RIVERSIDE BOULEVARD AND 11TH STREET, SW	
SCALE: 1" = 100'	DIRECTOR UTILITIES & OPERATIONS DATE
DATE 9/1/94	
DIST MAP: 122	
PLAN NO: 94-13	DIRECTOR OF PUBLIC WORKS DATE