



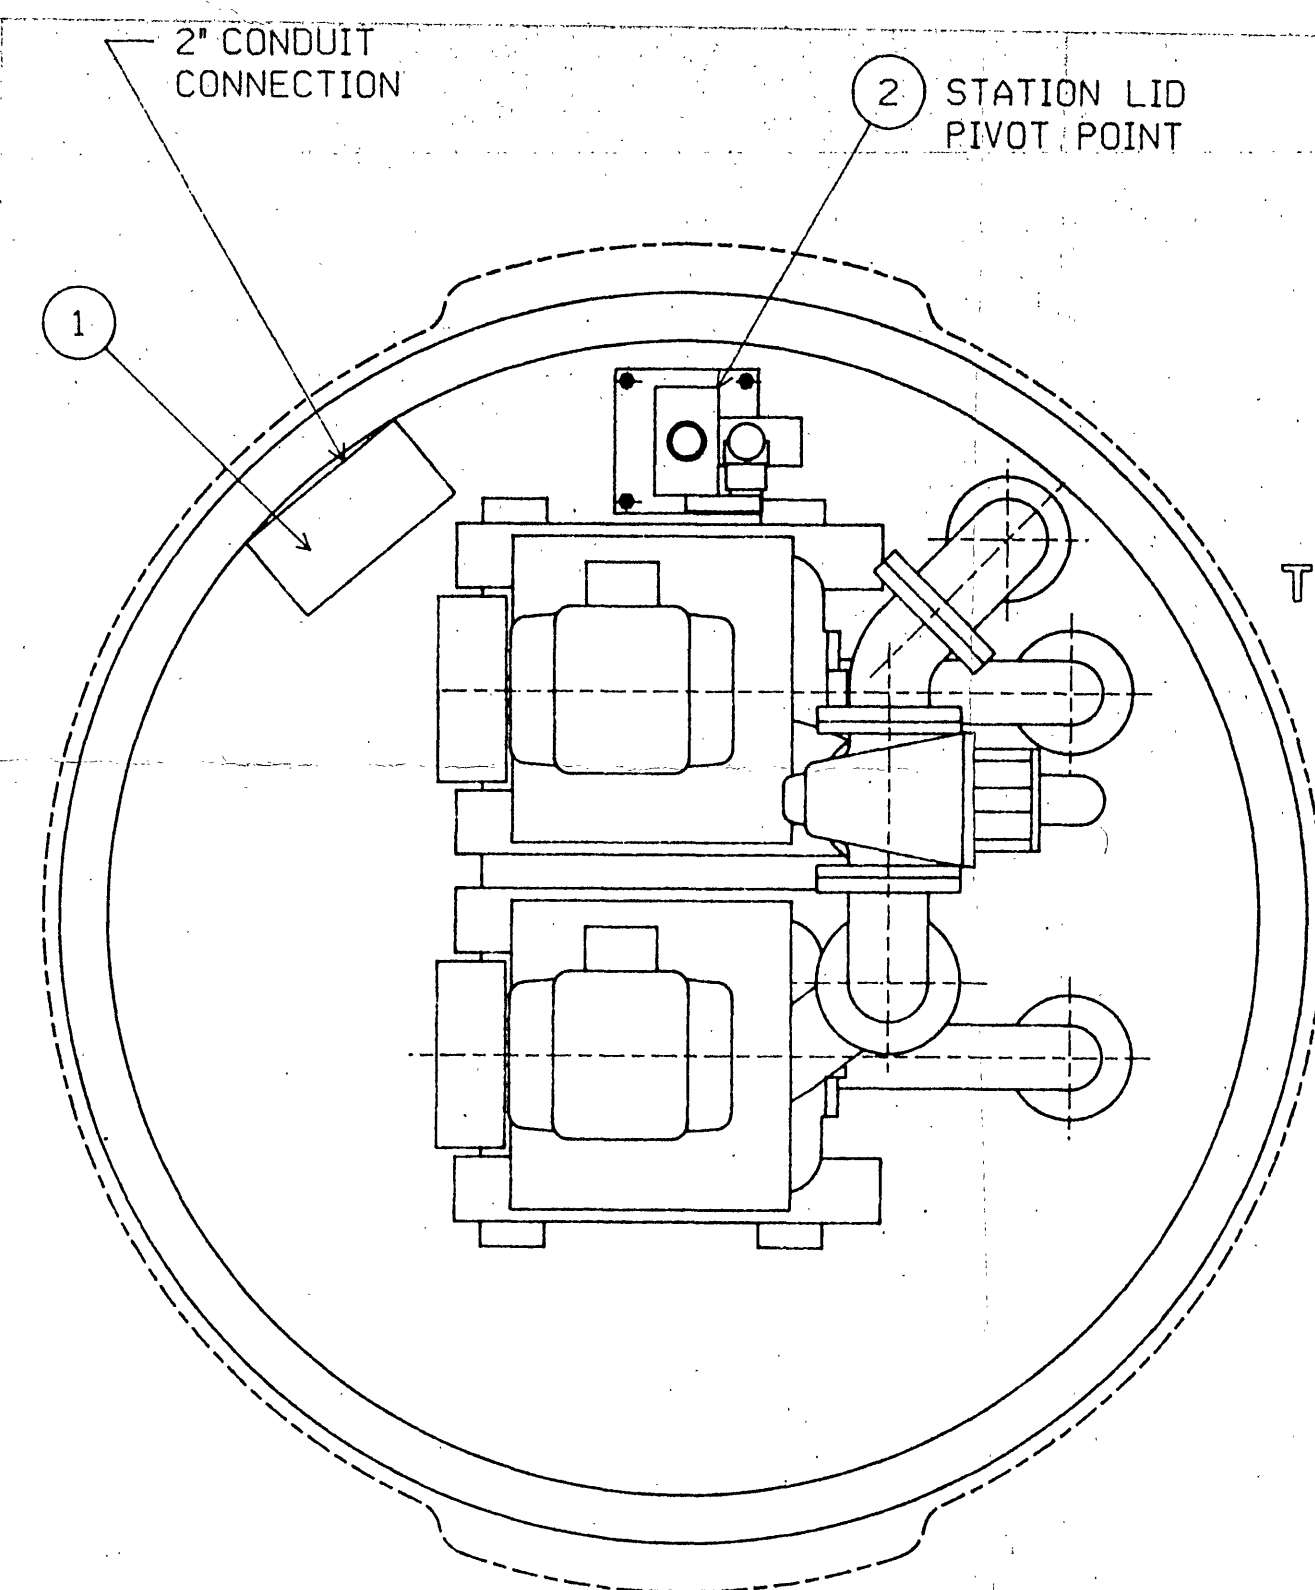

TOP VIEW


72\"/>

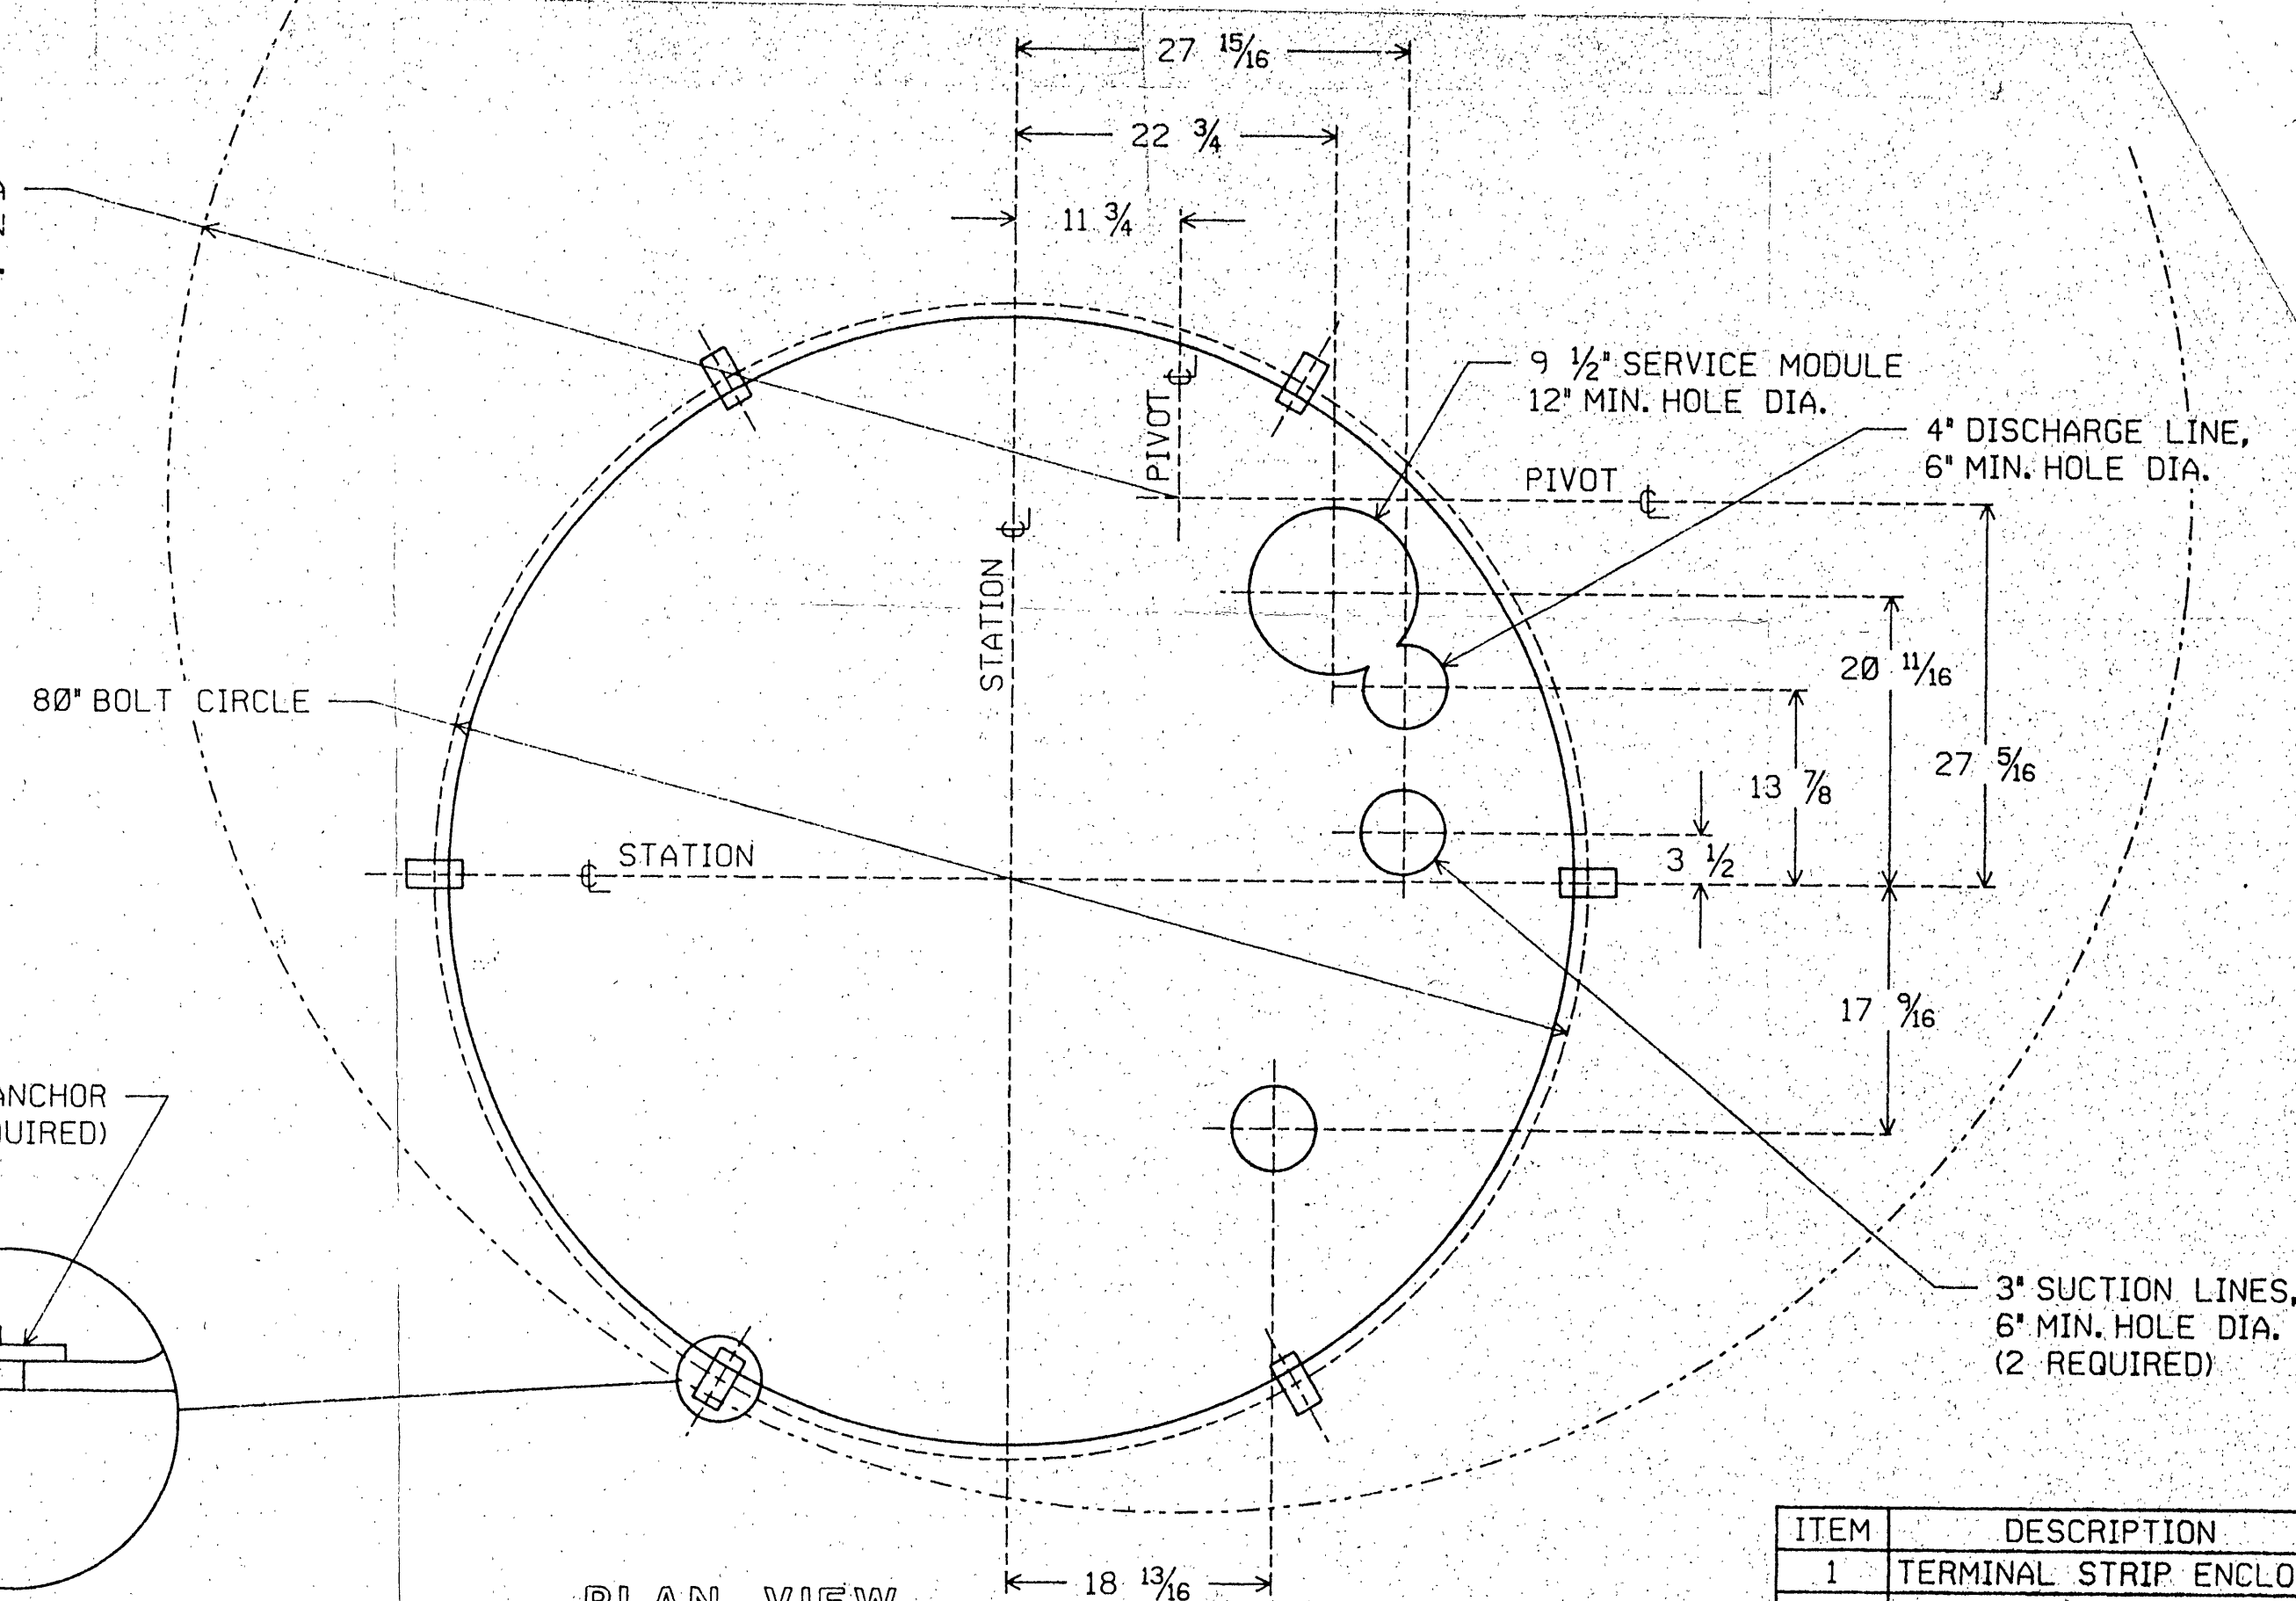


PLAN VIEW

NOTE: PLAN VIEW HAS BEEN ROTATED 23° CLOCKWISE WITH RESPECT TO TOP VIEW.

STAINLESS STEEL ANCHOR ASSY. (6 REQUIRED)

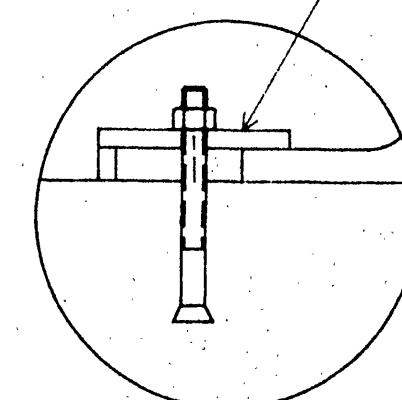


DETAIL OF STATION ANCHORS

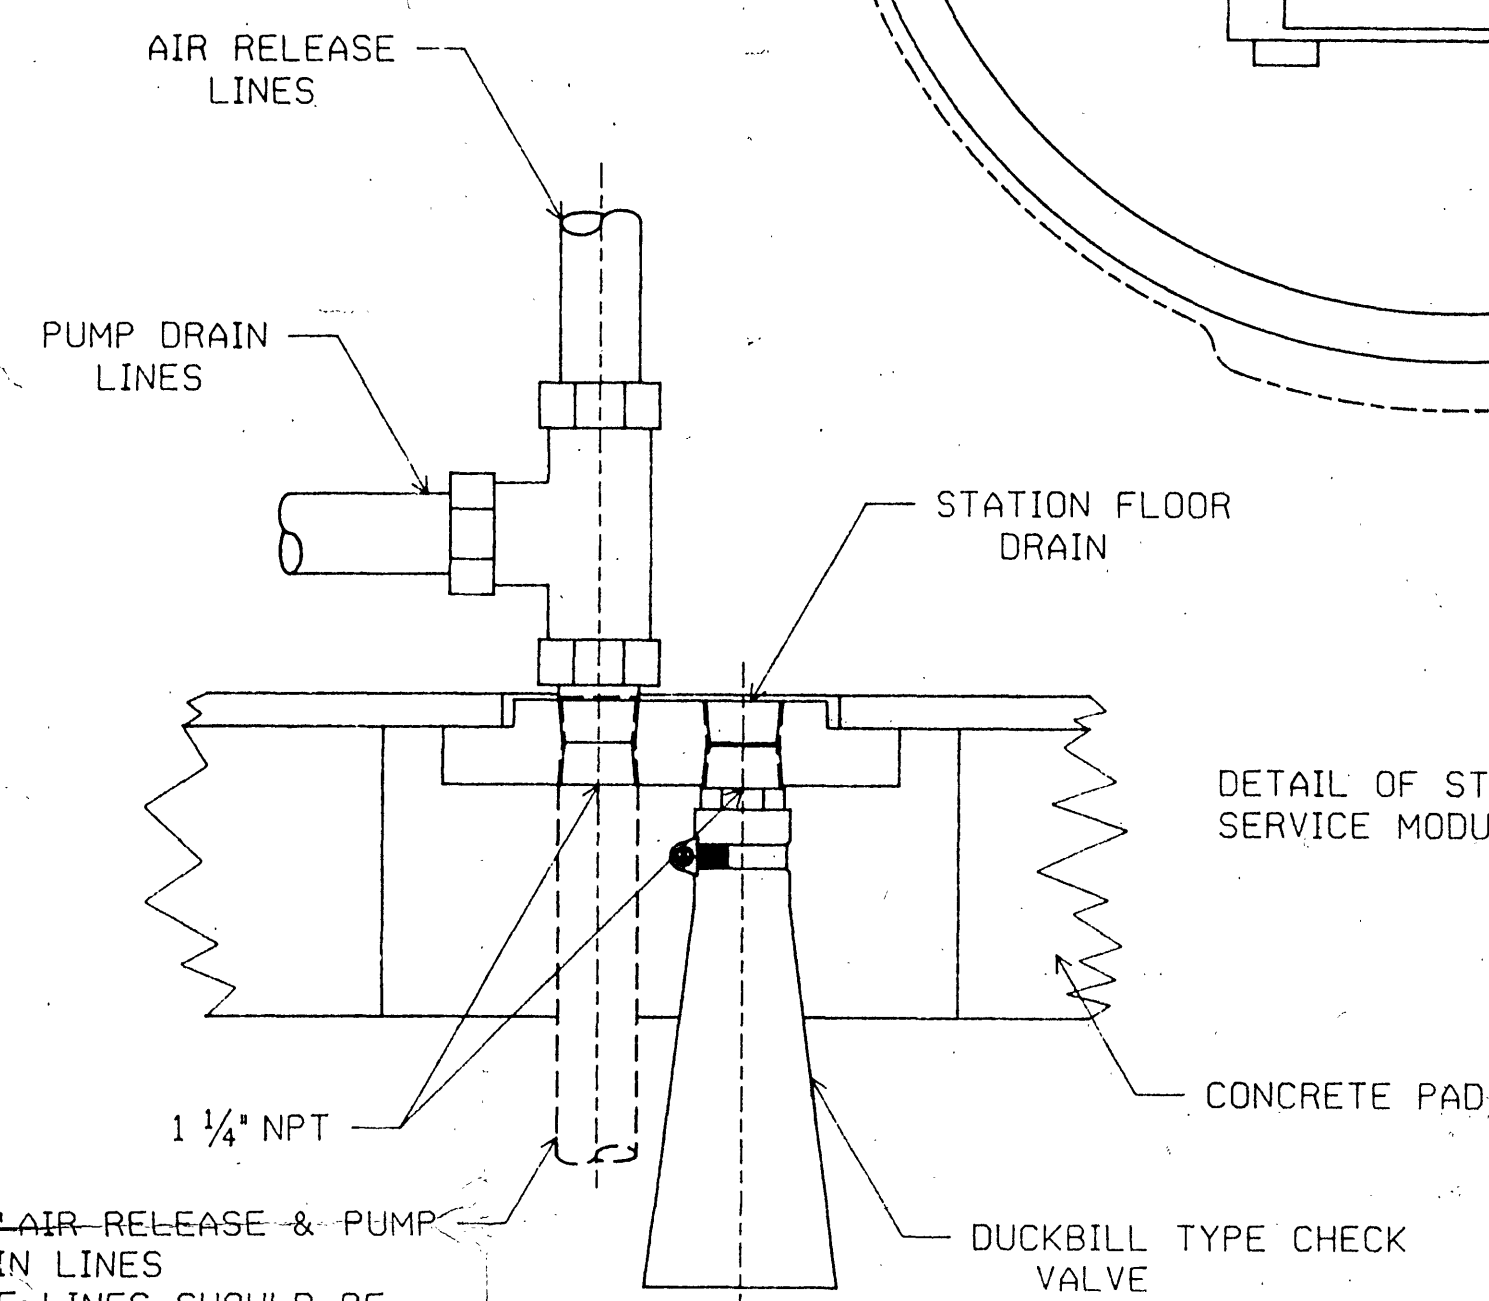


DETAIL OF STATION SERVICE MODULE

1 1/4\"/>

MAX. BURY DEPTH

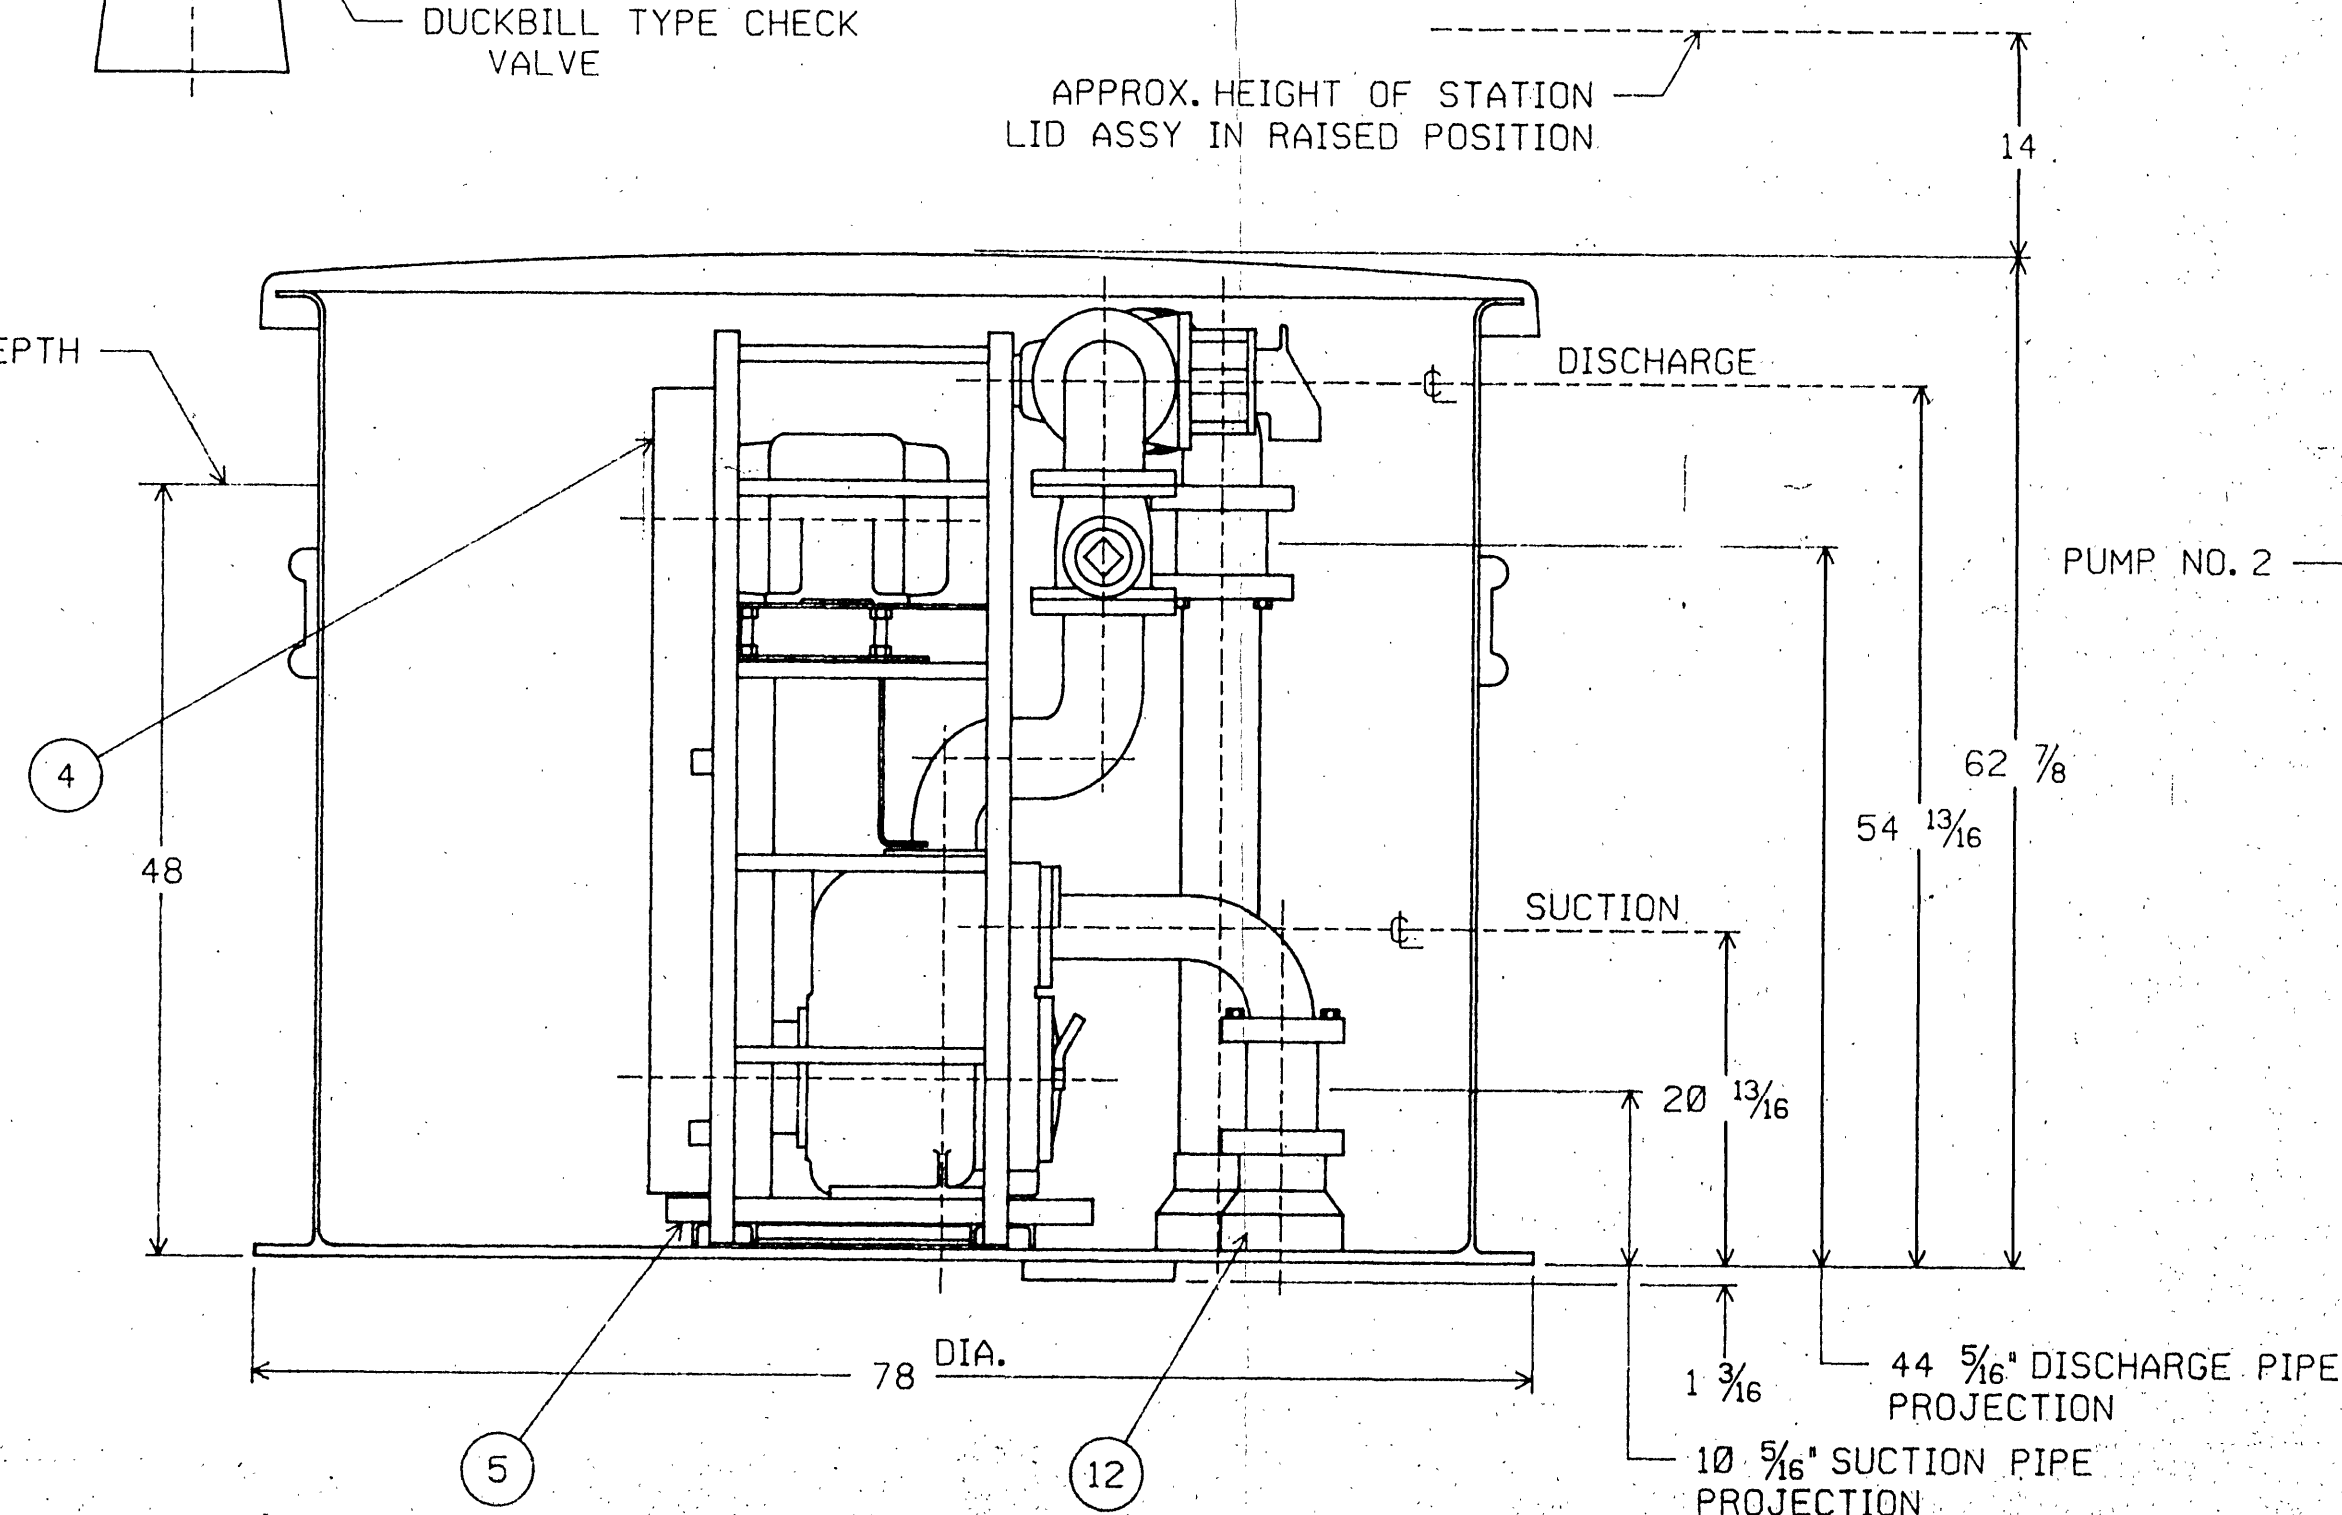


PUMP NO. 2

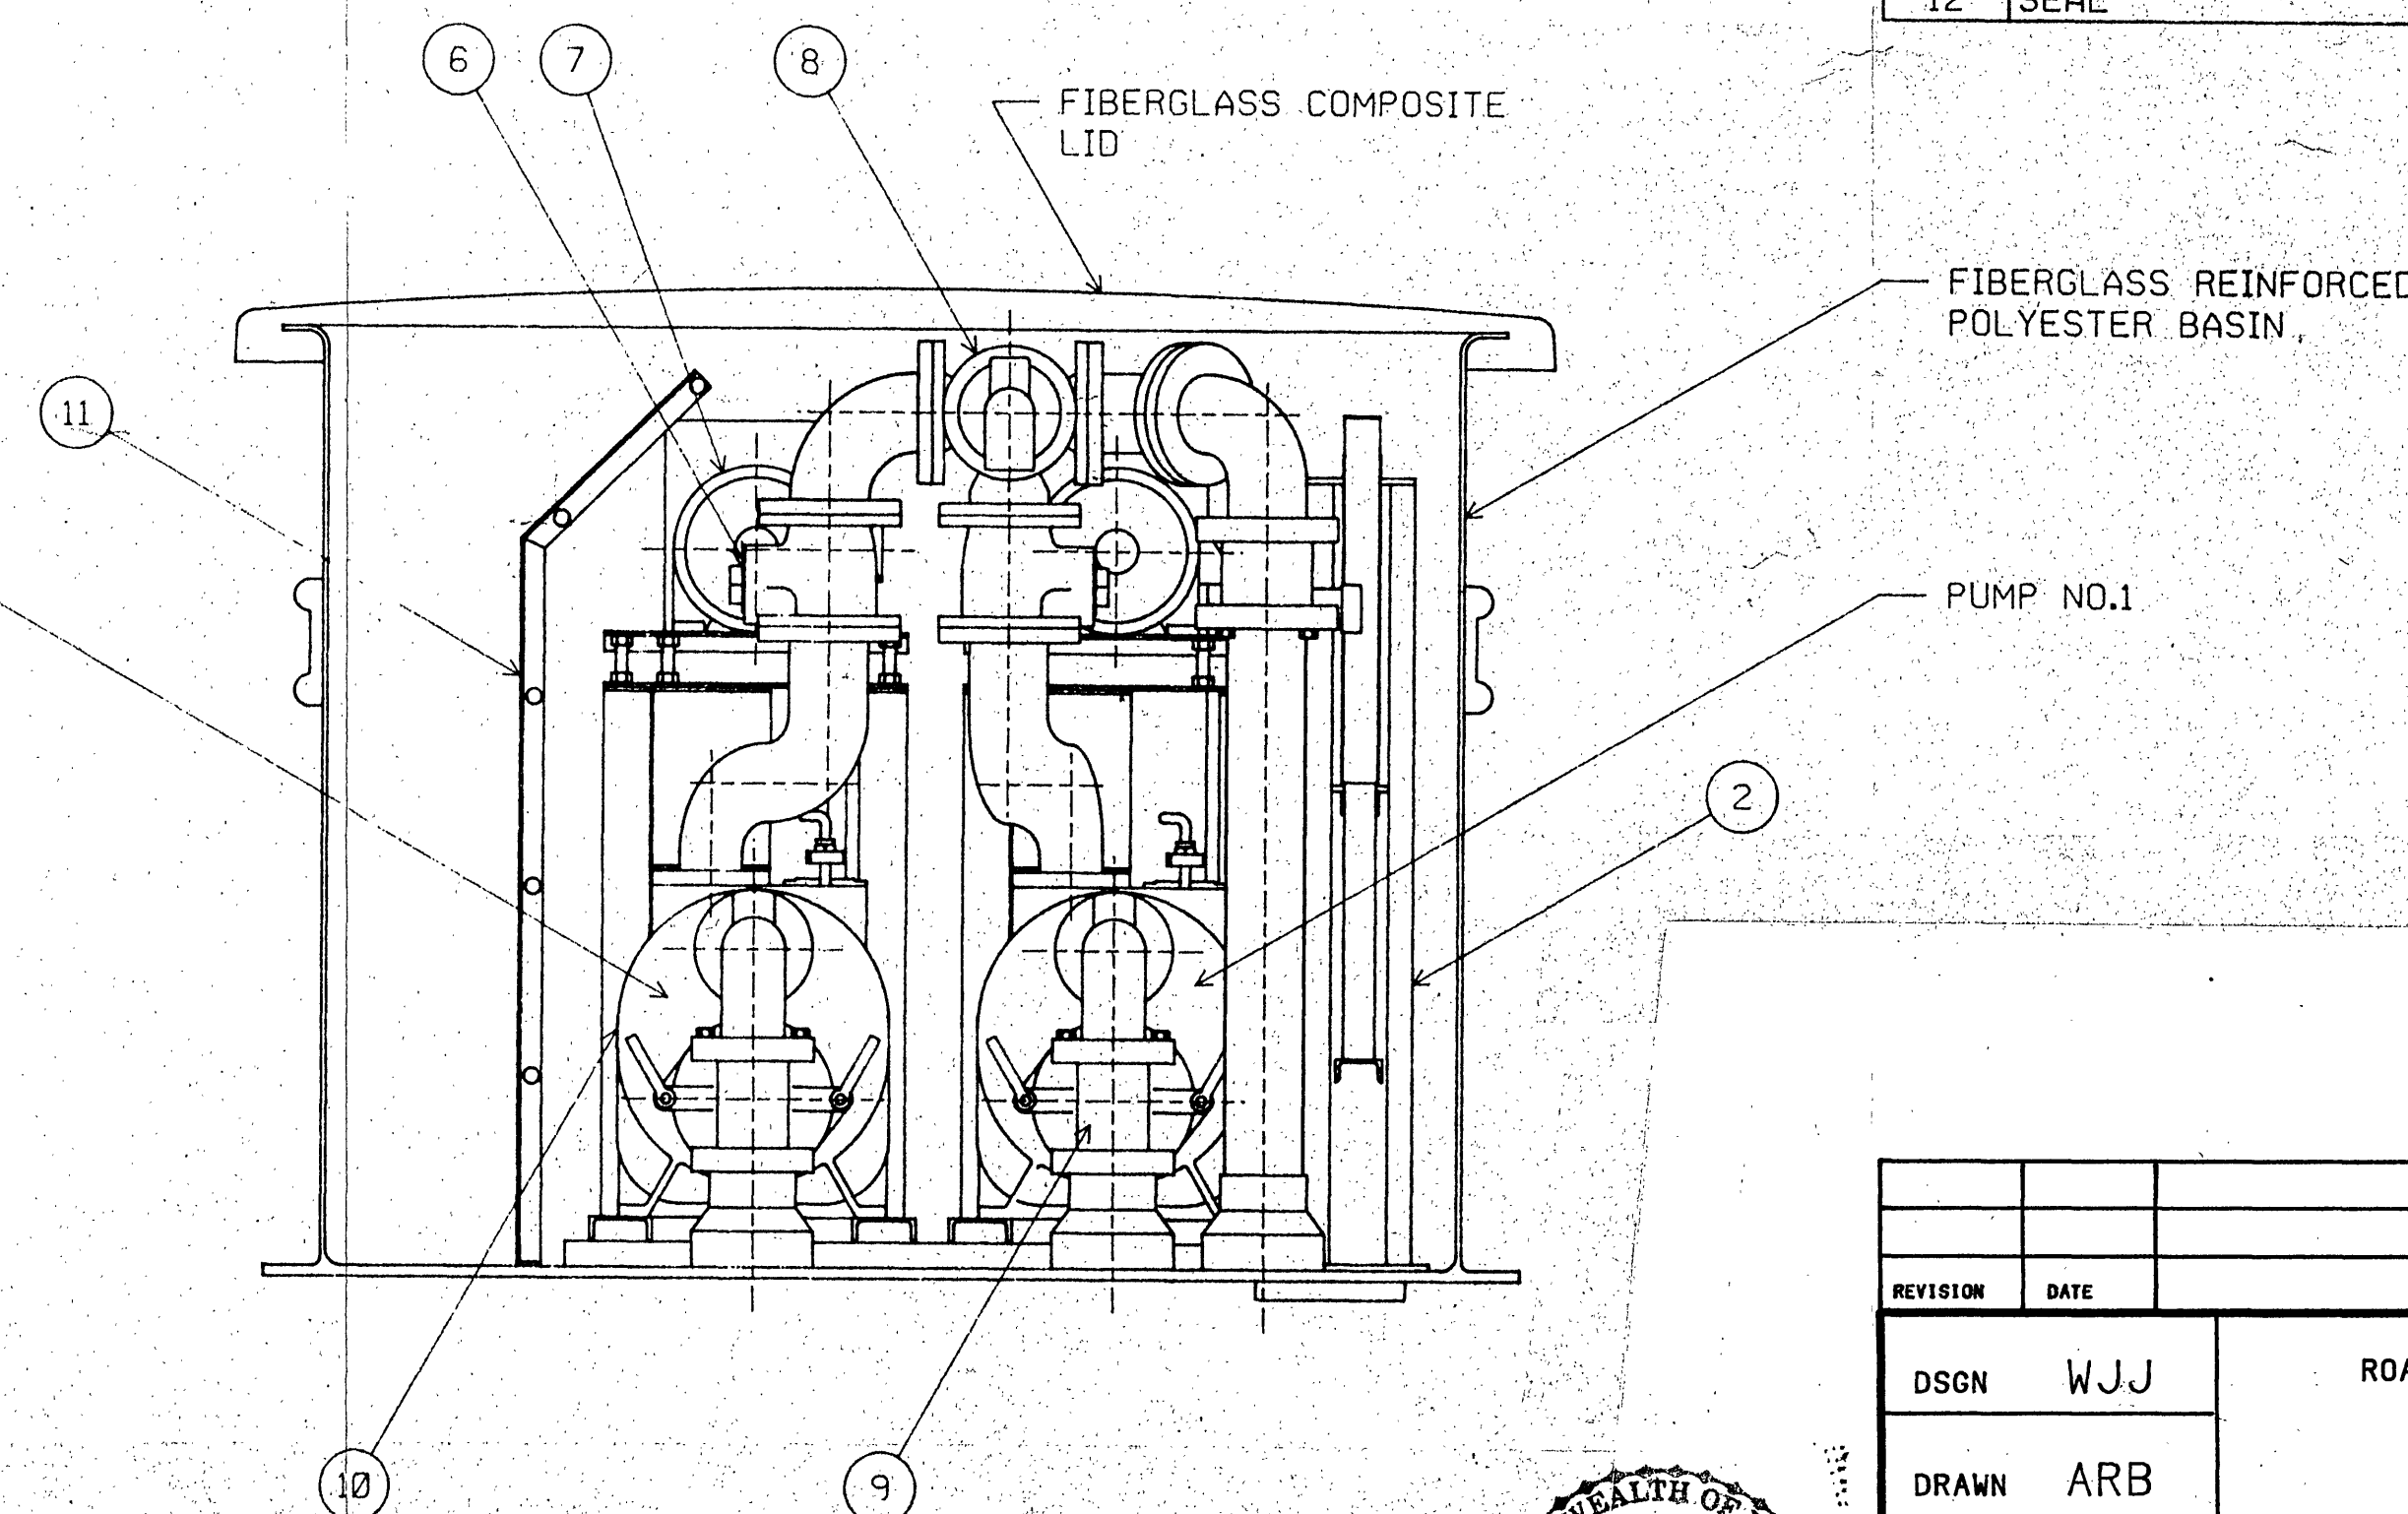

ITEM	DESCRIPTION	MAT'L & SIZE
1	TERMINAL STRIP ENCLOSURE	PVC
2	LIFTING MECHANISM	STEEL
3	EXHAUST BLOWER	140 CFM (NOT SHOWN)
4	BELT GUARD ASSY	STEEL
5	BASE ASSY	STEEL
6	DISCHARGE CHECK VALVE	CAST IRON 4"
7	MOTOR FR	HP RPM
8	DISCHARGE PLUG VALVE	CAST IRON 4" 3-WAY
9	DRESSER COUPLING	CAST IRON 3" & 4" STYLE 138
10	PUMP	CAST IRON T3A3-B
11	ENTRANCE LADDER	STEEL
12	SEAL	RUBBER

REVISION	DATE	DESCRIPTION	BY	APP.
DSGN	WJJ	ROANOKE CENTRE FOR INDUSTRY AND TECHNOLOGY CHIP DRIVE, NE. PLAN- PUMP STATION		
DRAWN	ARB			
CHKD	SWH			
		ROANOKE, VIRGINIA		
 Mattern & Craig CONSULTING ENGINEERS SURVEYORS			SCALE: 1" = 1'-0"	CORP. NO. 677N
			DATE: 4/8/88	SHEET 16
			DRAWING # 0877016	

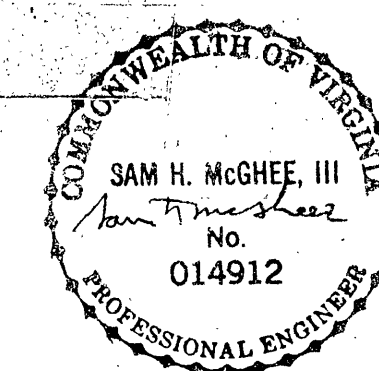

Mattern & Craig
CONSULTING ENGINEERS
SURVEYORS