



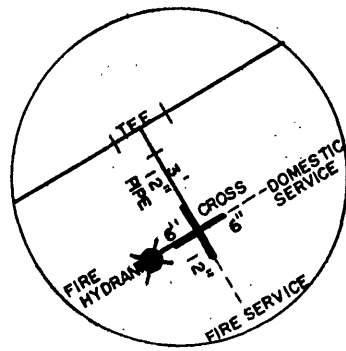

DETAIL
NTS

NOTE: ALL EXIST. UTILITIES SHALL BE
ASCERTAINED IN THE FIELD
PRIOR TO CONSTRUCTION.

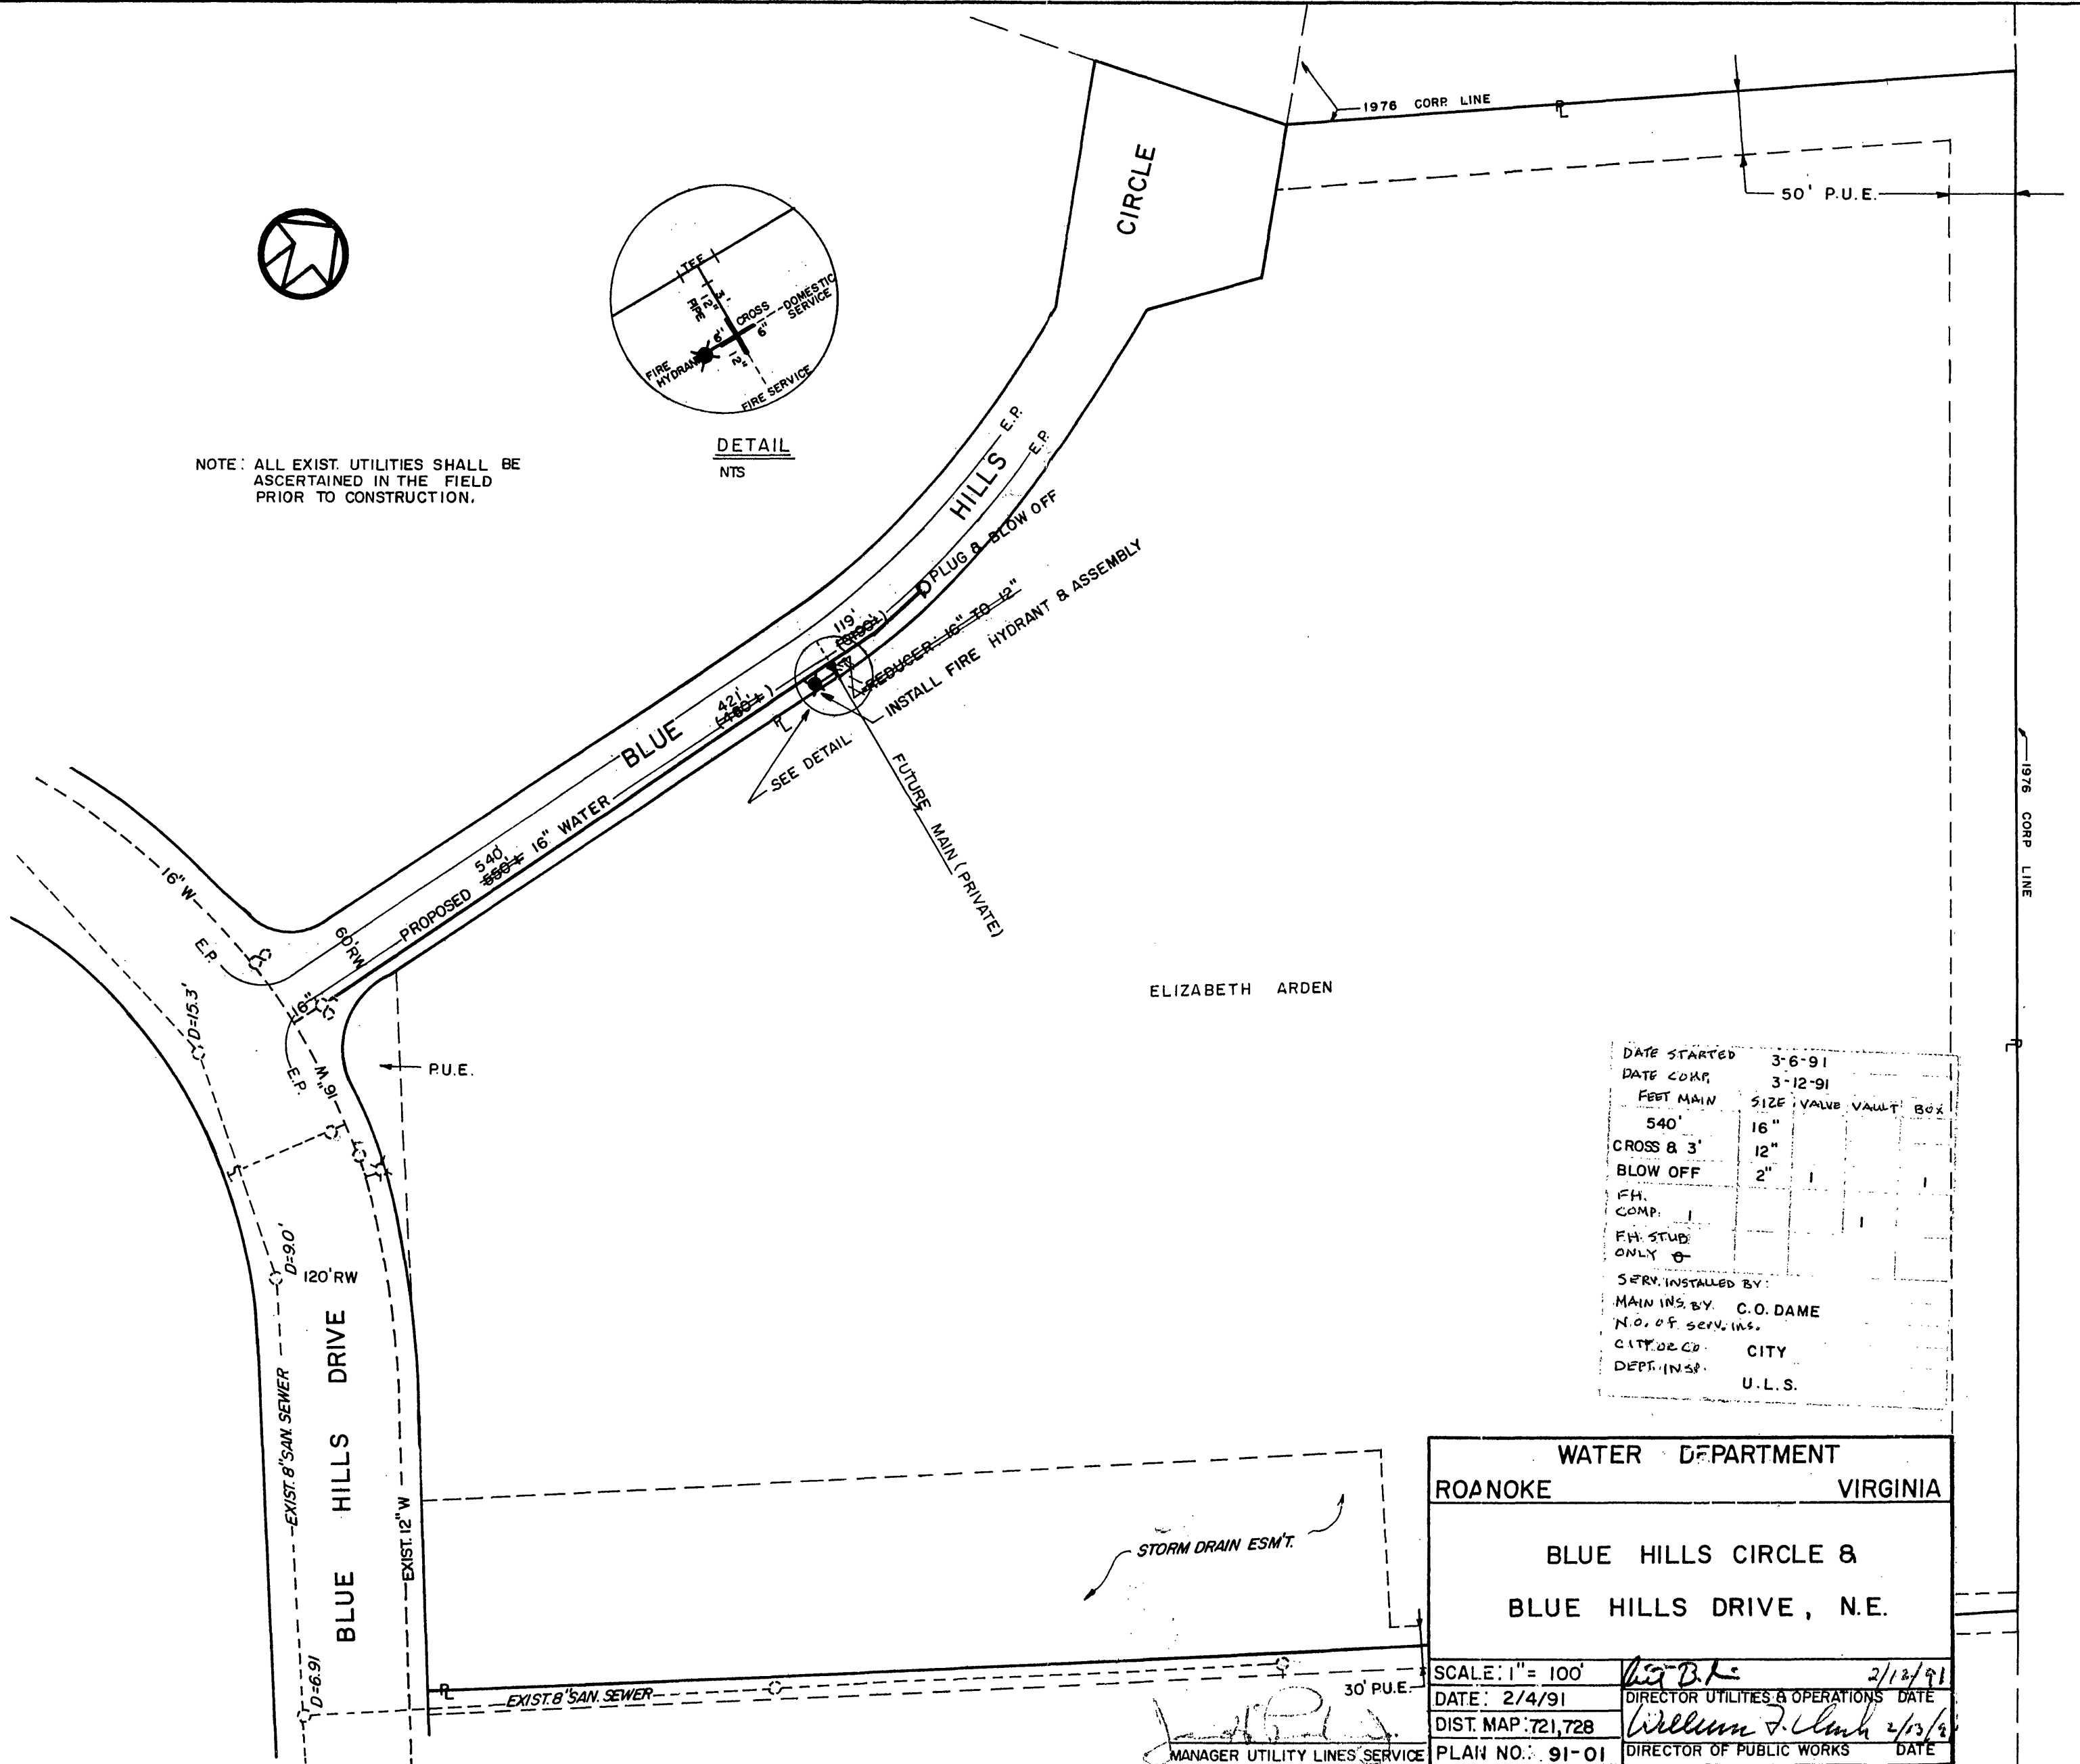

DATE STARTED	3-6-91			
DATE COMP.	3-12-91			
FEET MAIN	540'	SIZE	16"	VALVE VAULT BOX
CROSS & 3'		12"		
BLOW OFF		2"		
F.H. COMP.	1			
F.H. STUD ONLY	0			
SERV. INSTALLED BY:				
MAIN INS. BY: C.O. DAME				
N.O. OF SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP. U.L.S.				

WATER DEPARTMENT	
ROANOKE	VIRGINIA
BLUE HILLS CIRCLE & BLUE HILLS DRIVE, N.E.	
SCALE: 1" = 100'	2/12/91
DATE: 2/4/91	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 721,728	William J. Clark 2/13/91
PLAN NO.: 91-01	DIRECTOR OF PUBLIC WORKS DATE