


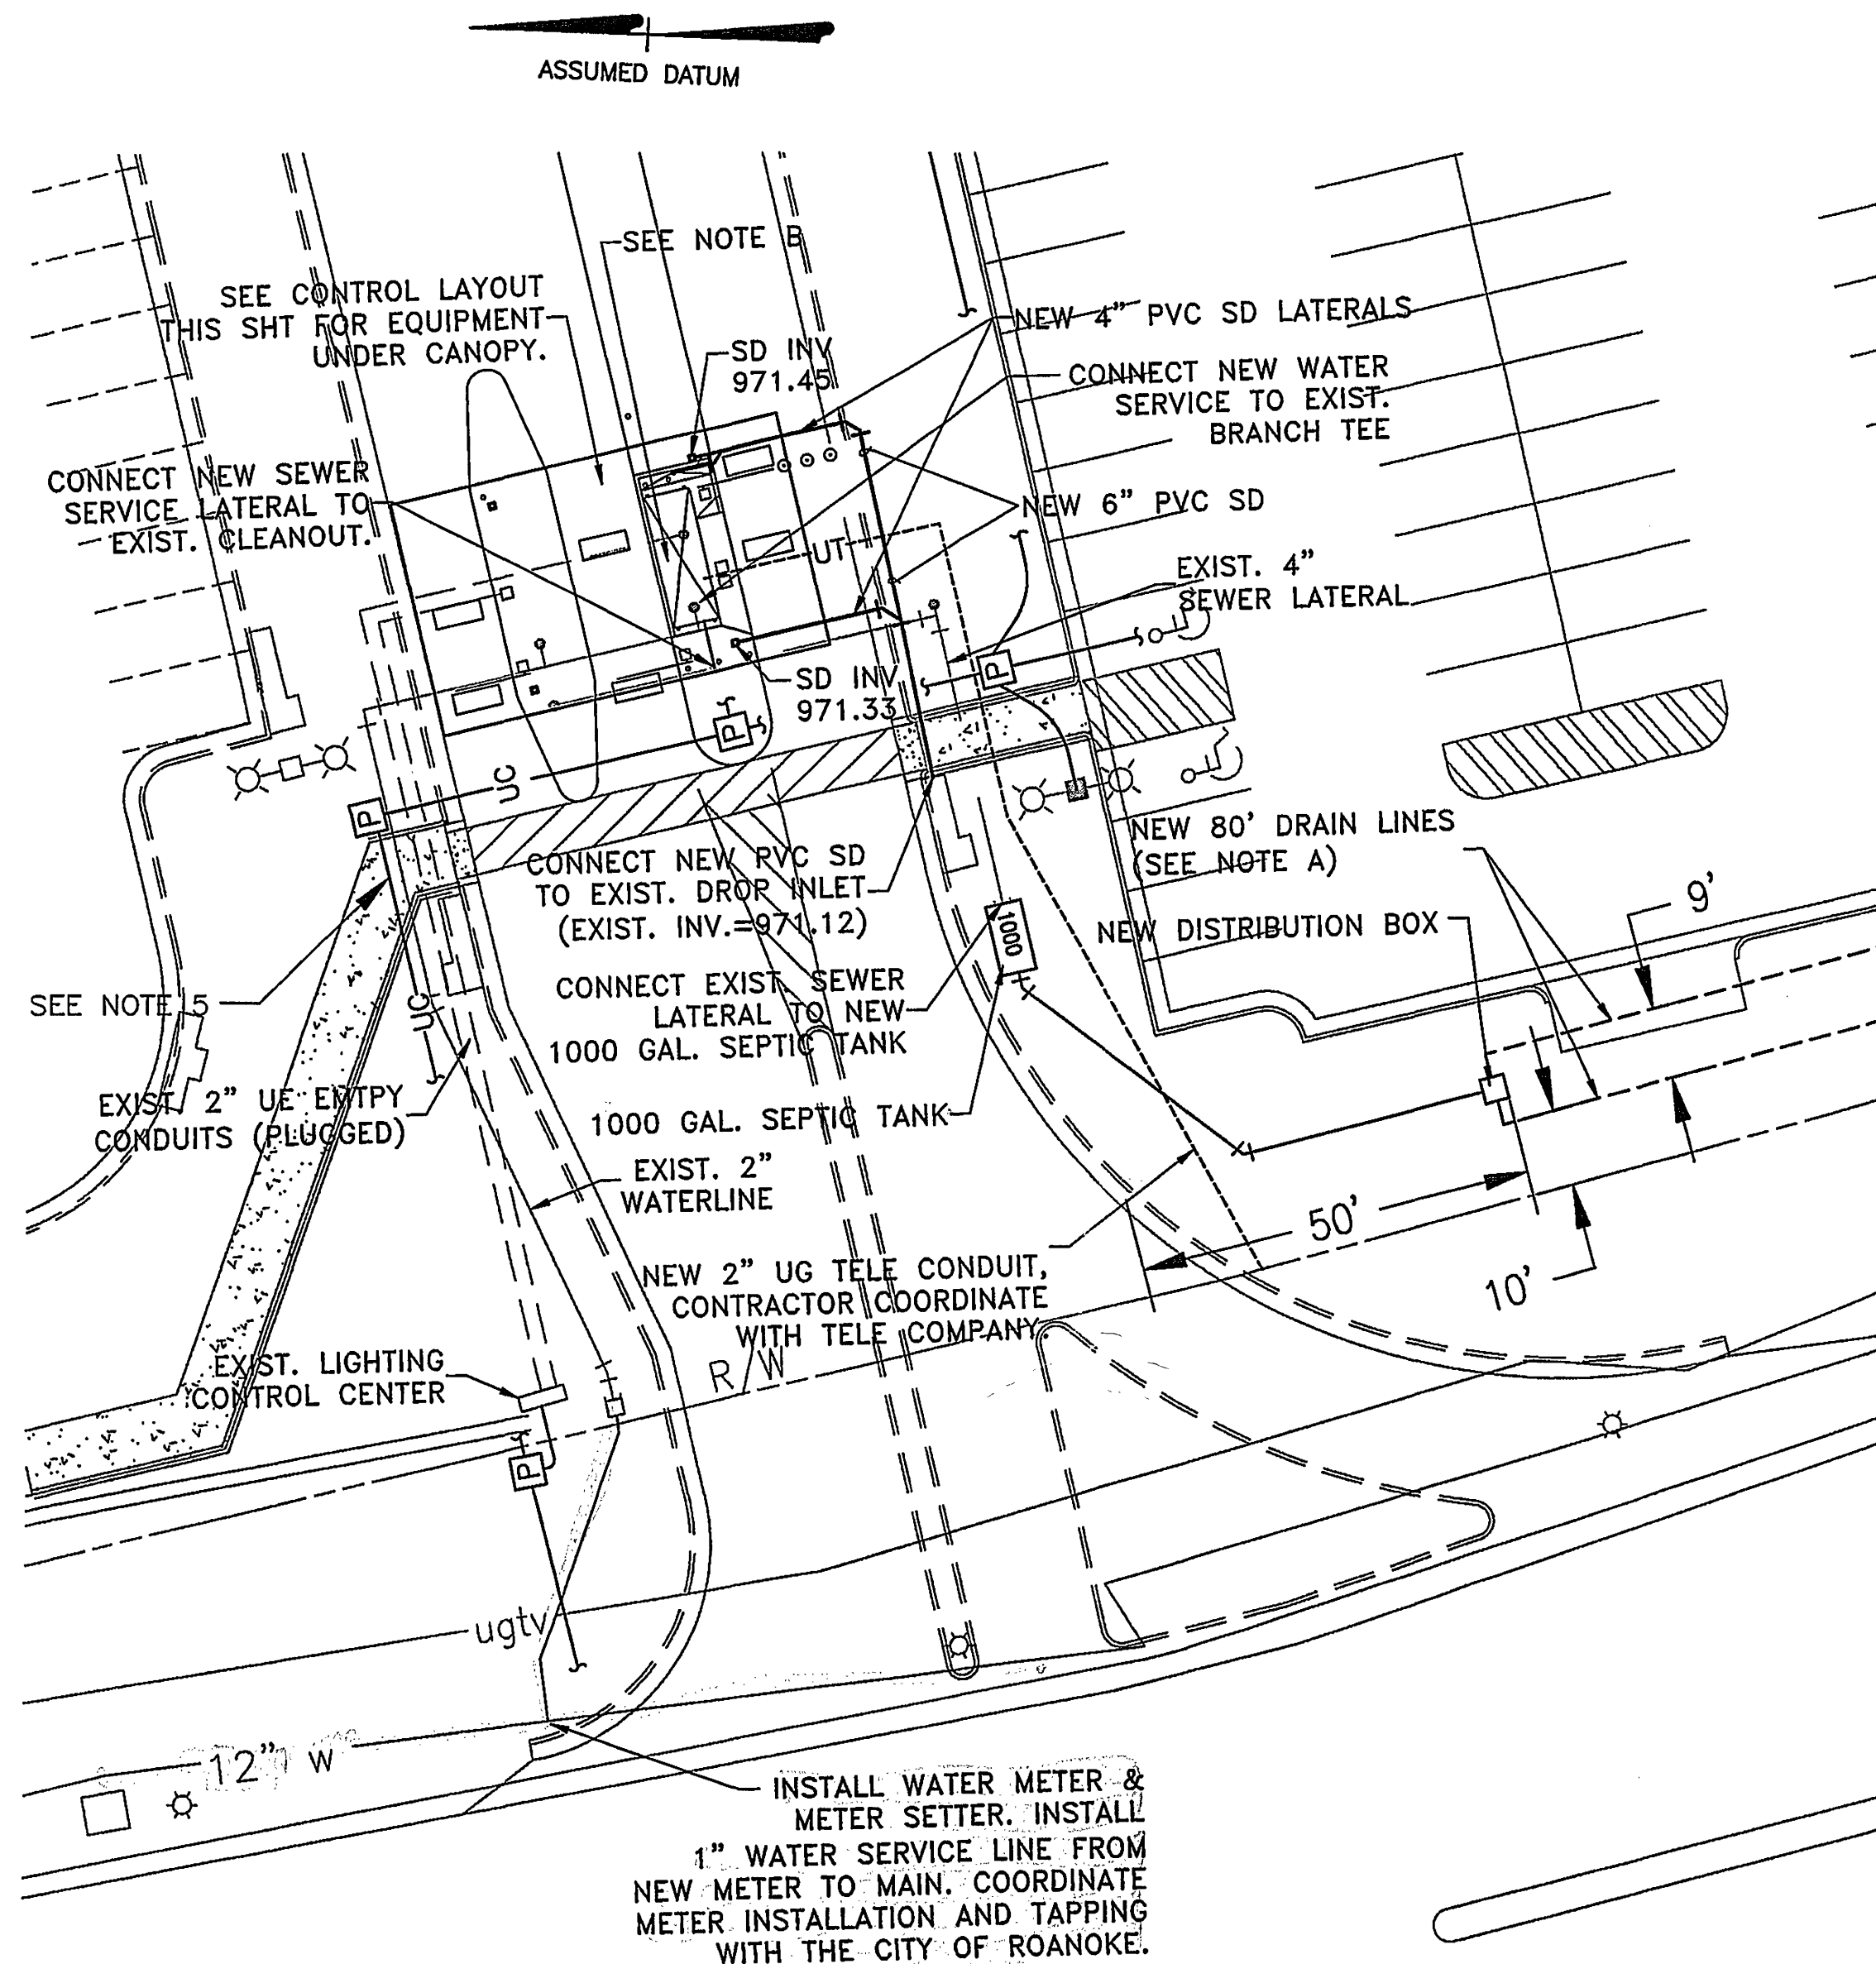


- NOTE A: SEPTIC TANK, DISTRIBUTION BOX, DRAIN LINES, AND PIPING SHALL CONFORM TO THE VIRGINIA DEPARTMENT OF HEALTH REGULATIONS AND THE CITY OF ROANOKE REQUIREMENTS AND STANDARDS. PRIOR TO INSTALLATION OF THE 80' SEPTIC DRAIN LINES, THE CONTRACTOR IS DIRECTED AS FOLLOWS:
1. DIG BACKHOLE TEST PITS FOR EACH LINE TO THE DEPTH SHOWN ON SEWAGE DISPOSAL CONSTRUCTION PERMIT.
 2. CONTACT MR. DAVID TAYLOR, ENVIRONMENTAL HEALTH SPECIALIST, VIRGINIA DEPARTMENT OF HEALTH, AT ROANOKE COUNTY HEALTH DEPARTMENT 540-857-7807 FOR A FIELD EXAMINATION OF THE SOIL SUBSTRATA.
 3. INCORPORATE ALL VERTICAL AND/OR HORIZONTAL LOCATIONS OF THE DRAIN LINES AS DIRECTED BY THE VDH SANITARIAN AND COMPLETE THE INSTALLATION.

NOTE B: CONTRACTOR SHALL COORDINATE UNDERGROUND UTILITIES WITH PRE-ENGINEERED BUILDING UTILITIES (WATER, SANITARY, ELECTRIC, AND TELEPHONE). PROVIDE AND INSTALL CONDUIT AND PIPING AS REQUIRED TO CONNECT PROPOSED FACILITIES IN PRE-ENGINEERED BUILDING TO EXISTING UTILITIES. THIS WORK SHALL BE INCLUDED IN THE LUMP SUM PRICE BID FOR PRE-ENGINEERED BUILDING AND NO SEPARATE PAYMENT WILL BE MADE.

UTILITY DETAIL

SCALE: 1"=20'

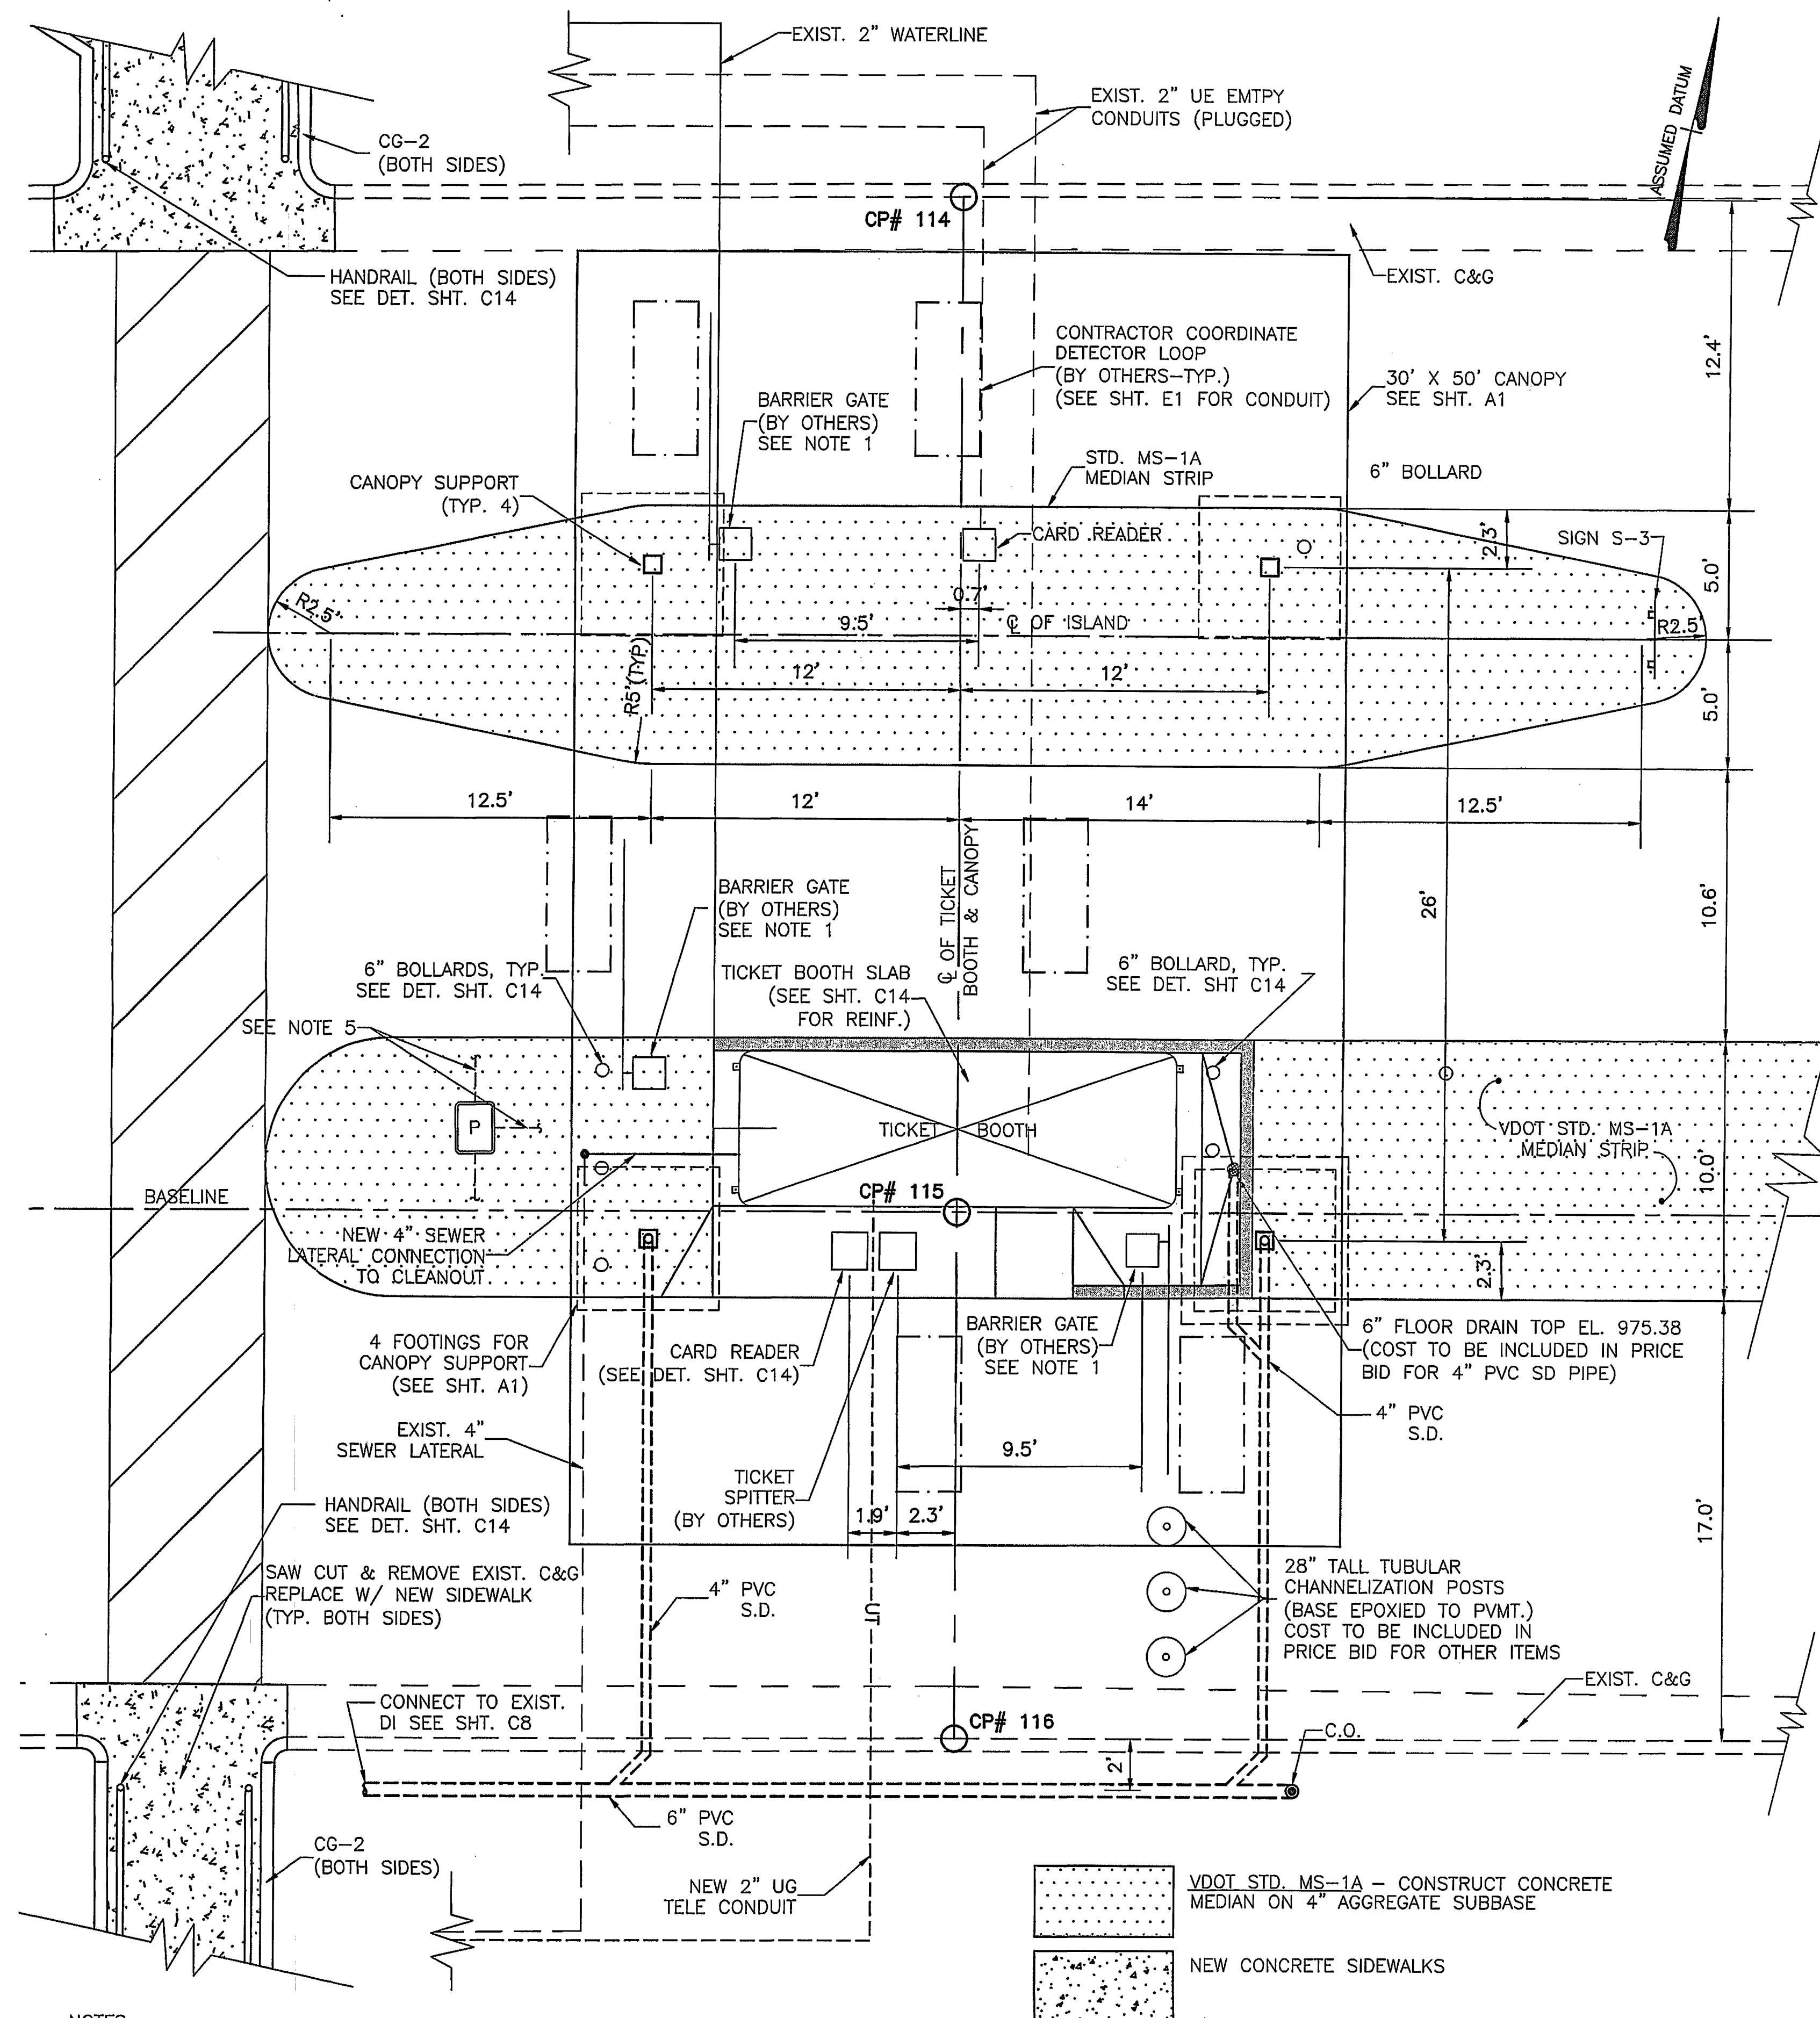


NOTES:

1. TICKET SPITTER, CARD READER AND BARRIER GATE FOUNDATIONS TO BE AT SPACING AND LOCATION RECOMMENDED BY MANUFACTURER.
2. LOOP DETECTORS, TICKET SPITTERS AND BARRIER GATE EQUIPMENT TO BE PROVIDED AND INSTALLED BY OTHERS, CONTRACTOR COORDINATE.
3. CONTRACTOR SHALL PROVIDE CONDUITS FOR ALL EQUIPMENT PER MANUFACTURERS REQUIREMENTS.
4. FOUNDATION PADS FOR CARD READERS, TICKET SPITTER AND BARRIER GATES SHALL BE LEVEL, SIZED TO FIT EQUIPMENT AND SET AT ELEVATION AS RECOMMENDED BY MANUFACTURER.
5. CONTRACTOR SHALL INSTALL IN 2" CONDUIT (SEE SHT. E3) 5 CONDUCTORS, CONSISTING OF 2 PAIR TWISTED, #22 GA. AND 1-#18 GA. DRAIN WIRE, NON-SHEILDIED, FOR CONNECTION BETWEEN MODEM IN NEW TICKET BOOTH TO MODEM IN EXIST. TICKET BOOTH.

CONTROL LAYOUT

SCALE: 1"=4'-0"

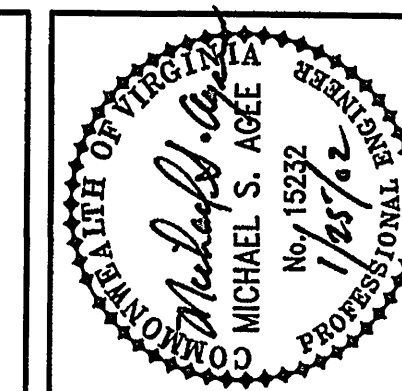

Date	
Revisions	

Commission No.:	1930H
Drawn By:	DEC
Designed By:	JMB/RSM
Checked By:	MSA
Date:	JANUARY, 2002

Matern & Craig
CONSULTING ENGINEERS • SURVEYORS
701 FIRST STREET, S.W.
ROANOKE, VA 24004
TEL (804) 345-7342
FAX (804) 345-7691

ROANOKE REGIONAL AIRPORT - OVERFLOW
PARKING LOT MODIFICATIONS & ADDITION
UTILITY DETAIL &
CONTROL LAYOUT
ROANOKE, VIRGINIA

Vertical Scale:
N/A

Horizontal Scale:
AS SHOWN

Issue Date:
AUGUST, 2001

Sheet No.:

C9