


LEGEND

- WATER MAIN
- POST INDICATOR VALVE
- FIRE HYDRANT (3 VALVED HOSE NOZZLES)
- INDIVIDUAL SHELL BUILDING
- INDICATES LIMITS OF WATER DISTRIBUTION SYSTEM INCLUDED IN THIS REQUEST FOR ACCEPTANCE BY CITY OF ROANOKE
- NEW 8" CONNECTIONS INCLUDED IN THIS REQUEST TO BE PROVIDED BY CITY OF ROANOKE

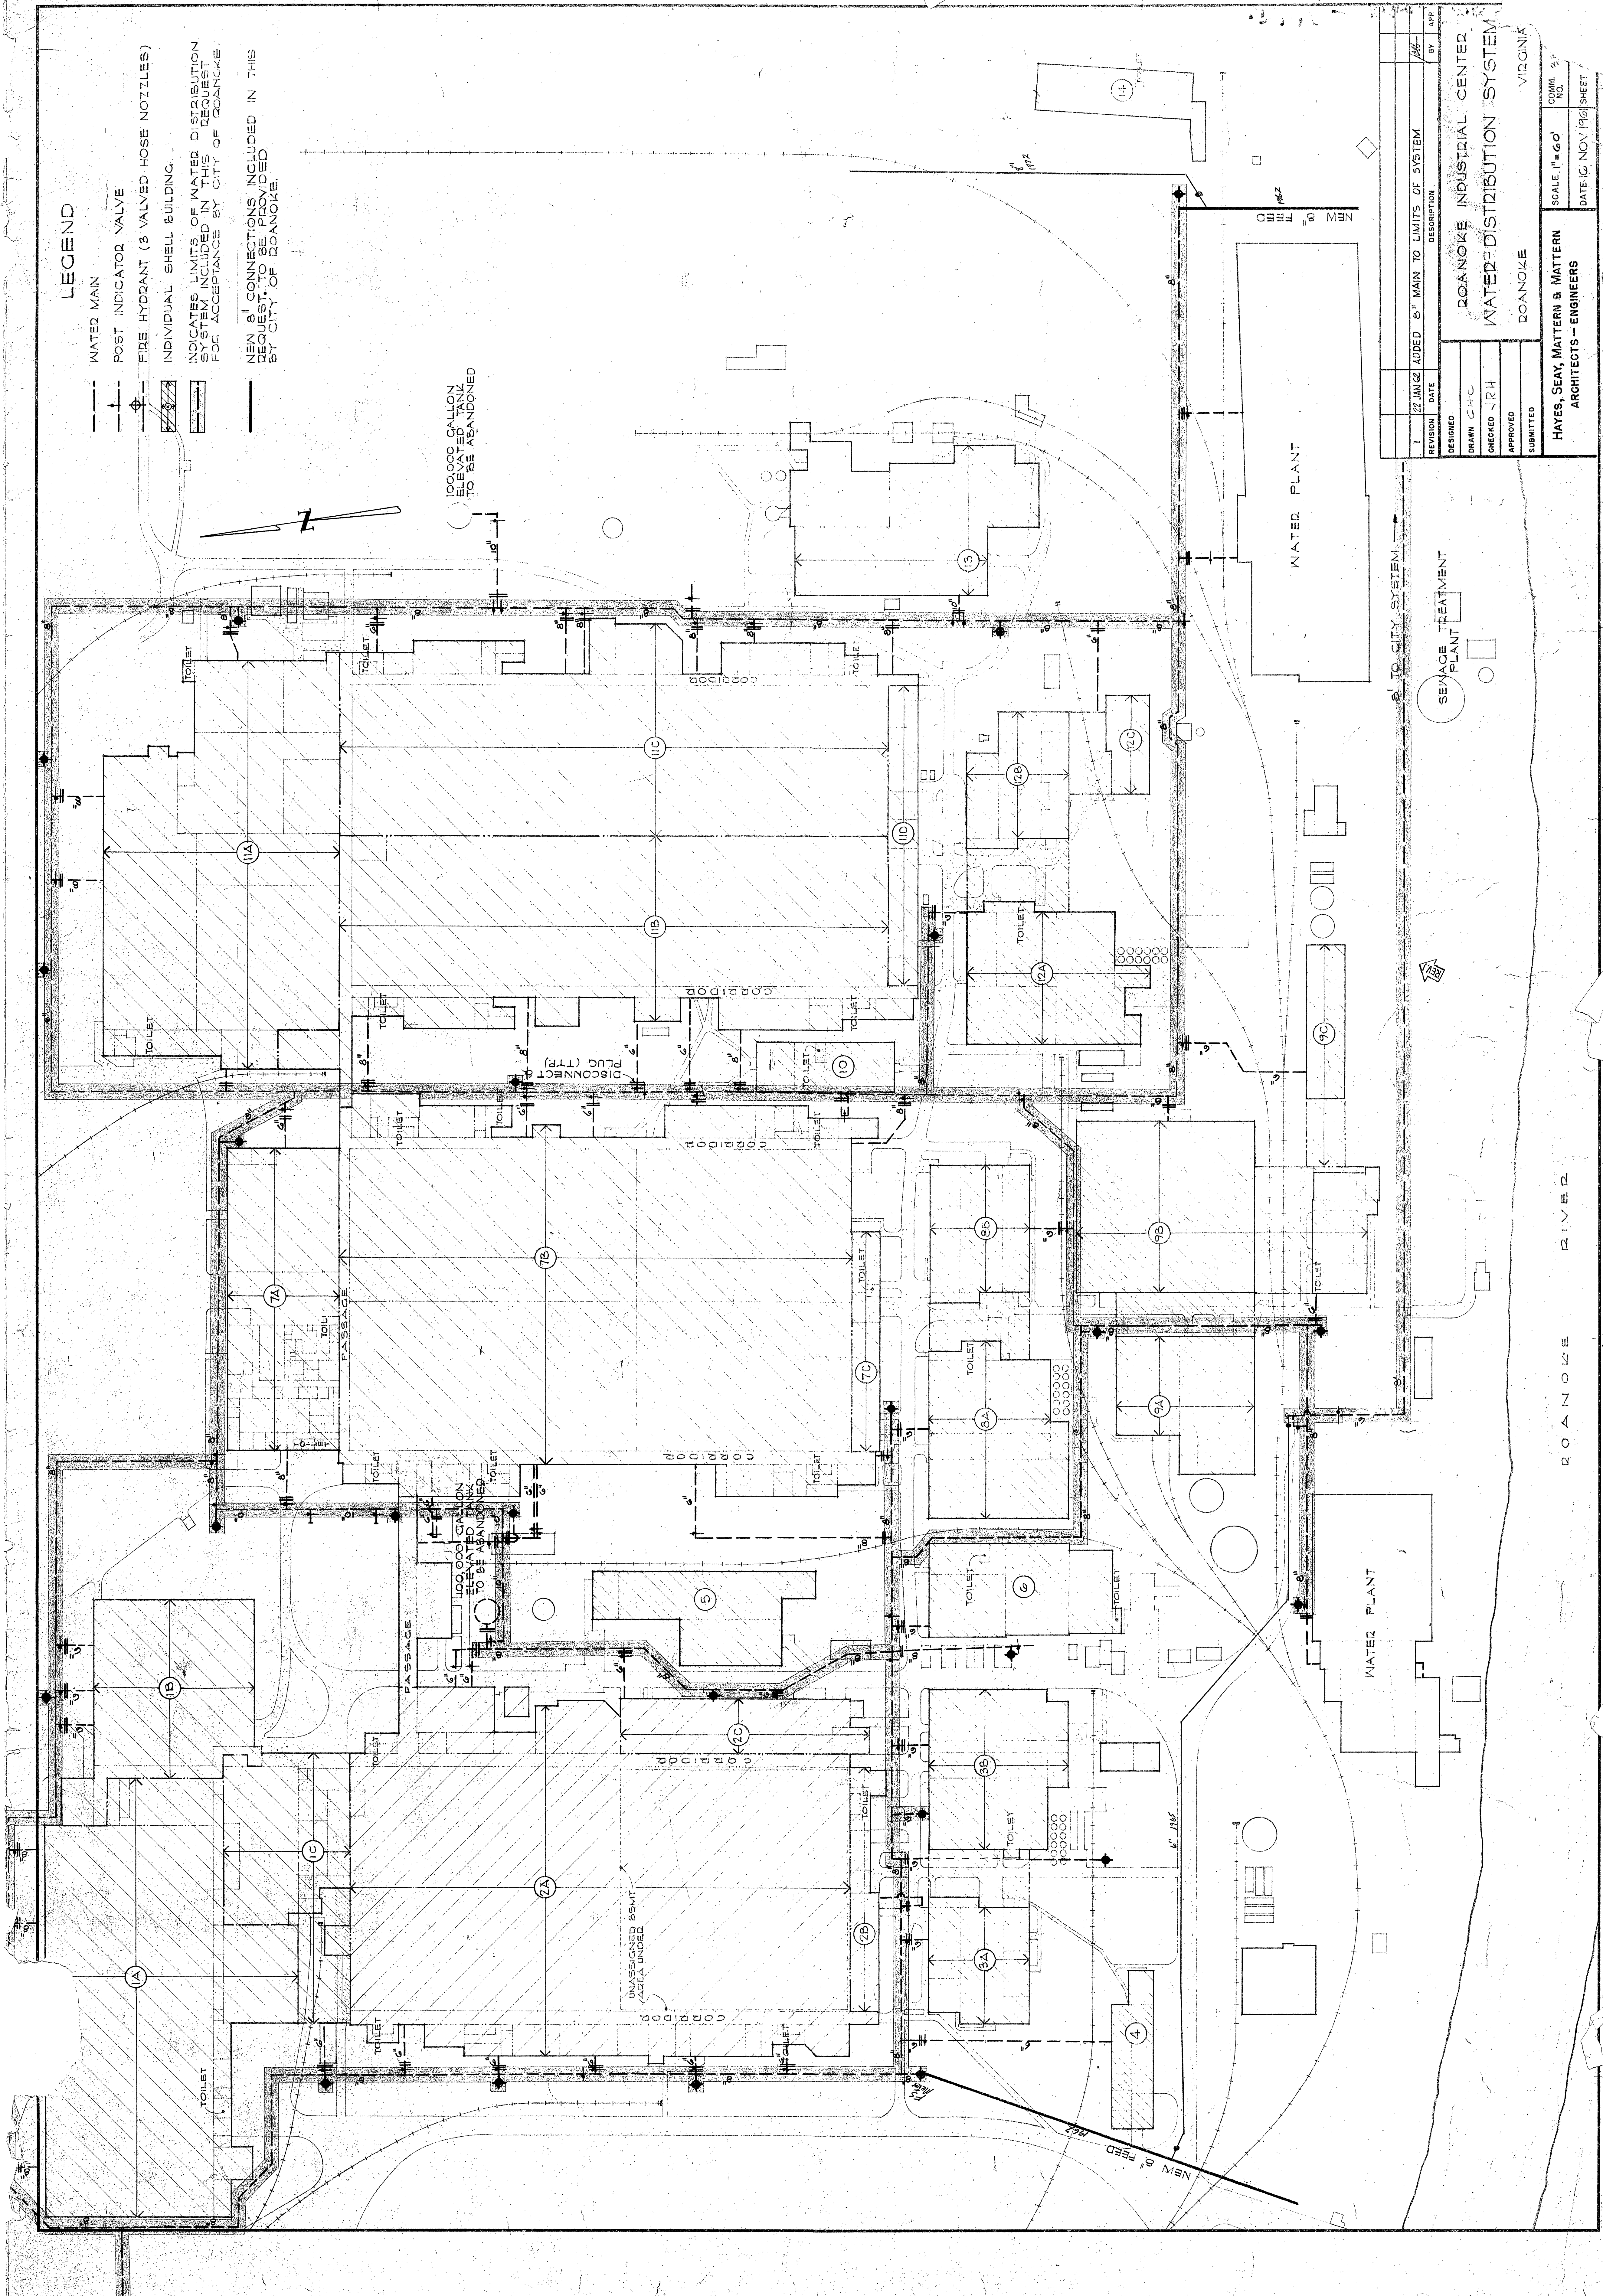

REVISION	DATE	DESCRIPTION	BY	APP
1	22 JAN 62	ADDED 8\"/>		
DESIGNED				
DRAWN				
CHECKED				
APPROVED				
SUBMITTED				

ROANOKE INDUSTRIAL CENTER	SCALE: 1\"/>	COMPL. NO.
WATER DISTRIBUTION SYSTEM	DATE: 12 NOV 1962	SHEET
DOANOKE		
HAYES SEAY, MATTERN & MATTERN		
ARCHITECTS - ENGINEERS		

SEWAGE TREATMENT PLANT



8\"/>

ROANOKE RIVER