


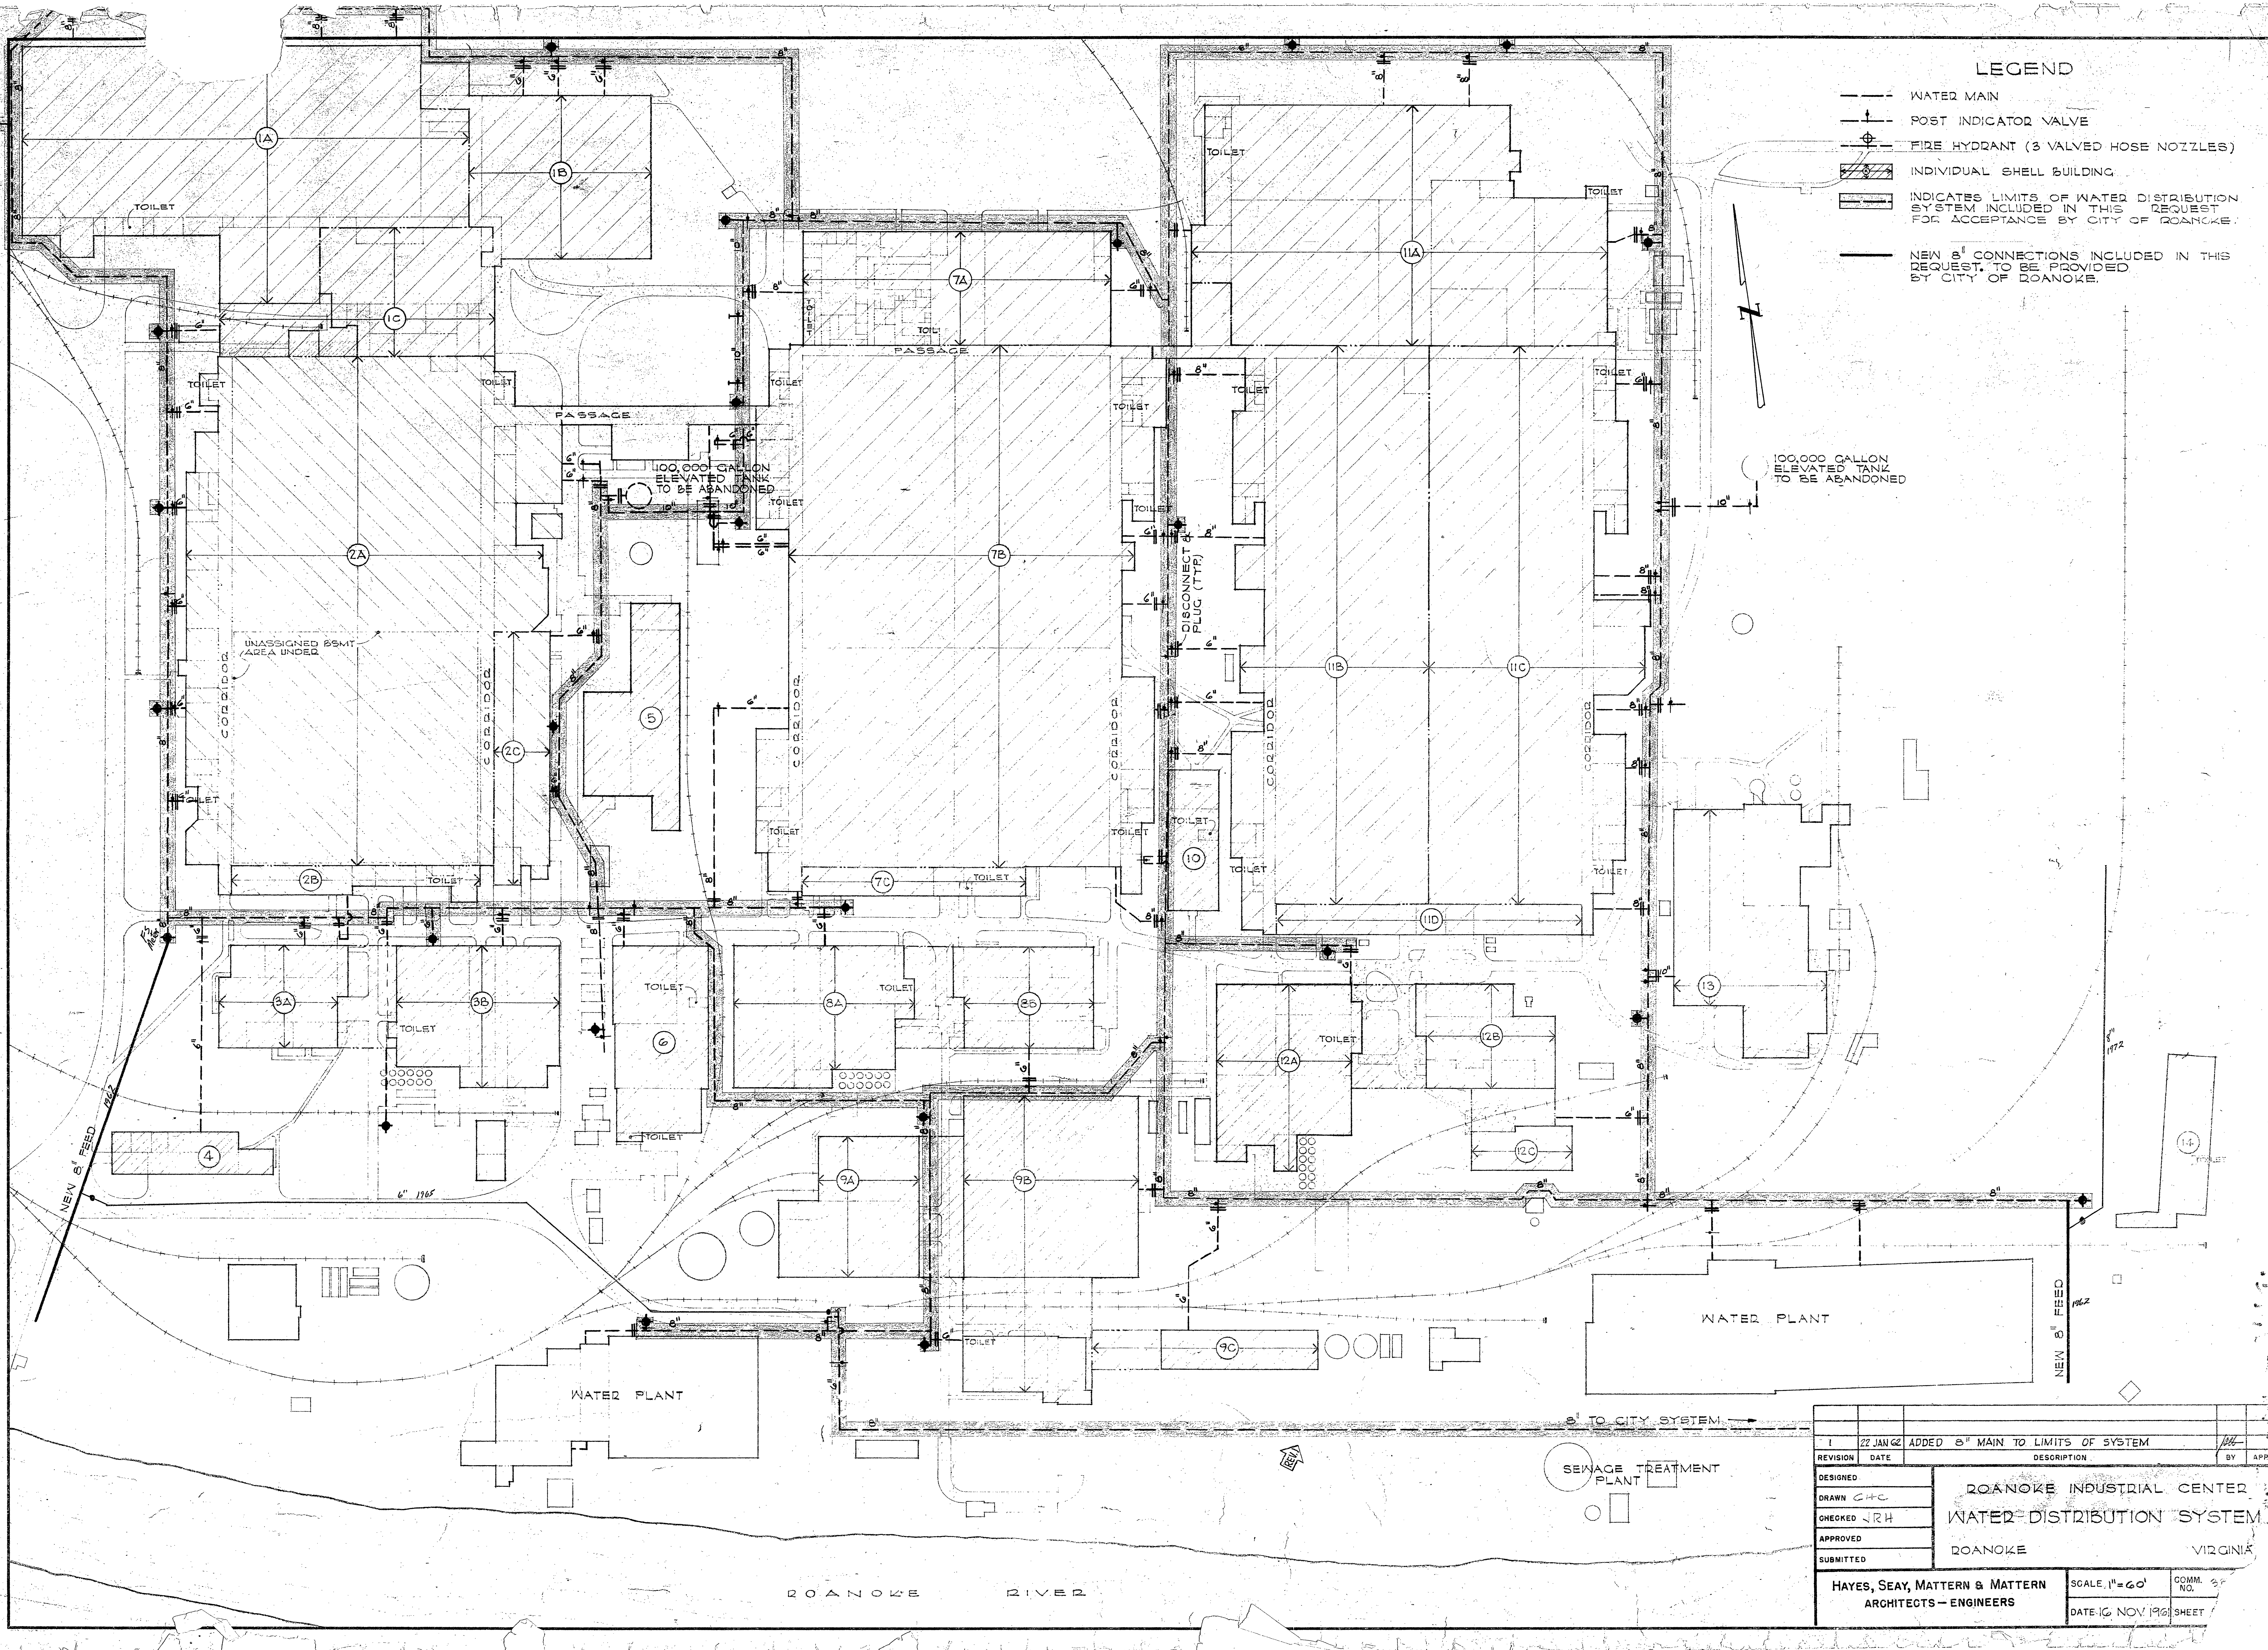

- LEGEND**
- WATER MAIN
 - POST INDICATOR VALVE
 - FIRE HYDRANT (3 VALVED HOSE NOZZLES)
 - INDIVIDUAL SHELL BUILDING
 - INDICATES LIMITS OF WATER DISTRIBUTION SYSTEM INCLUDED IN THIS REQUEST FOR ACCEPTANCE BY CITY OF ROANOKE.
 - NEW 8" CONNECTIONS INCLUDED IN THIS REQUEST. TO BE PROVIDED BY CITY OF ROANOKE.

REVISION	DATE	DESCRIPTION	BY	APP
1	22 JAN 62	ADDED 8" MAIN TO LIMITS OF SYSTEM		
DESIGNED				
DRAWN CMC				
CHECKED JRH				
APPROVED				
SUBMITTED				
ROANOKE INDUSTRIAL CENTER			WATER DISTRIBUTION SYSTEM	
ROANOKE			VIRGINIA	
HAYES, SEAY, MATTERN & MATTERN			SCALE, 1"=60'	COMM. NO.
ARCHITECTS-ENGINEERS			DATE: 10 NOV 1963	SHEET