


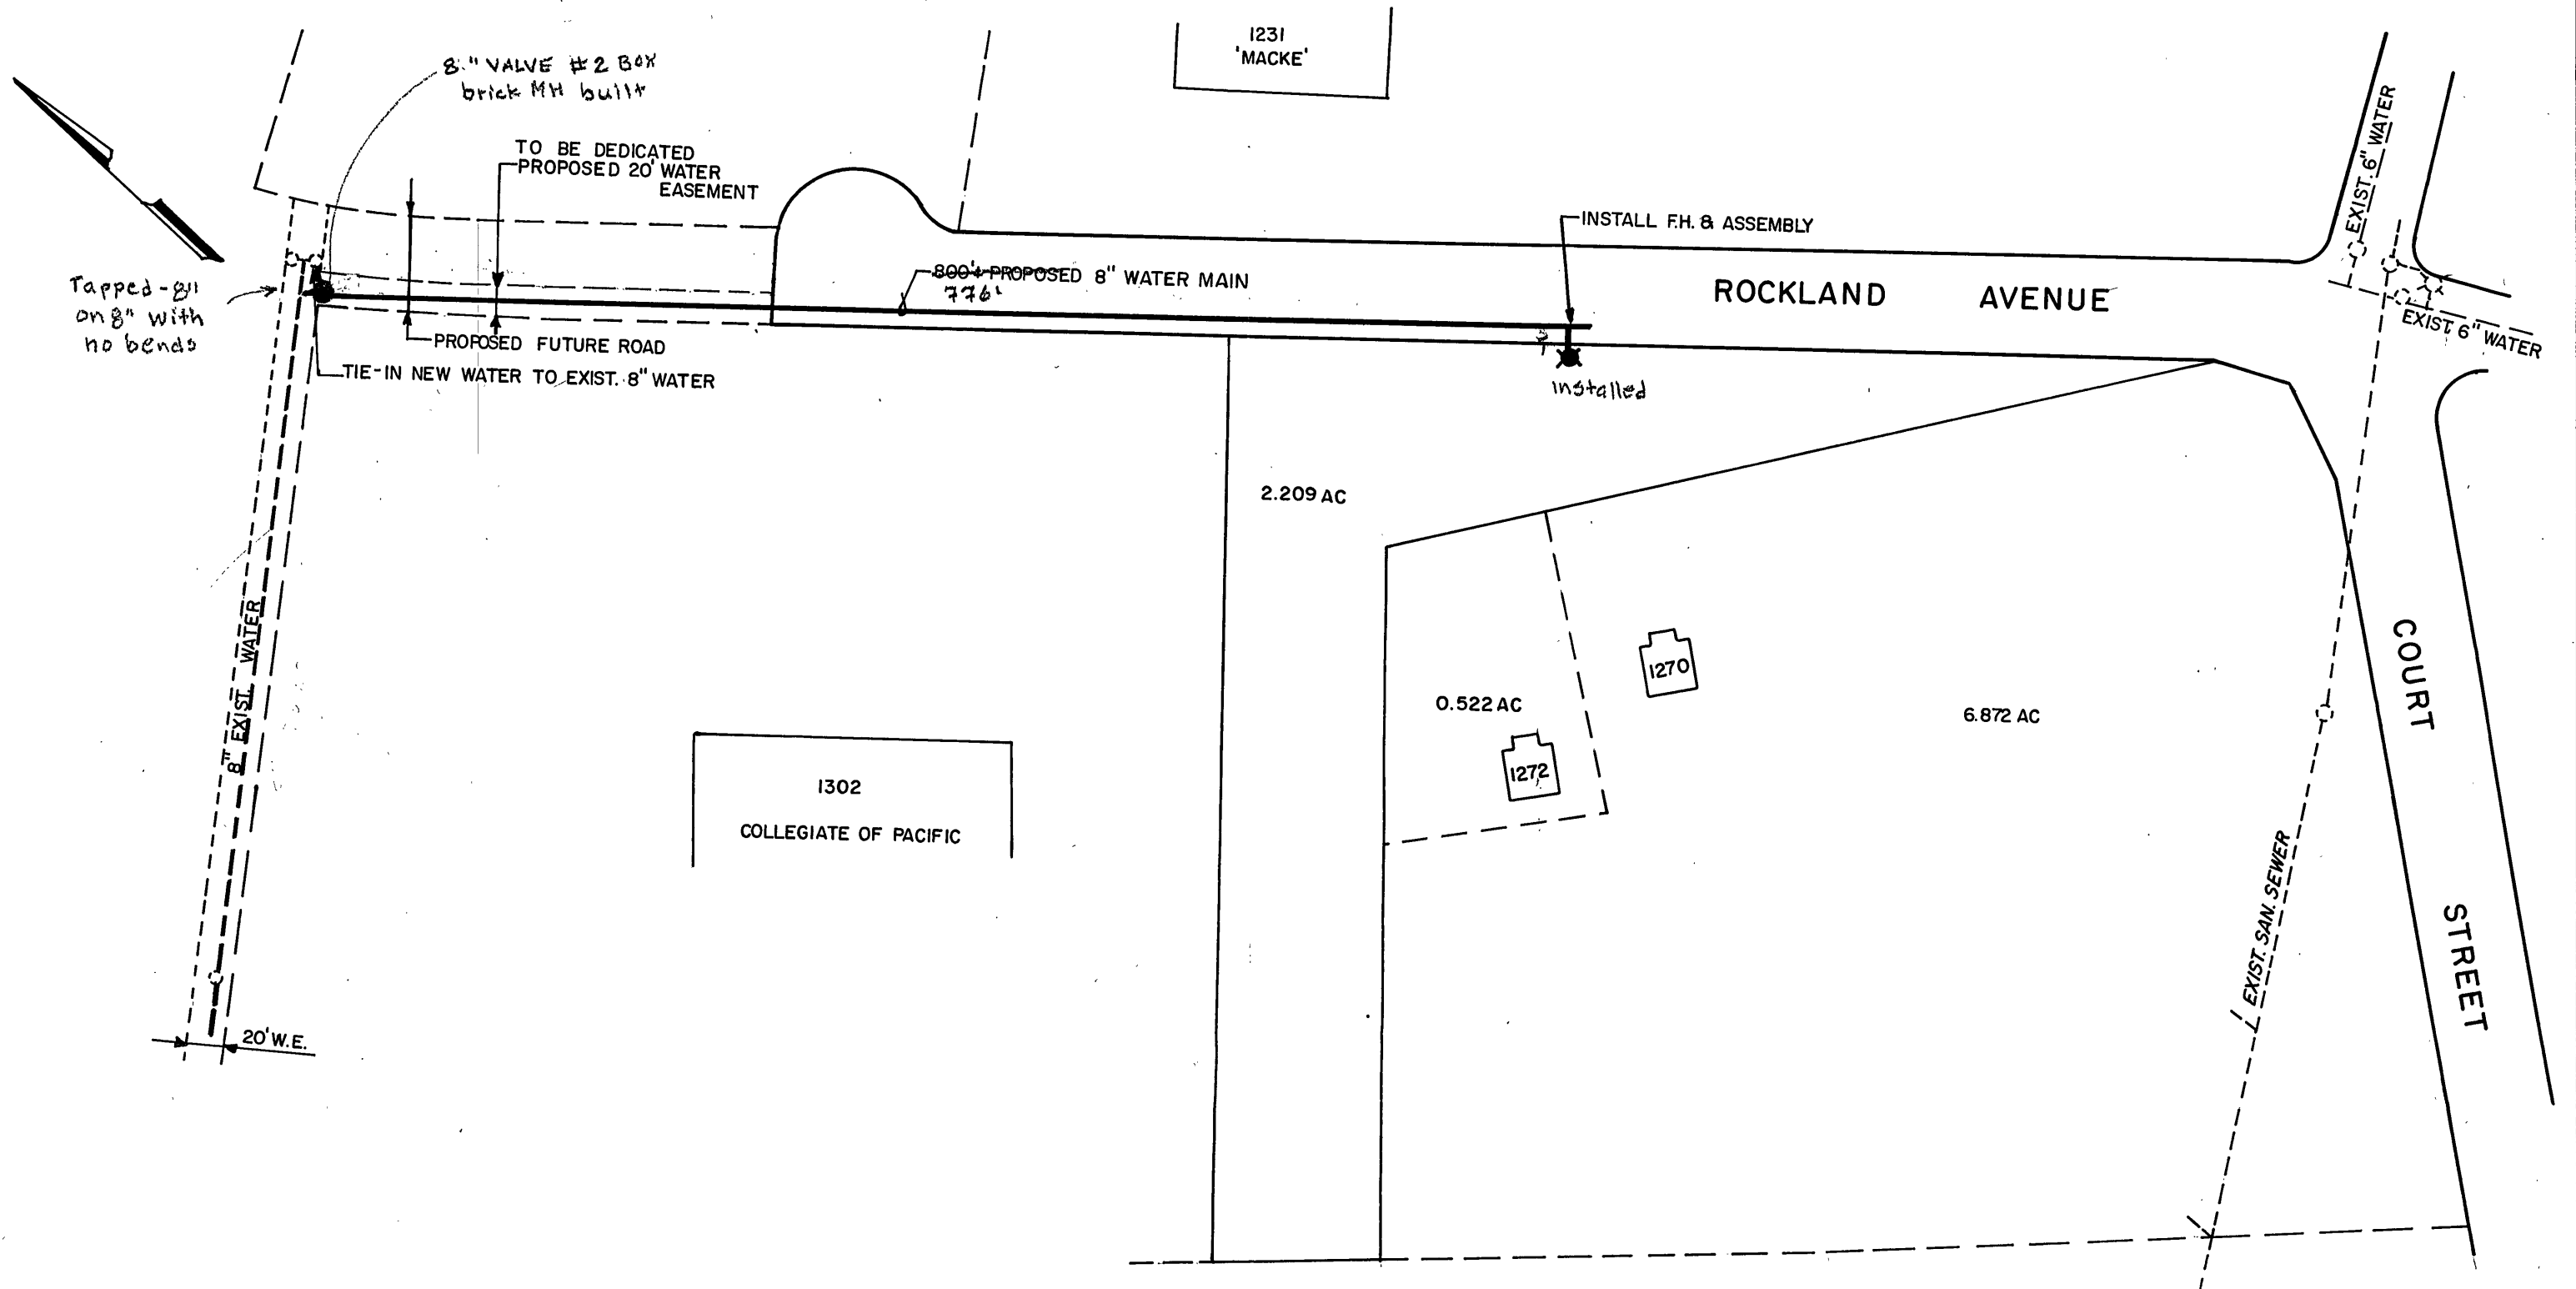

NOTE: ALL EXIST. UTILITIES SHALL BE ASCERTAINED IN THE FIELD PRIOR TO CONSTRUCTION.

|                    |                |
|--------------------|----------------|
| DATE STARTED       | 1995           |
| DATE COMP.         | 6/20/1995      |
| FEET MAIN          | 776'           |
| SIZE               | 8"             |
| VALVE              | 1              |
| VAULT              | 1              |
| F.H. COMP.         | 1              |
| F.H. STUB ONLY     | 4 1/2          |
| SEN. INS. BY:      | Calvin O. Dame |
| MAIN INS. BY:      | Calvin O. Dame |
| NO. SAN SERV. P.C. | 6"             |
| CITY OR CO.        | City           |
| DEPT. NO.          | U.W.S.         |

95# SP

one service

|                               |                          |
|-------------------------------|--------------------------|
| WATER DEPARTMENT              |                          |
| ROANOKE                       | VIRGINIA                 |
| ROCKLAND AVENUE, N.W.         |                          |
| SCALE: 1" = 100'              | DATE: 8/2/94             |
| DIST. MAP: 213                | DATE: 8/24/95            |
| MANAGER UTILITY LINE SERVICES | DIRECTOR OF PUBLIC WORKS |