
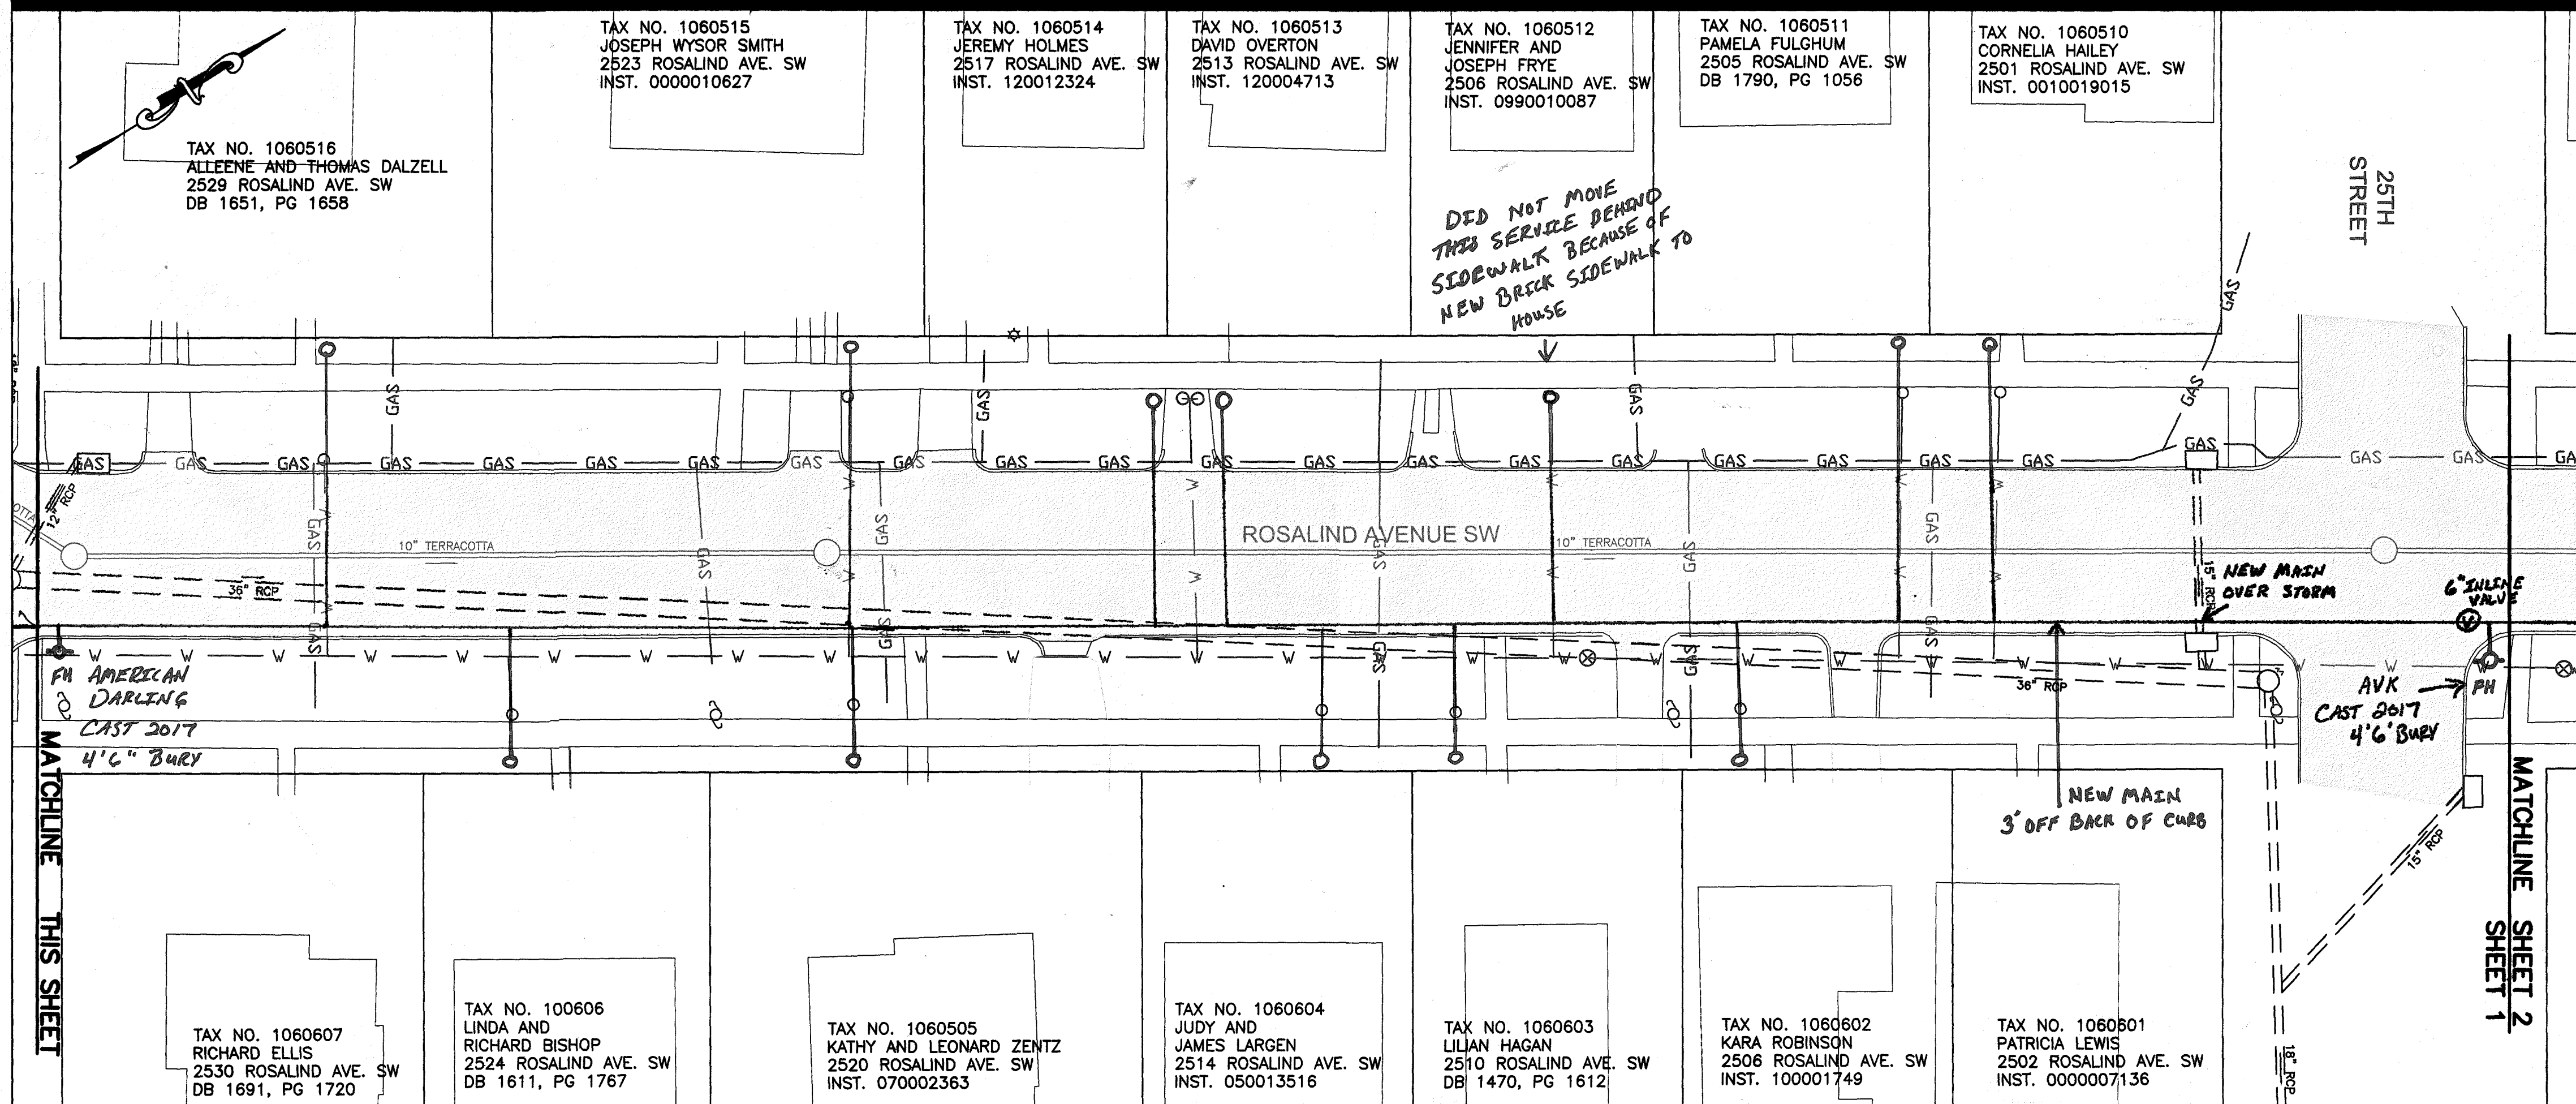


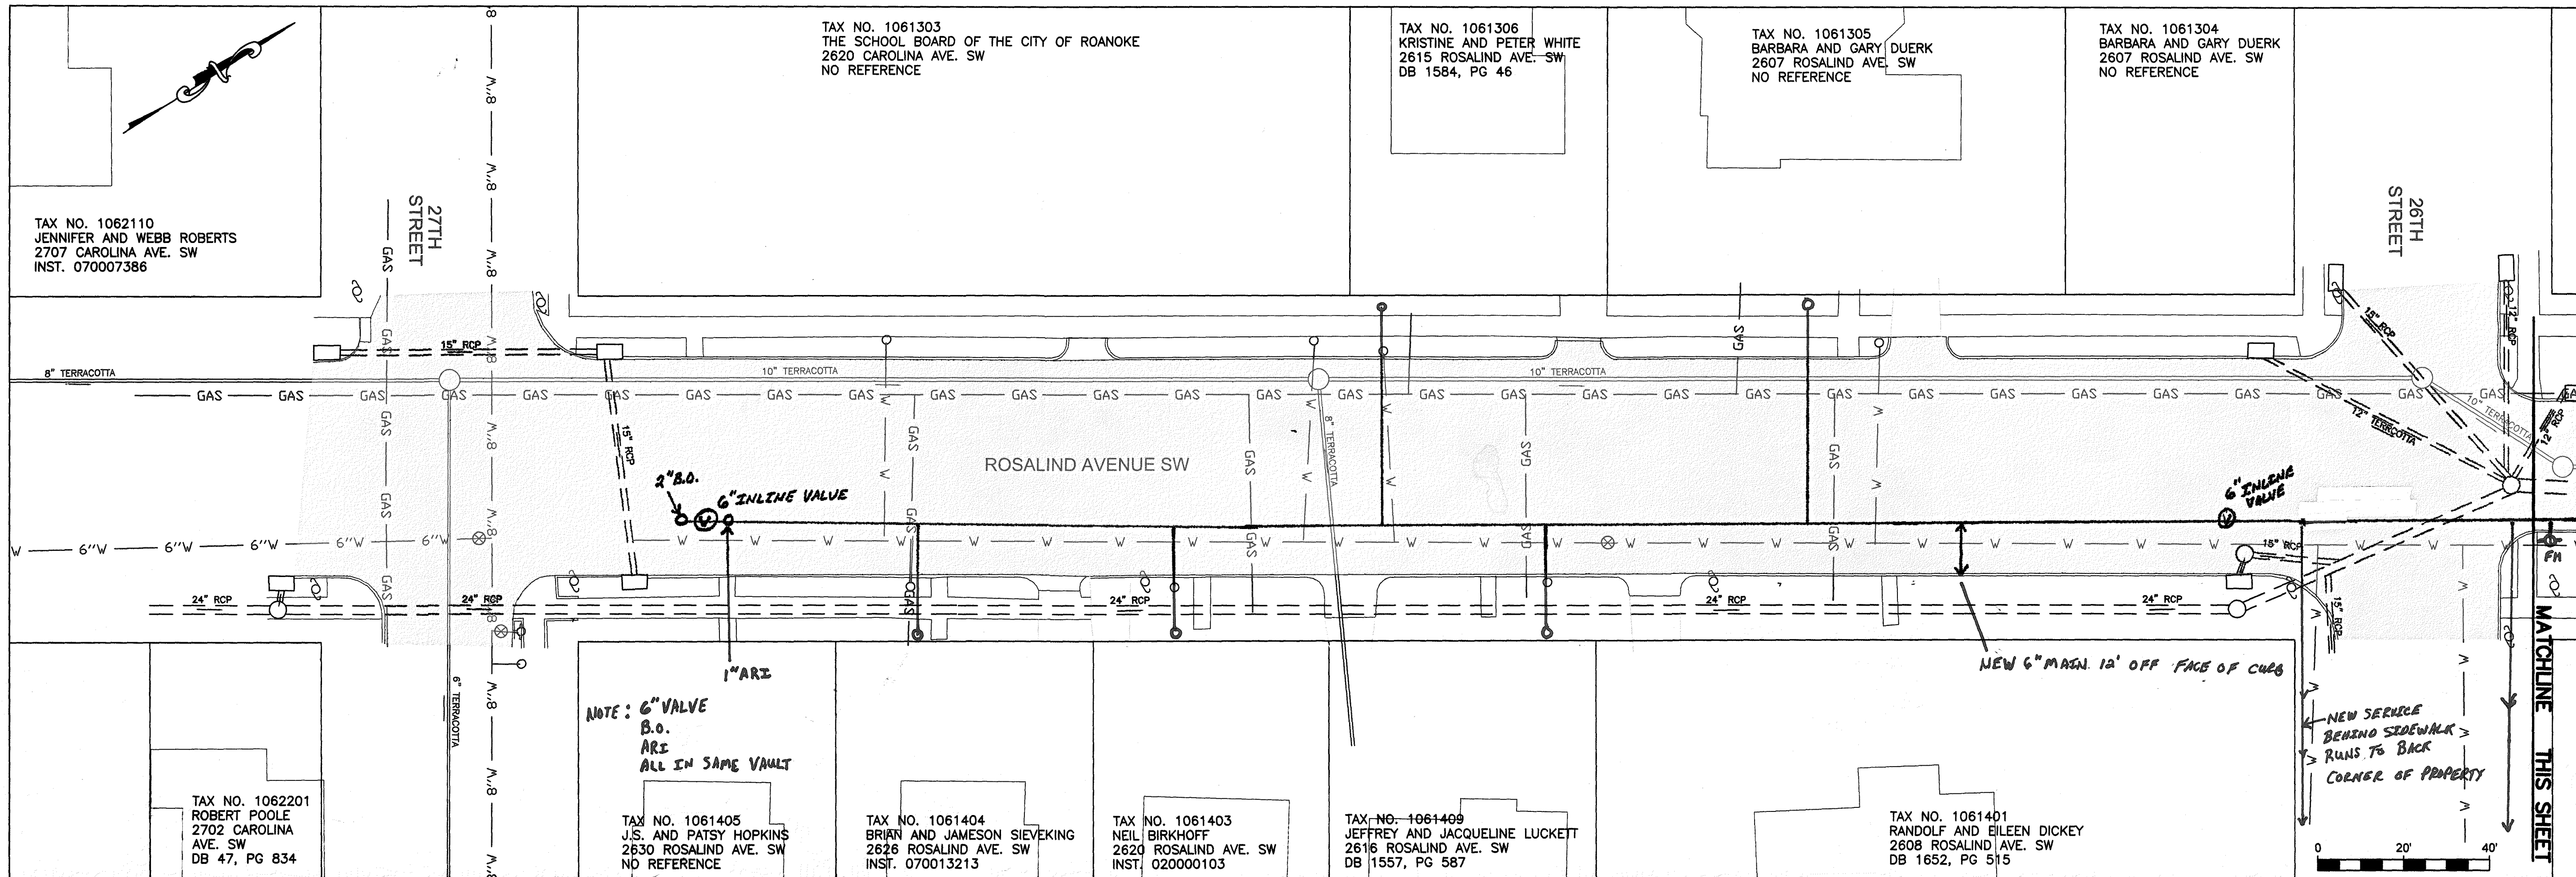

Project Name	
Install Contractor	WVWA CIP-1
Construction Start Date	4-12-18
Completion Date	6-6-18
Water Main(s)	
Manufacturer	U.S. PIPE
Diameter	6"
Pipe Class	350
Material	DUCTILE
Comments	3'6" Cover
Water Service(s)	
Manufacturer	ADS Polyflex
Diameter	1"
Pipe Class	250 PSI SDR 9
Material	POLY CTS HDPE
Comments	
Water Valve(s) 1	
Manufacturer	AVK
Valve Type	GATE
Diameter	6"
Direction to Open / Turns to Close	
Comments	
Water Valve (s) 2	
Manufacturer	
Valve Type	
Diameter	
Direction to Close / Turns to Close	
Comments	
Hydrant(s)	
Authority ID #	
Manufacturer	
Model	
Cast Date	
Static Pressure	
Comments	

WESTERN VIRGINIA

WATER AUTHORITY

ENGINEERING SERVICES

601 S JEFFERSON ST, SUITE 300

ROANOKE, VA 24011

540-853-5700

ROSALIND AVE (23RD ST - 27TH ST)

WATER MAIN REPLACEMENTS

BASEMAP

Rev	Date	Description

Designed: DRJ
Drawn: DRJ
Checked:
Approved:
Date: MAY 2018
Project: WCIP-006

1
Sheet 1 of 2