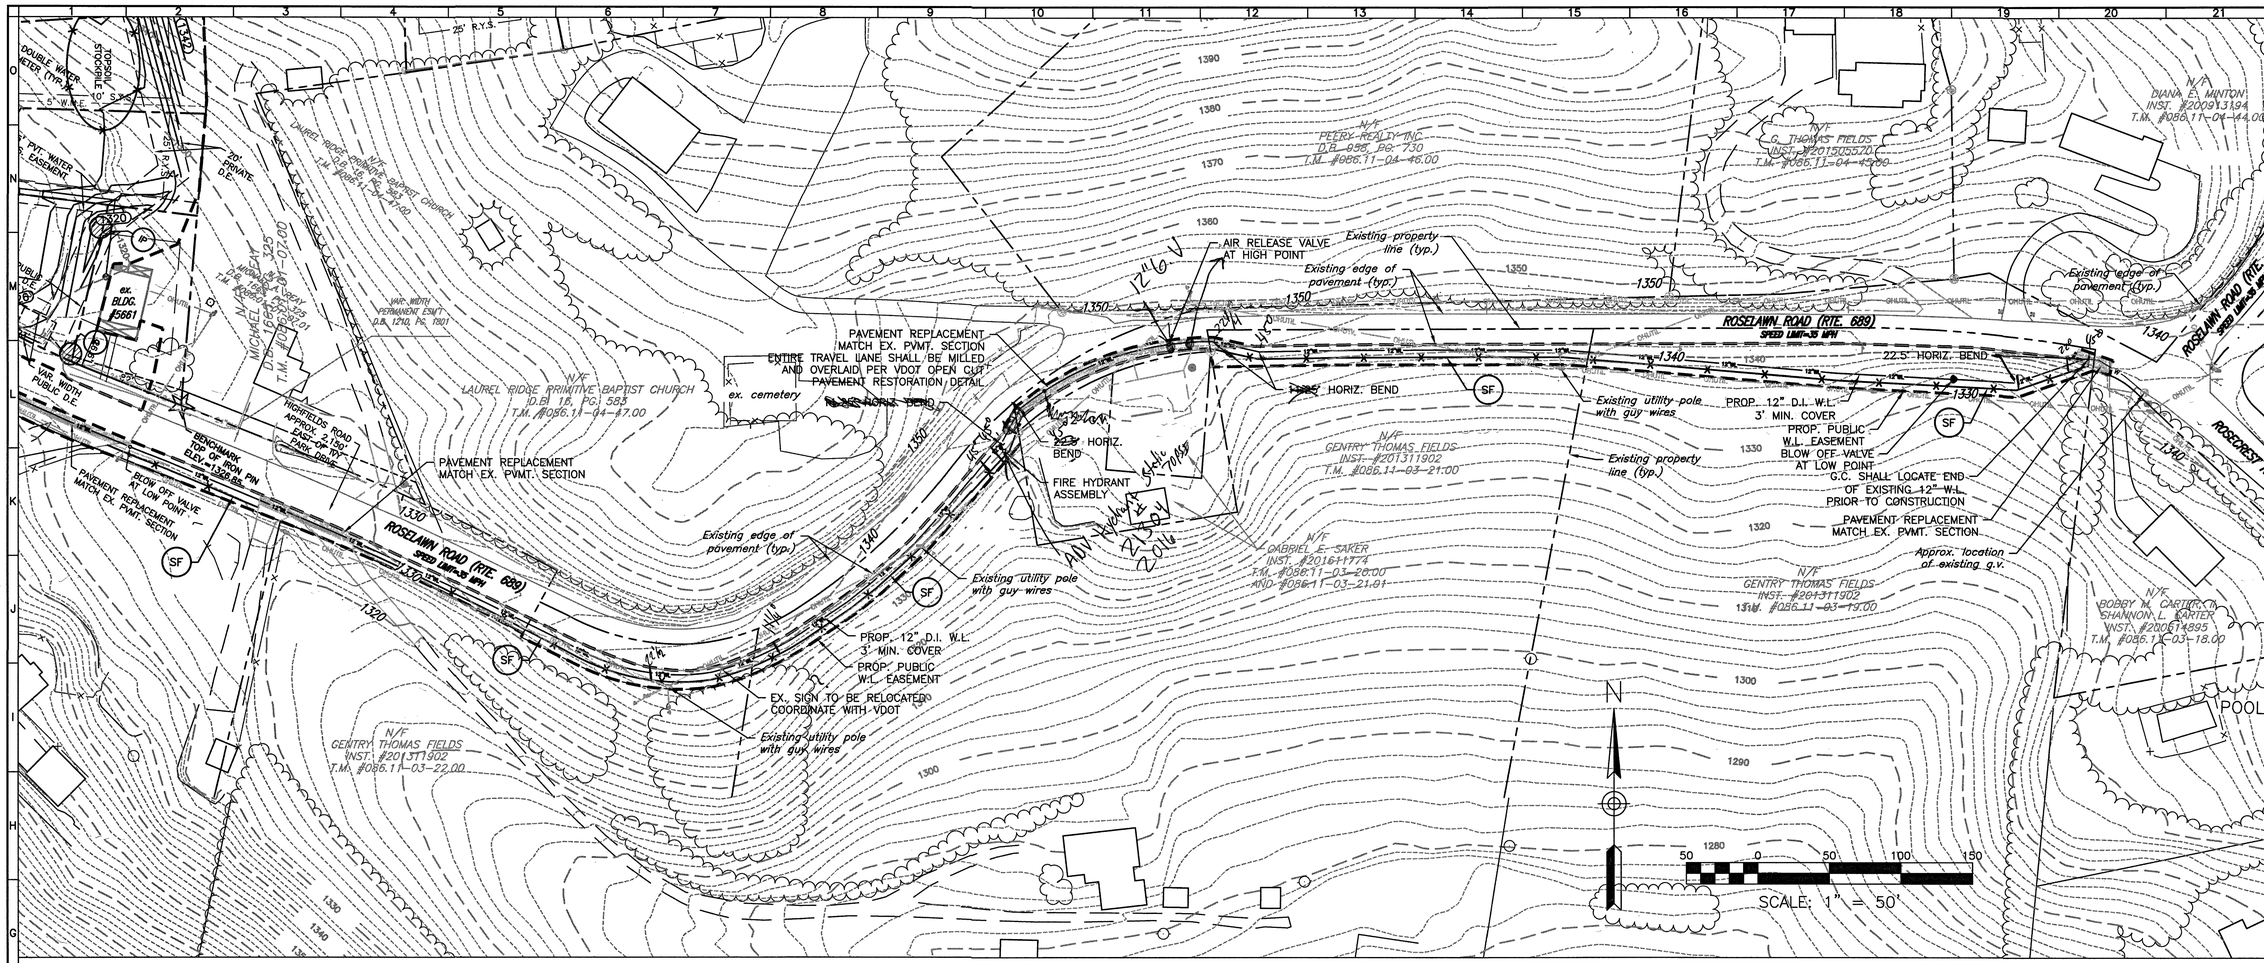

WATERLINE EXTENSION PROFILE #2

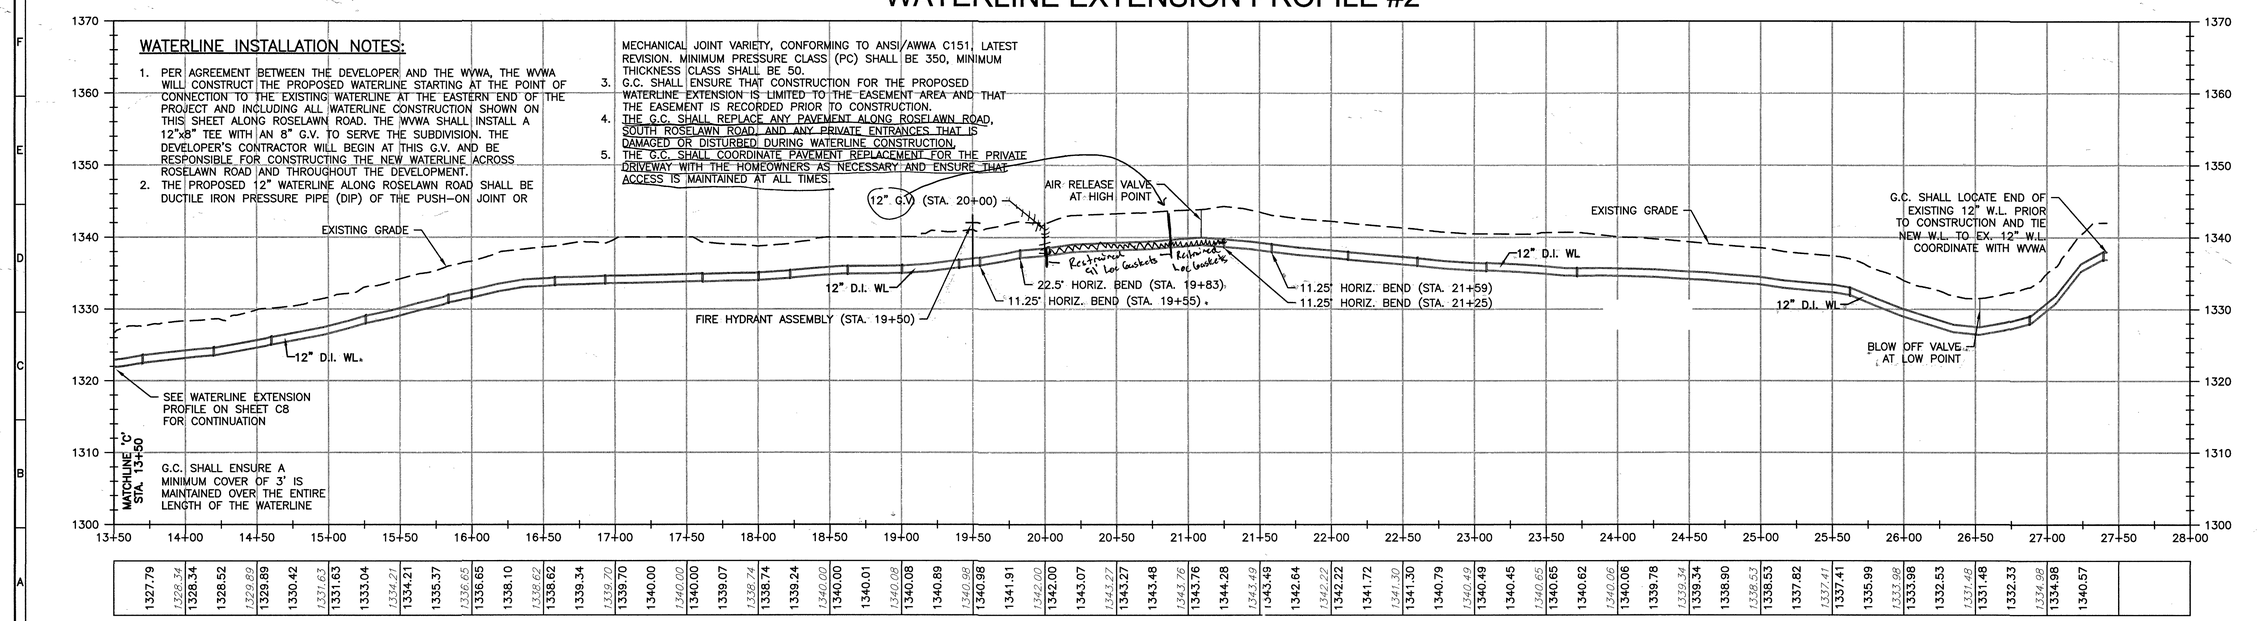

WATERLINE INSTALLATION NOTES:

1. PER AGREEMENT BETWEEN THE DEVELOPER AND THE WVWA, THE WVWA WILL CONSTRUCT THE PROPOSED WATERLINE STARTING AT THE POINT OF CONNECTION TO THE EXISTING WATERLINE AT THE EASTERN END OF THE PROJECT AND INCLUDING ALL WATERLINE CONSTRUCTION SHOWN ON THIS SHEET ALONG ROSELAWN ROAD. THE WVWA SHALL INSTALL A 12"x8" TEE WITH AN 8" G.V. TO SERVE THE SUBDIVISION. THE DEVELOPER'S CONTRACTOR WILL BEGIN AT THIS G.V. AND BE RESPONSIBLE FOR CONSTRUCTING THE NEW WATERLINE ACROSS ROSELAWN ROAD AND THROUGHOUT THE DEVELOPMENT.
2. THE PROPOSED 12" WATERLINE ALONG ROSELAWN ROAD SHALL BE DUCTILE IRON PRESSURE PIPE (DIP) OF THE PUSH-ON JOINT OR MECHANICAL JOINT VARIETY, CONFORMING TO ANSI/AWWA C151, LATEST REVISION. MINIMUM PRESSURE CLASS (PC) SHALL BE 350, MINIMUM THICKNESS CLASS SHALL BE 50.
3. G.C. SHALL ENSURE THAT CONSTRUCTION FOR THE PROPOSED WATERLINE EXTENSION IS LIMITED TO THE EASEMENT AREA AND THAT THE EASEMENT IS RECORDED PRIOR TO CONSTRUCTION.
4. THE G.C. SHALL REPLACE ANY PAVEMENT ALONG ROSELAWN ROAD, SOUTH ROSELAWN ROAD, AND ANY PRIVATE ENTRANCES THAT IS DAMAGED OR DISTURBED DURING WATERLINE CONSTRUCTION.
5. THE G.C. SHALL COORDINATE PAVEMENT REPLACEMENT FOR THE PRIVATE DRIVEWAY WITH THE HOMEOWNERS AS NECESSARY AND ENSURE THAT ACCESS IS MAINTAINED AT ALL TIMES.

| | | |