
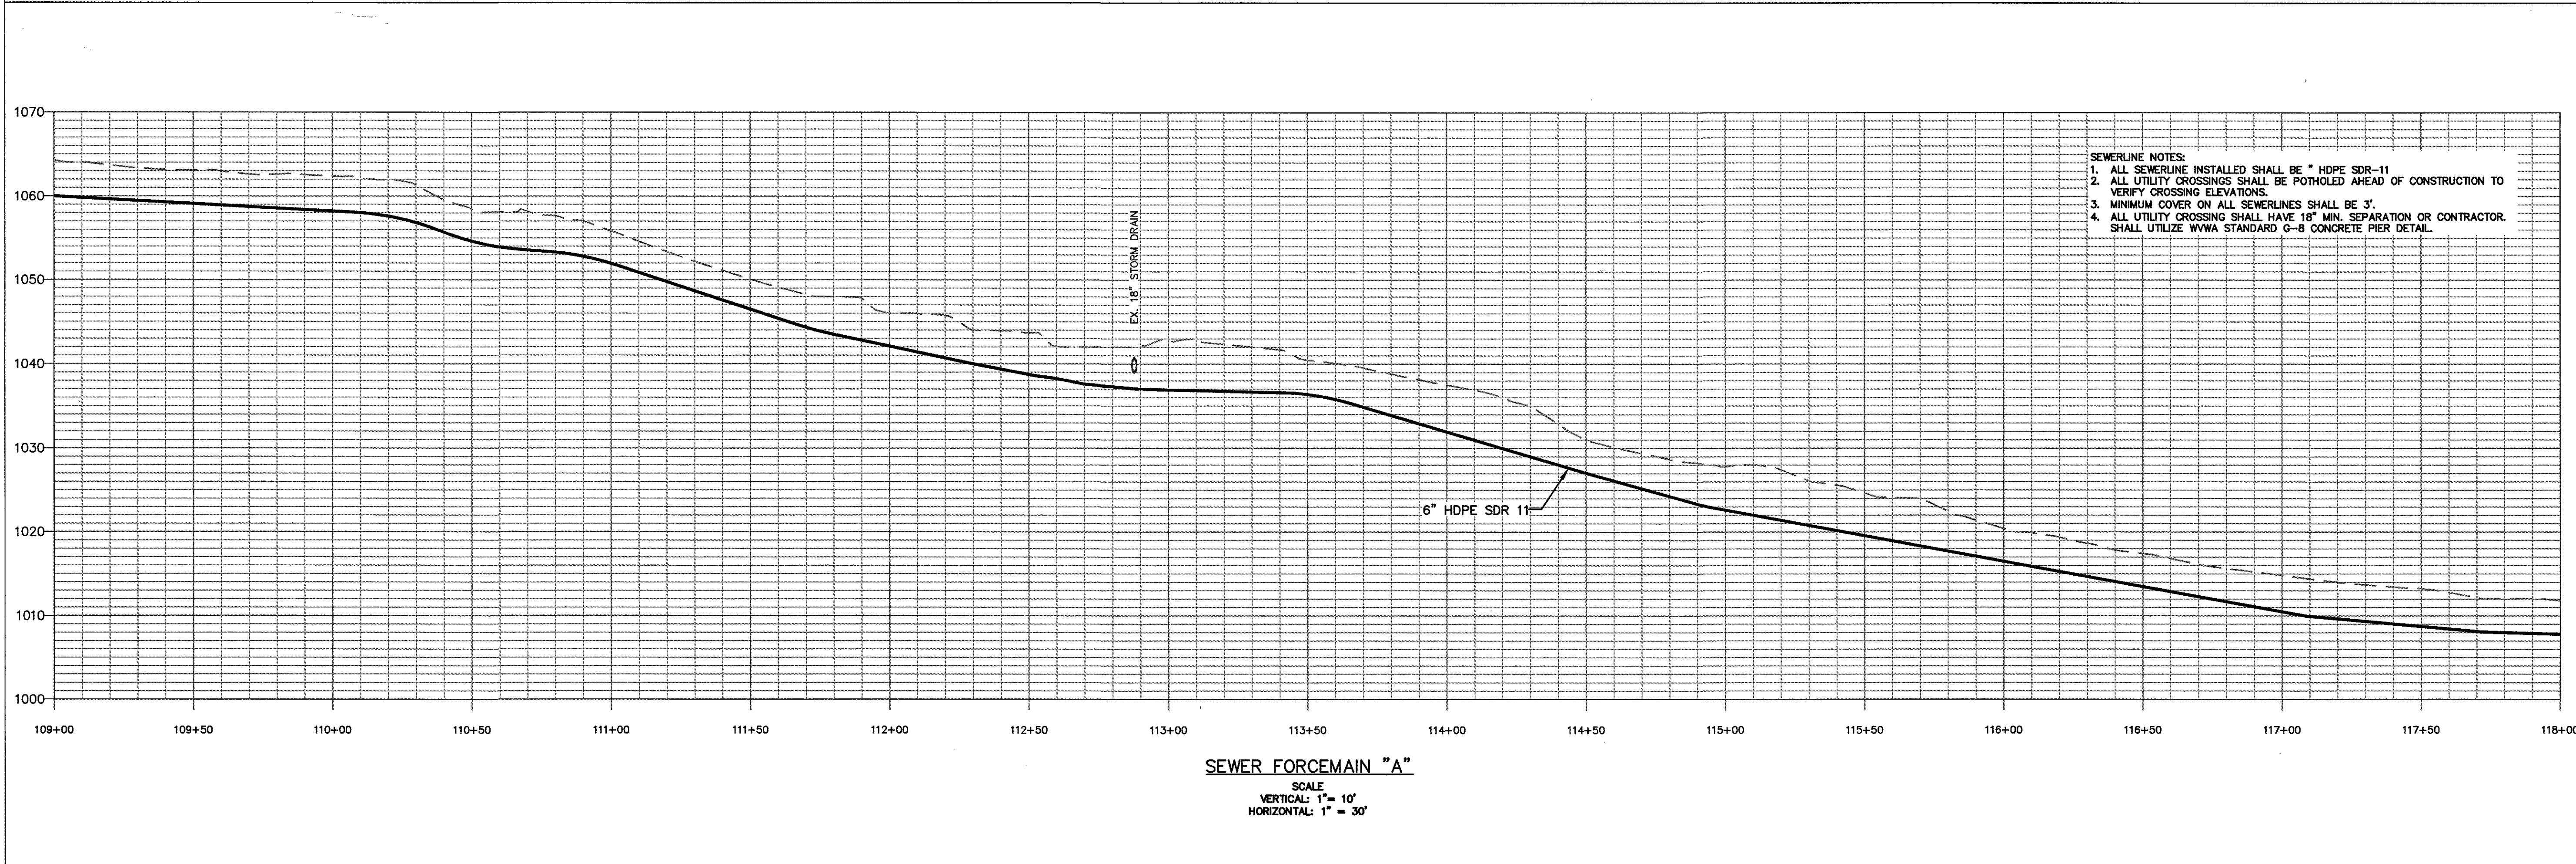


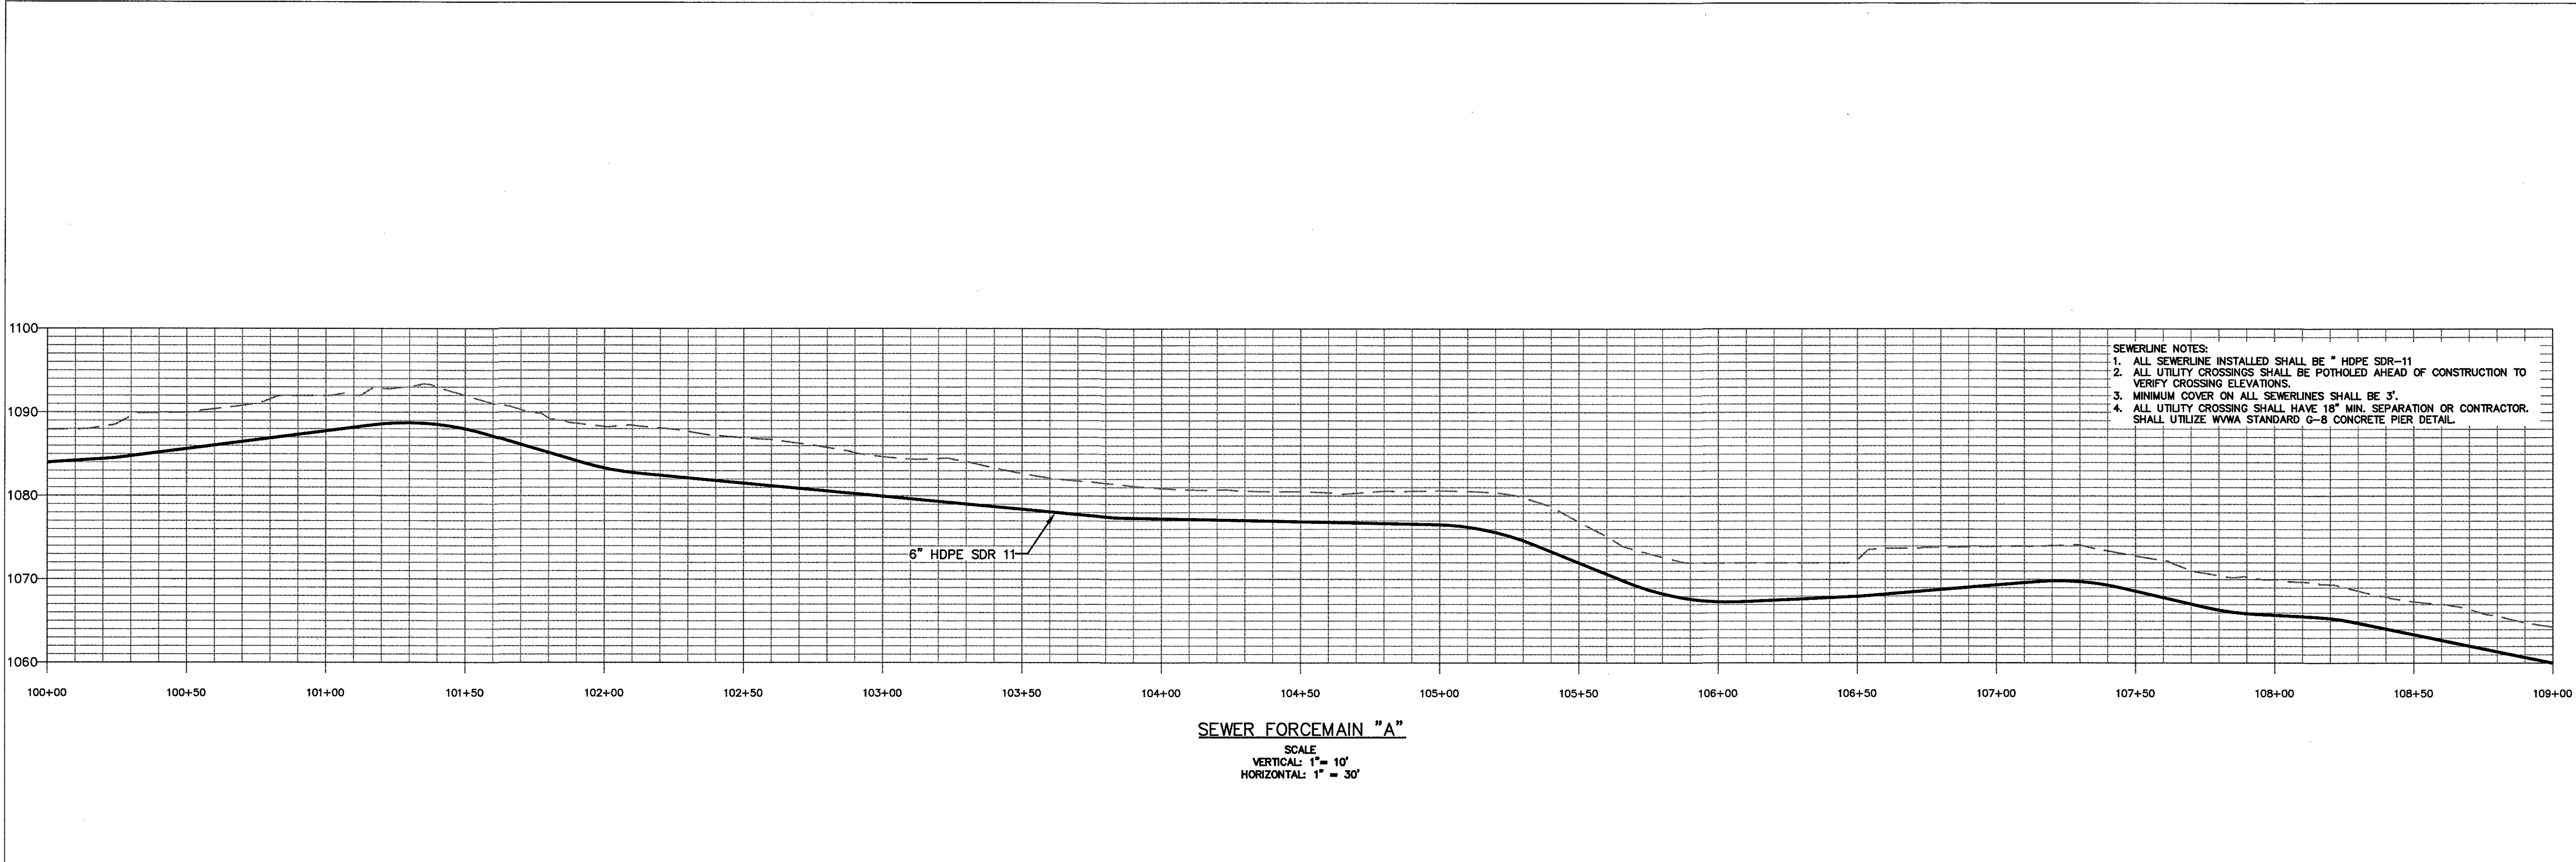

- SEWERLINE NOTES:
1. ALL SEWERLINE INSTALLED SHALL BE " HDPE SDR-11
 2. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 3. MINIMUM COVER ON ALL SEWERLINES SHALL BE 3'.
 4. ALL UTILITY CROSSING SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYWA STANDARD G-8 CONCRETE PIER DETAIL.

- SEWERLINE NOTES:
1. ALL SEWERLINE INSTALLED SHALL BE " HDPE SDR-11
 2. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 3. MINIMUM COVER ON ALL SEWERLINES SHALL BE 3'.
 4. ALL UTILITY CROSSING SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYWA STANDARD G-8 CONCRETE PIER DETAIL.

WESTERN VIRGINIA


WATER AUTHORITY

ENGINEERING SERVICES

601 S JEFFERSON ST, SUITE 300

ROANOKE, VA 24011

540-853-5770

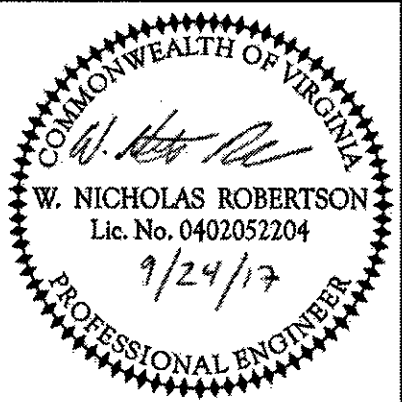

RUTROUGH ROAD WATER & SEWER EXTENSION PHASE 2				SEWER PROFILE			
Rev	Description	Date	By	Rev	Description	Date	By
Designed: AAS							
Drawn: AAS							
Checked: WNR							
Approved:							
Date: 9/24/17							
Project:							
				23			
				Sheet 23 of 31			