


SEWERLINE NOTES:

1. ALL SEWERLINE INSTALLED SHALL BE " HDPE SDR-11
2. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
3. MINIMUM COVER ON ALL SEWERLINES SHALL BE 3'.
4. ALL UTILITY CROSSING SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYMA STANDARD G-8 CONCRETE PIER DETAIL.

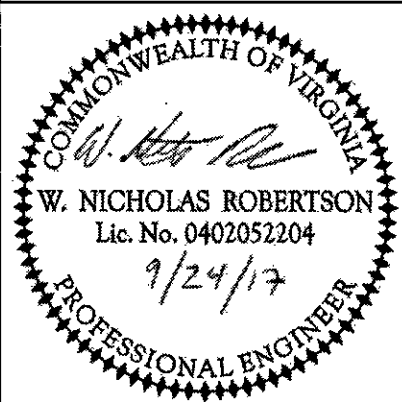

SEWER PROFILE

24
Sheet 24 of 31

