


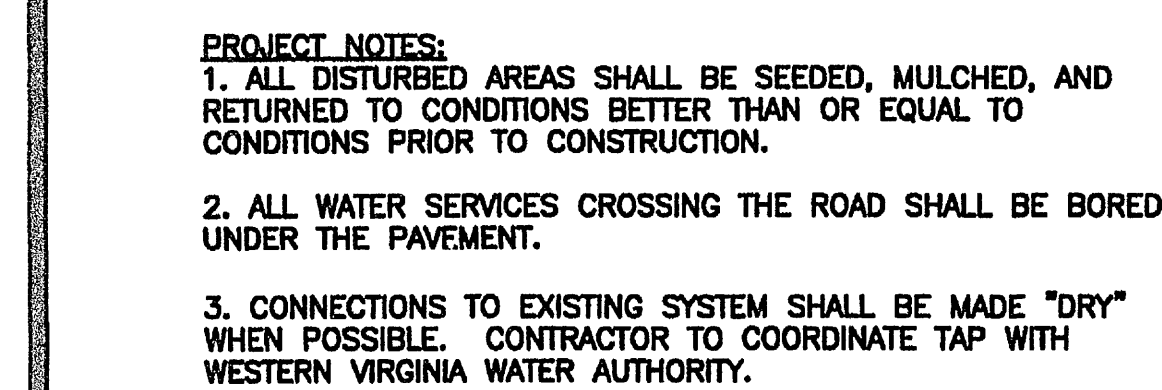

THE MAJORITY OF THE PROPOSED WORK WILL BE DONE WITHIN THE CITY OF ROANOKE RIGHT-OF-WAY. ALL WORK PERFORMED WITHIN THE CITY RIGHT-OF-WAY SHALL CONFORM TO THE CITY OF ROANOKE RIGHT-OF-WAY EXCAVATION AND RESTORATION STANDARDS.

CONTRACTOR TO UTILIZE CROSS DITCH SILT FENCE IN
ROADSIDE DITCHES/SWALES AS DEPICTED IN SILT FENCE
DETAIL 3.05 ON SHEET 1D.

CONTRACTOR TO PLACE
CHECK DAMS IN
REGRADED DITCHES

Now Or Formerly
Kevin W. & Lisa McDonough
Tax#2530114
Instrument#20050015851
3125
Salem Turnpike NW

CONTRACTOR TO CONNECT TO
EXISTING COMMERCIAL WATER
SERVICE

FIRE HYDRANT
ASSEMBLY (DETAIL W-18)

CONTRACTOR TO CONNECT TO
EXISTING COMMERCIAL WATER

N/F
DJN INVESTMENTS LLC
TAX#2520102
3118
Salem Turnpike NW



PROJECT NOTES:

PROJECT NOTES:

4. PAVEMENT RESTORATION ON ROANOKE CITY ROUTES SHALL BE IN ACCORDANCE WITH DETAIL UTR-1 ON SHEET 10. A SAW CUT IS REQUIRED FOR ALL PAVEMENT DISTURBANCES PRIOR TO TRENCH EXCAVATION. A TACK COAT MUST BE APPLIED TO THE VERTICAL SURFACES OF THE EXISTING PAVEMENT STRUCTURE PRIOR TO PLACING NEW PAVEMENT STRUCTURE.

5. CONTRACTOR TO ENSURE PAVEMENT SEAM BETWEEN THE NEW PATCH AND/OR OVERLAY AND THE EXISTING PAVEMENT IS NOT LOCATED IN A STORMWATER RUNOFF CONVEYANCE AREA AND/OR AREA PRONE TO STANDING WATER.

6. AS PORTIONS OF THE EXISTING WATERLINE ARE ABANDONED, ASSOCIATED VALVE VAULTS ARE TO BE ABANDONED IN PLACE BY REMOVING THE FRAME & COVER AND FILLING THE VAULT WITH COMPACTED 21A STONE. PROJECT INSPECTOR WILL NOTIFY CONTRACTOR WHEN VAULTS CAN BE ABANDONED. VALVE VAULTS LOCATED IN PAVEMENT SHALL BE RESTORED AS PER DETAIL UTR-1 ON SHEET 10.

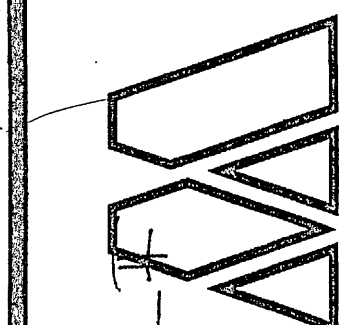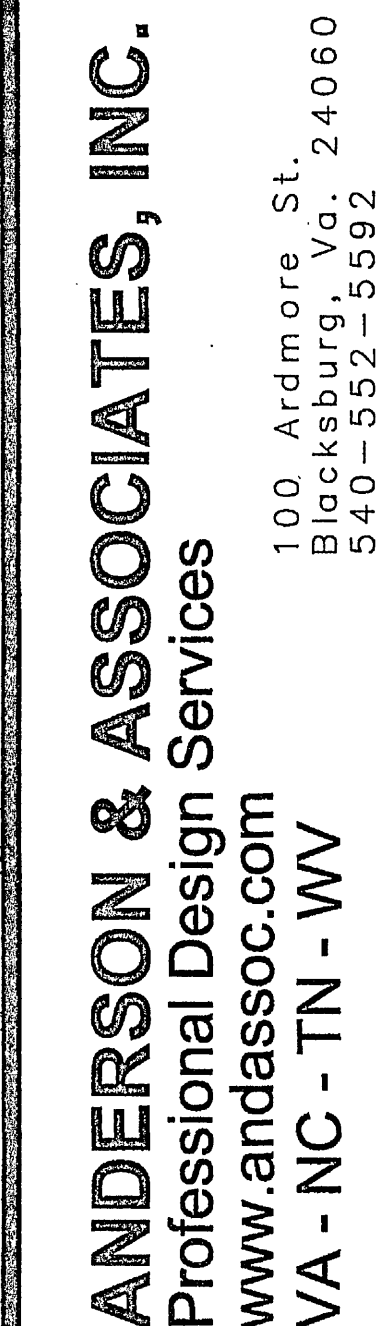

COMMONWEALTH OF VIRGINIA
 THERON F. BARRINEAU, II
 Lic No. 41767
 11 MAR 2011
 PROFESSIONAL ENGINEER

**SALEM TURNPIKE
WATER LINE REPLACEMENT PROJECT
WATERLINE PLAN & PROFILE
STA. 48+50 - 62+00**

Designed By:	TFB
Drawn By:	CBD/LTB
Checked By:	JKD
Date:	03 FEB 2010
Revised:	31 MAR 2010 26 APR 2010 11 MAR 2011
Scale:	HORIZ: 1" = 50' VERT: 1" = 10'
Plan #:	27870-001
Sheet:	5 OF 9