



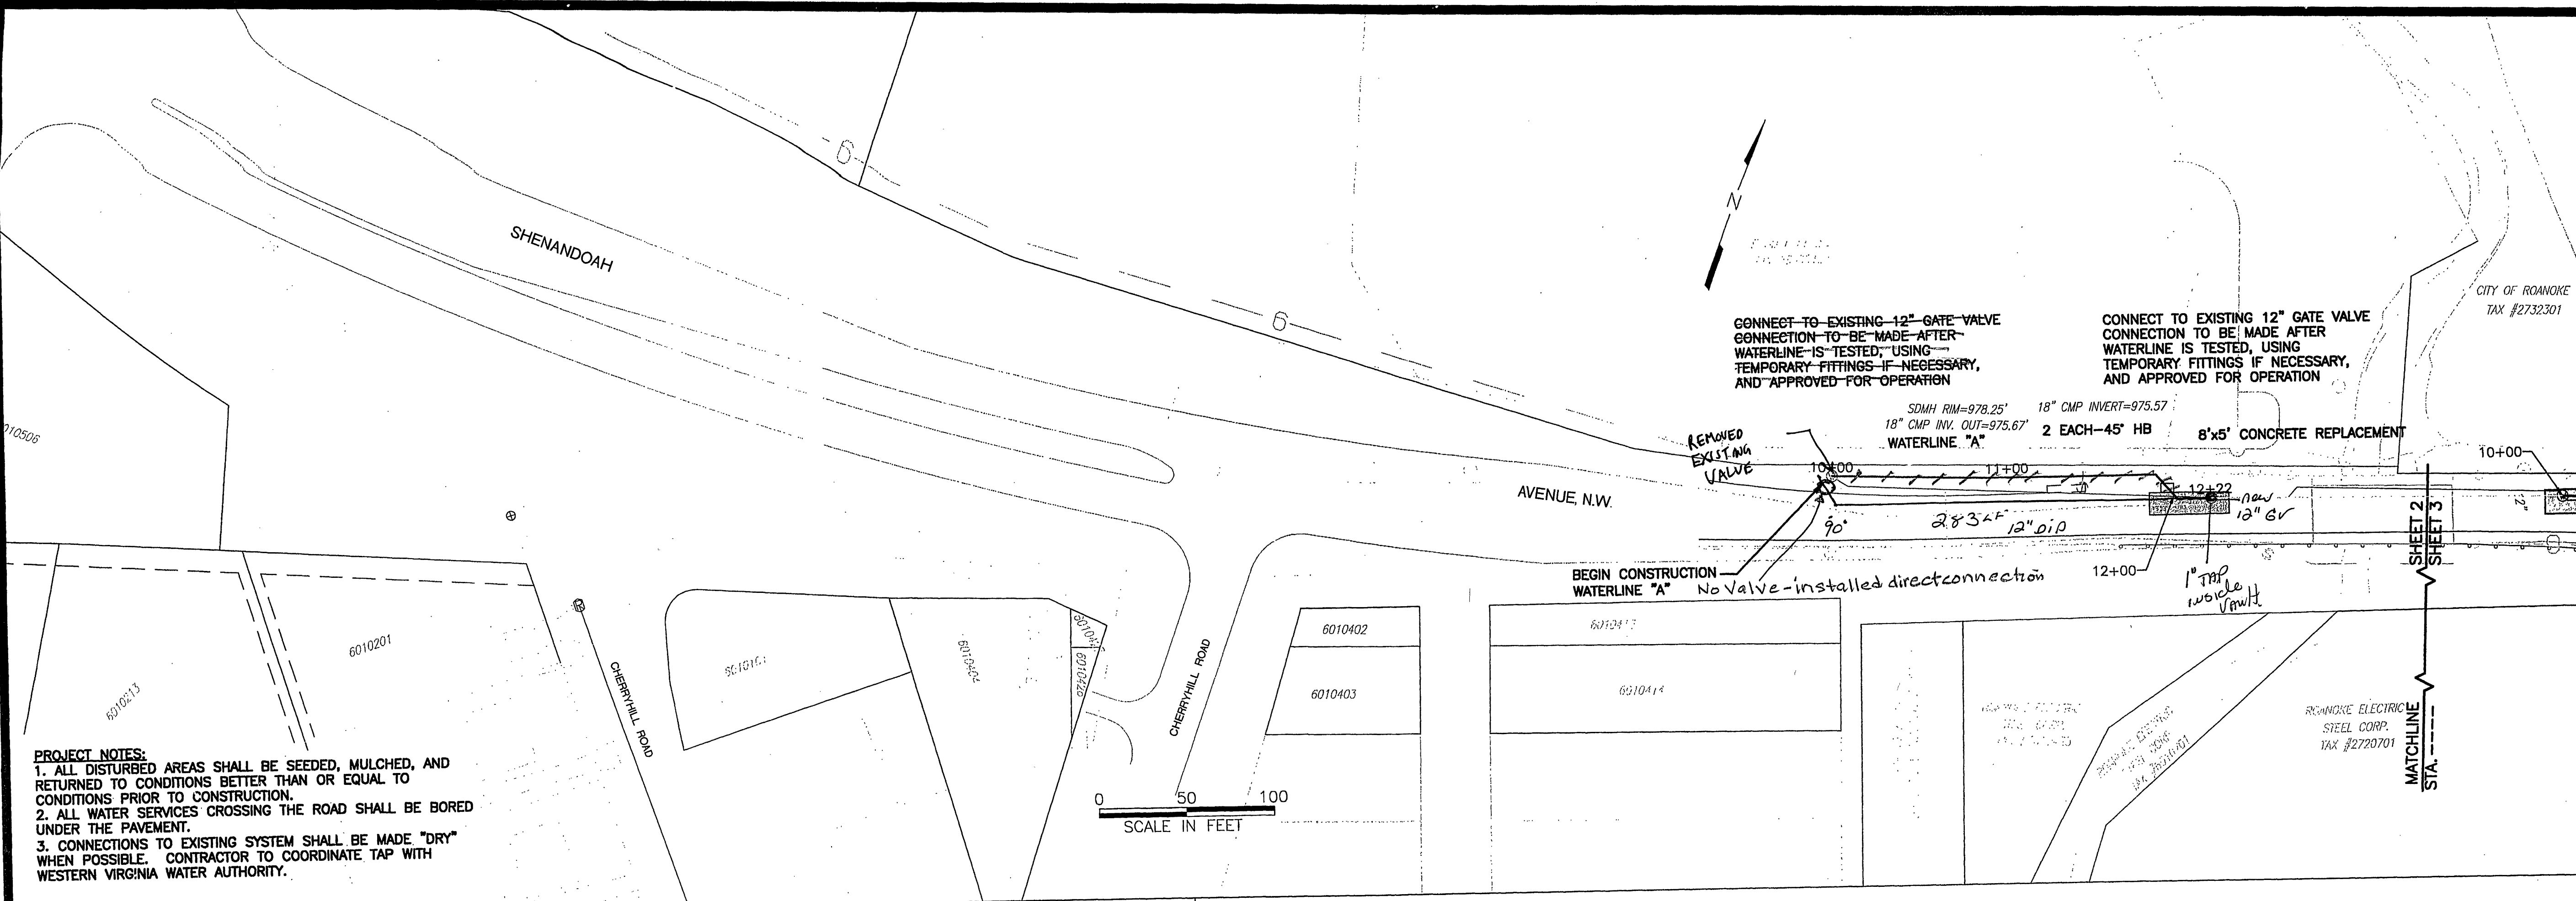


PROJECT NOTES:
1. ALL DISTURBED AREAS SHALL BE SEEDED, MULCHED, AND RETURNED TO CONDITIONS BETTER THAN OR EQUAL TO CONDITIONS PRIOR TO CONSTRUCTION.
2. ALL WATER SERVICES CROSSING THE ROAD SHALL BE BORED UNDER THE PAVEMENT.
3. CONNECTIONS TO EXISTING SYSTEM SHALL BE MADE "DRY" WHEN POSSIBLE. CONTRACTOR TO COORDINATE TAP WITH WESTERN VIRGINIA WATER AUTHORITY.

0 50 100
SCALE IN FEET

ALL UTILITY CROSSINGS MAY NOT BE SHOWN ON THE PROFILES. CONTRACTOR TO TAKE NECESSARY PRECAUTIONS TO FIELD VERIFY THE HORIZONTAL AND VERTICAL LOCATIONS OF THE EXISTING UTILITIES. THE WVWA AND ANDERSON & ASSOCIATES DOES NOT GUARANTEE, STATED OR IMPLIED, THE ACCURACY OF THE EXISTING UTILITY INFORMATION.

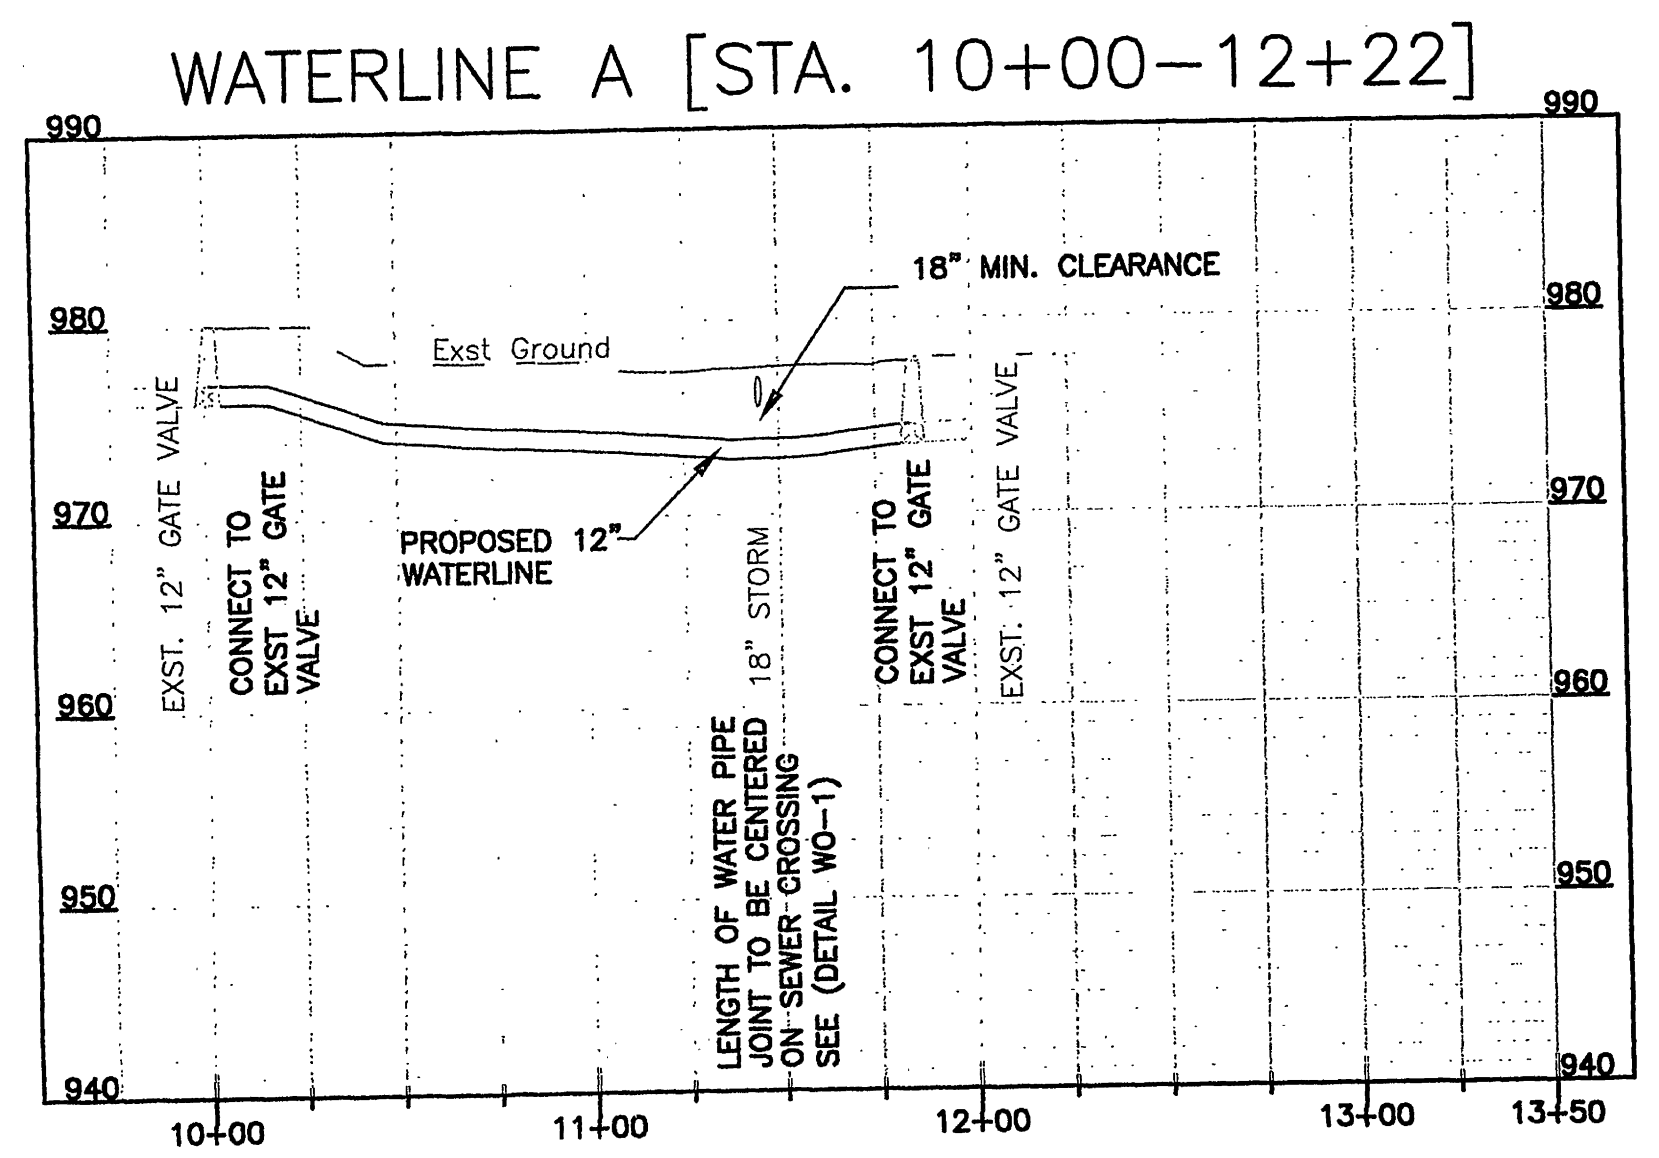

ANDERSON & ASSOCIATES, INC.
Professional Design Services
www.andassoc.com
VA - NC - TN - WV

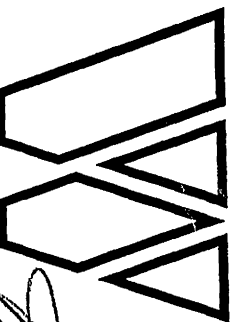
Professional Engineer
L. J. THOMAS, III
Lic. No. 49177
Professional Engineer
8 OCT 2012

**SHENANDOAH AVENUE
WATER LINE REPLACEMENT PROJECT
WATERLINE PLAN & PROFILE
WATERLINE "A" 10+00 - 12+22**

Designed By: LTB
Drawn By: CBD/LTB
Checked By: TFB
Date: 26 JULY 2012
Revised: 23 AUG 2012
08 OCT 2012
Scale: HORZ: 1" = 50'
VERT: 1" = 10'
Plan #: 29753-001
Sheet: 2 OF 12

100 Ardmore St.
Blacksburg, Va. 24060
540-552-5592