


THRUST BLOCK CONSTRUCTION
NO SCALE




PIPE SUPPORT IN CASING PIPE

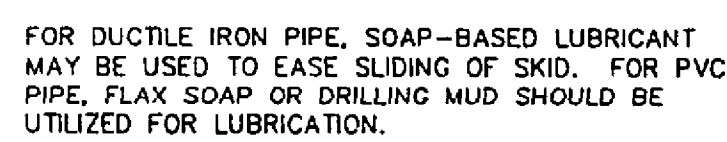

1. INSTALL FLUSH TYPE BLOW OFF WITH A SAMPLING TAP WHERE SPECIFICALLY CALLED OUT ON CONSTRUCTION DRAWINGS. WHERE NO SAMPLING TAP IS SPECIFIED OMIT 1" SAMPLING TAP AND ALL ASSOCIATED APPURTENANCES. IN ALL OTHER INSTANCES THE STANDARD BLOW OFF DETAIL SHOULD BE USED FOR CONSTRUCTION OF BLOW OFF ASSEMBLY.
2. SAMPLING TAP SHALL BE CONSTRUCTED USING GUIDELINES AS SET FORTH IN THE ROANOKE COUNTY PLUMBING STANDARDS.

FLUSH TYPE BLOW OFF

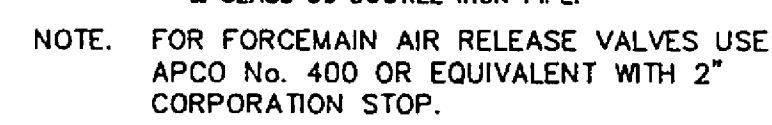

AUTOMATIC AIR RELEASE ASSEMBLY



- NOTES:
- (1) MAIN BODY OF HYDRANT MUST BE SILVER AND HAVE RED CAPS AND BONNET.
 - (2) DISTANCE "A" WITH CURB AND CUTTER, 2' MIN., 4' MAX. FROM BACK OF CURB.
 - (3) DISTANCE "A" WITHOUT CURB AND CUTTER, 6' MIN., 12' MAX. FROM EDGE OF PAVEMENT.
 - (4) AREA AROUND HYDRANT AT A RADIUS OF 4' TO BE APPROXIMATELY LEVEL AND UNOBSTRUCTED FOR ROAD CONSTRUCTION.



WT-0525