NOTES:
1. SEE SHEET 11 FOR TYPICAL DETAILS OF EROSION & SEDIMENT CONTROL MEASURES NECESSARY TO CONTROL RUNOFF FROM TEMPORARY STOCKPILE DURING WATERLINE INSTALLATION.

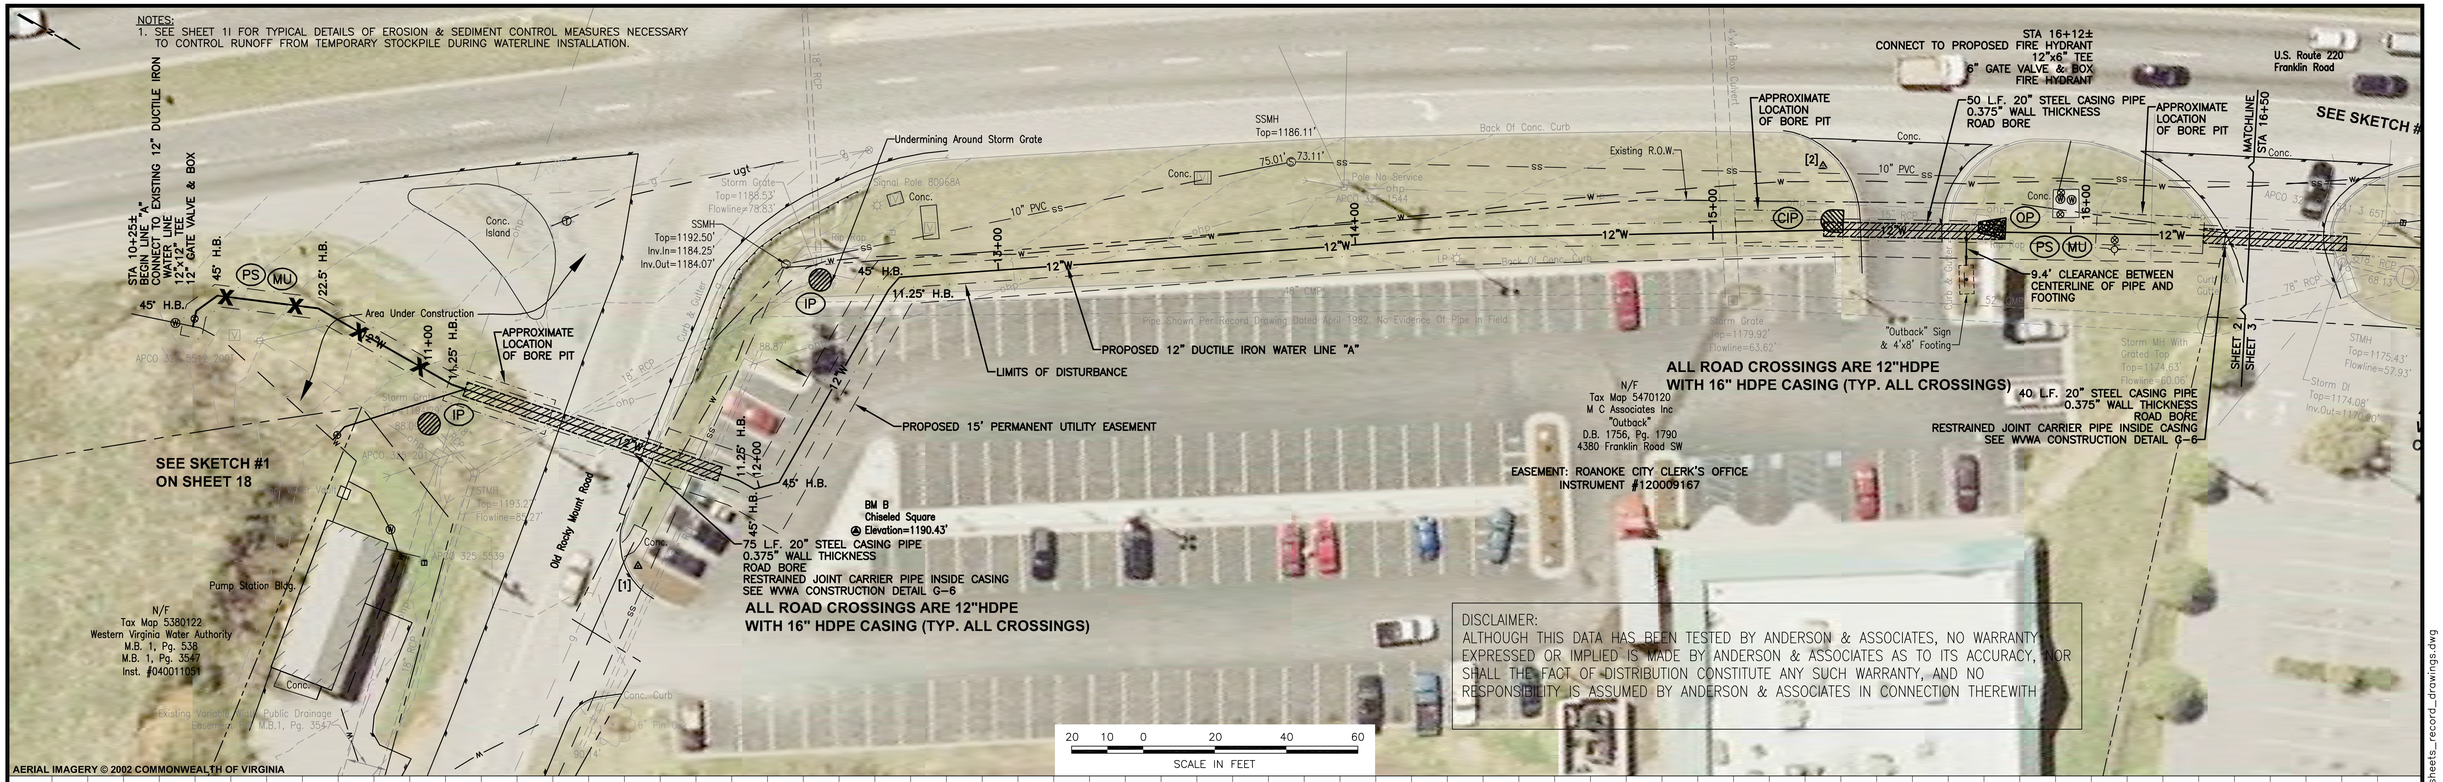

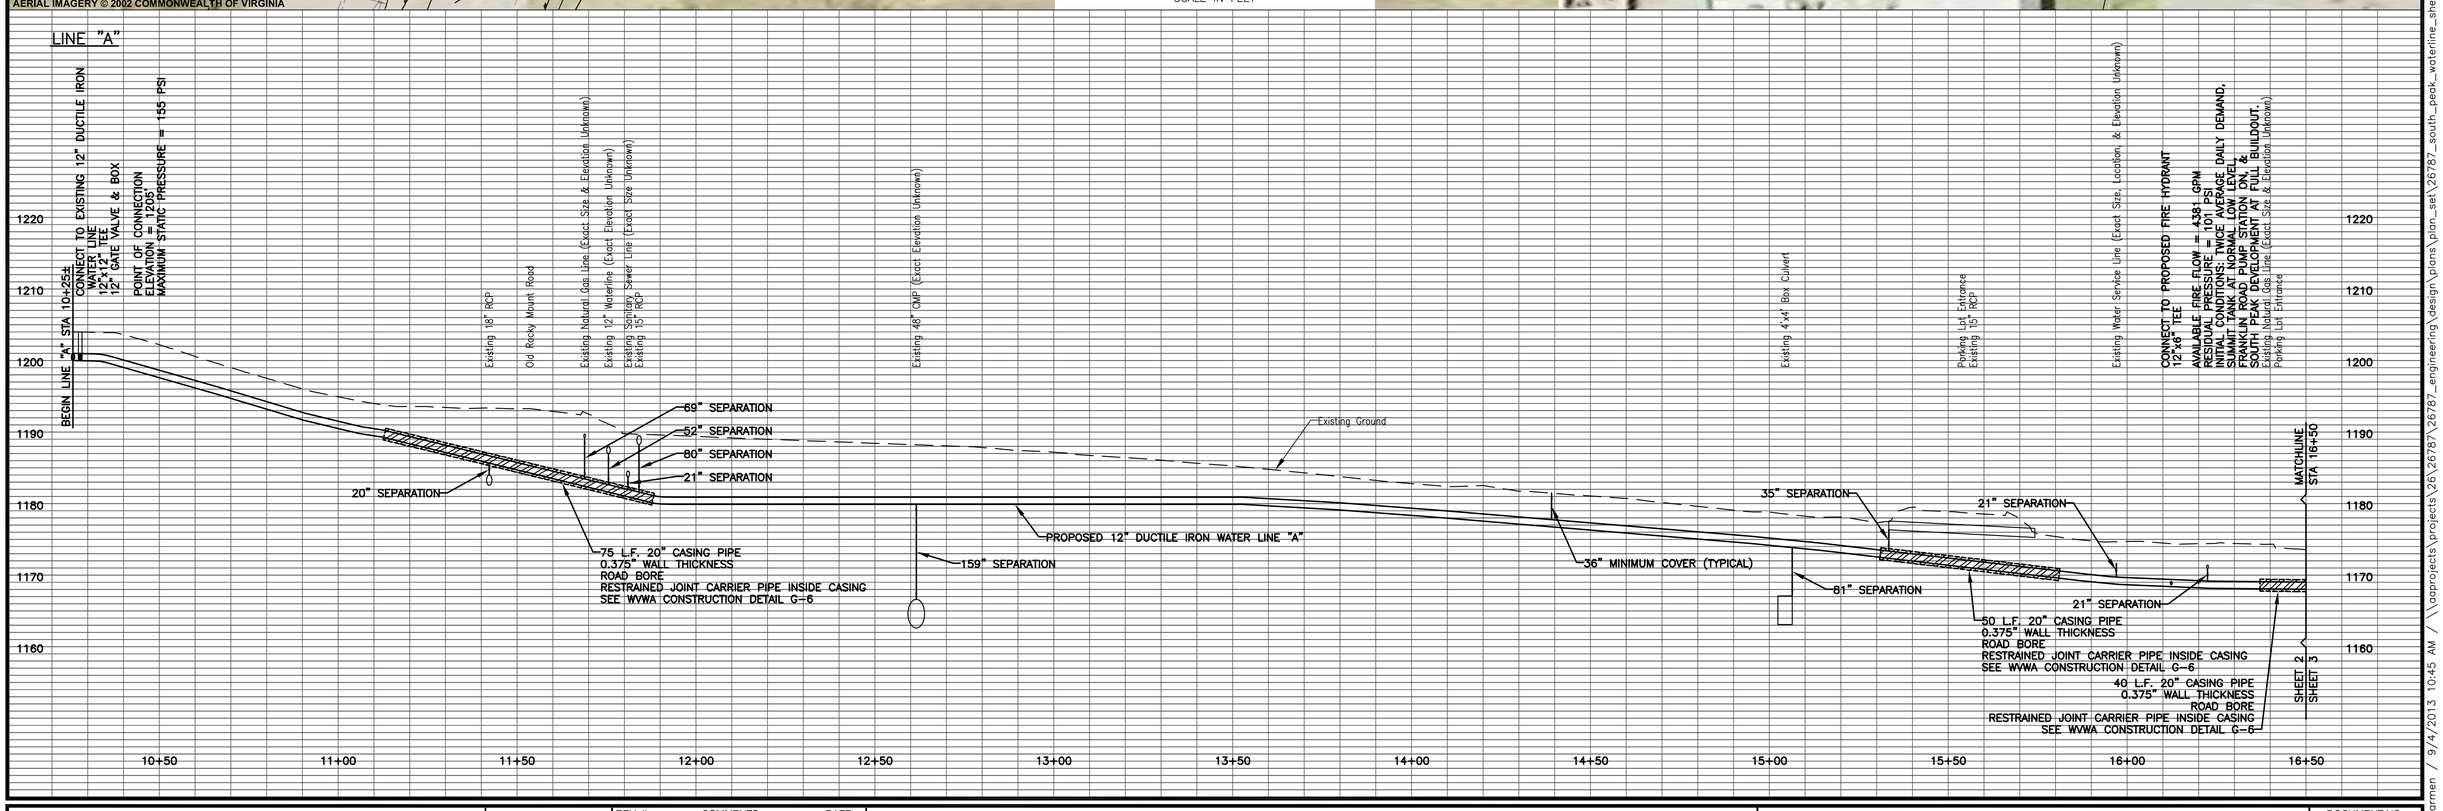

ANDERSON & ASSOCIATES, INC.
Professional Design Services
www.andassoc.com
100 Ardmore St.
Blacksburg, Va. 24060
540-552-5592

DATE	13 APR 12
DESIGNED	BJM
DRAWN	BJM
CHECKED	DAA
QA / QC	JKD

REV. #	COMMENTS	DATE
2	ROW ADDED	04 JUN 12
3	BORE PIT ADDED	04 JUN 12
5	RECORD	04 SEP 13
6	2ND REVIEW	20 AUG 12

SOUTH PEAK DEVELOPMENT
PHASE I WATER SYSTEM IMPROVEMENTS

WATER PLAN & PROFILE SHEET
LINE "A" STA 10+25± TO STA 16+50

DOCUMENT NO. 26787 – 013
SHEET 2 OF 30

Dunford, Carmen / 9/4/2013 10:45 AM / \\aaprojects\projects\26\26787\26787_engineering\design\plans\plan_set\26787_south_peak_waterline_sheets_record_drawings.dwg