



Waterline No. 2 PROFILE

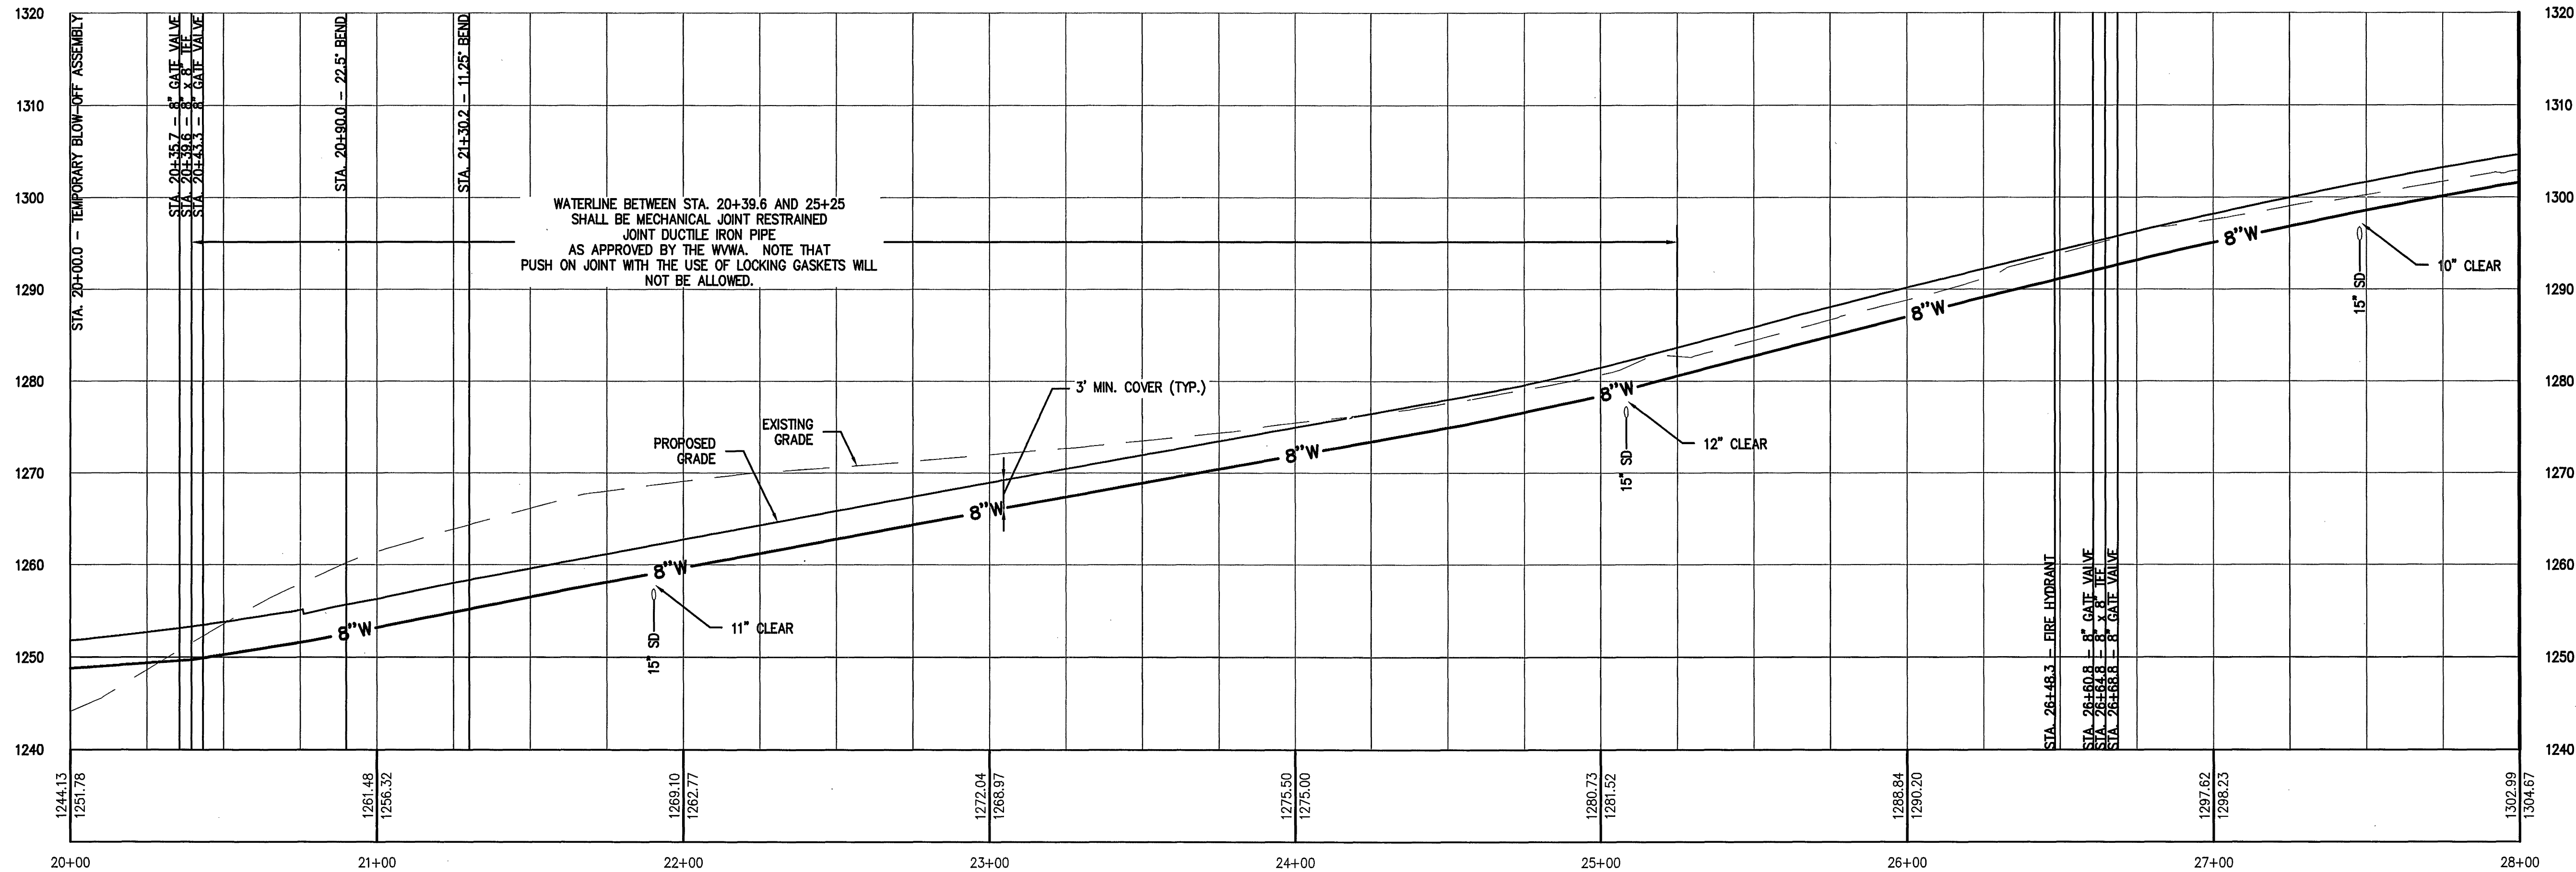

Waterline No. 2 PROFILE

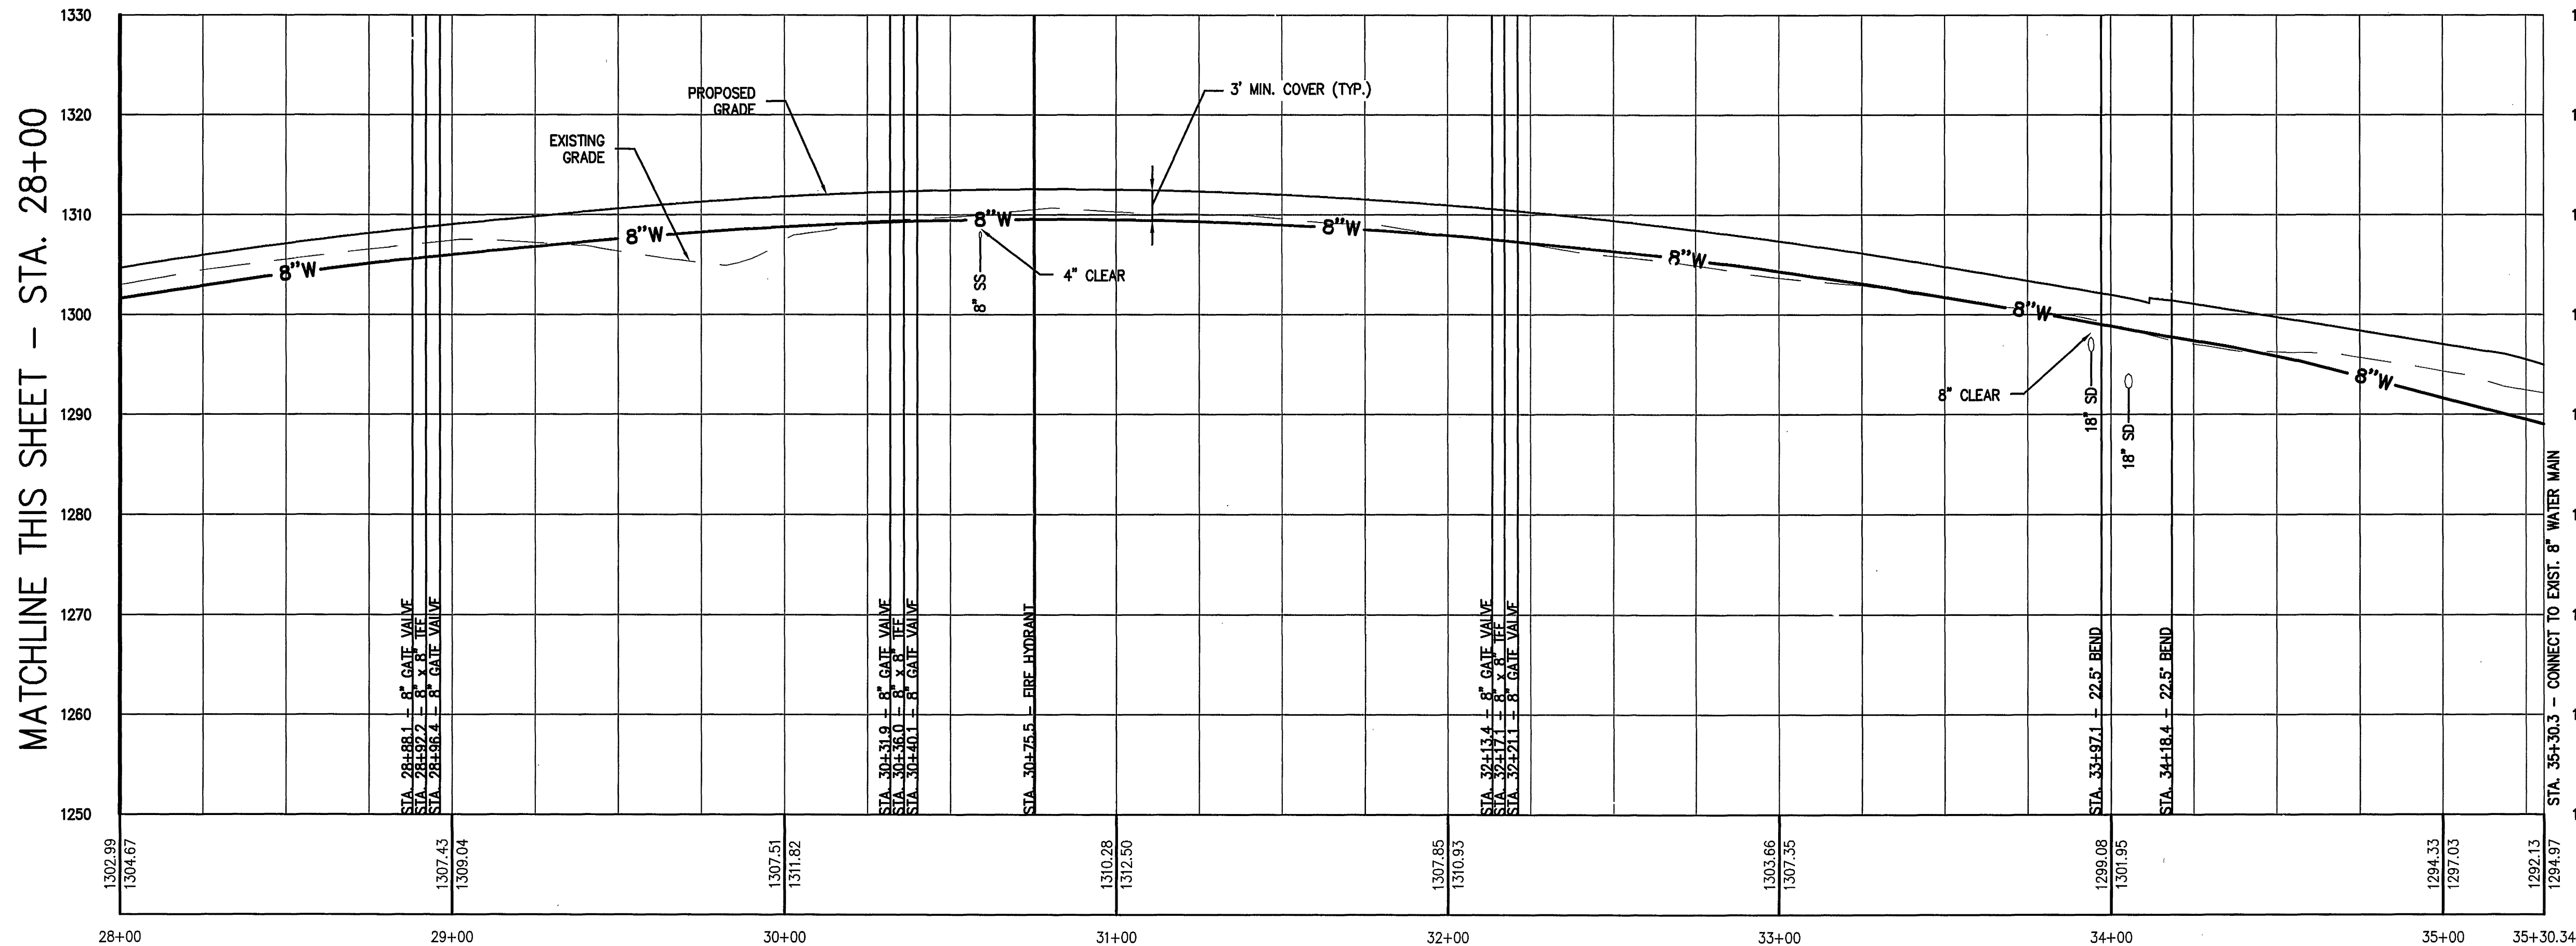

NOTES:

1. LINE SHOWN ON WATERLINE PROFILES (SHEETS C-10A & C-10B) REPRESENTS TOP OF PIPE.
2. SEE PLAN SHEET C-5 FOR UTILITY NOTES.
3. ALL WATER PIPE ON THIS PROJECT SHALL BE DUCTILE IRON PIPE.
4. BETWEEN WATERLINE STATIONS 11+25 AND 12+50, AND STATIONS 15+00 TO 18+26, THE USE OF PUSH ON JOINT WITH LOCKING GASKETS SHALL NOT BE ALLOWED. APPROVED PIPE SHALL BE MECHANICAL JOINT RESTRAINED JOINT DUCTILE IRON PIPE AS LISTED IN WYMA SPECIFICATIONS SECTION CS-2, 2.1.D.1.a.
5. ANCHOR BLOCKS SHALL BE INSTALLED ON THE WATERLINE WHERE SHOWN ON THE PLANS, AND SHALL BE AS DETAILED IN WYMA DETAIL G-10 SHOWN ON SHEET C-12A.

[illegible]

JULY 23, 2012
Drawn By: RWA
Designed By: RWA/WTA
Checked By: WTA
Date: 07/23/2012

Mattern & Craig
CONSULTING ENGINEERS • SURVEYORS

701 FIRST STREET, S.W.
ROANOKE, VIRGINIA 24016
(540) 345-9342
FAX (540) 345-7691

WATERLINE PROFILE

Vertical Scale:
1" = 10'

Horizontal Scale:
1" = 30'

Commission Number:
3101B

Sheet No.:

C-10B

