



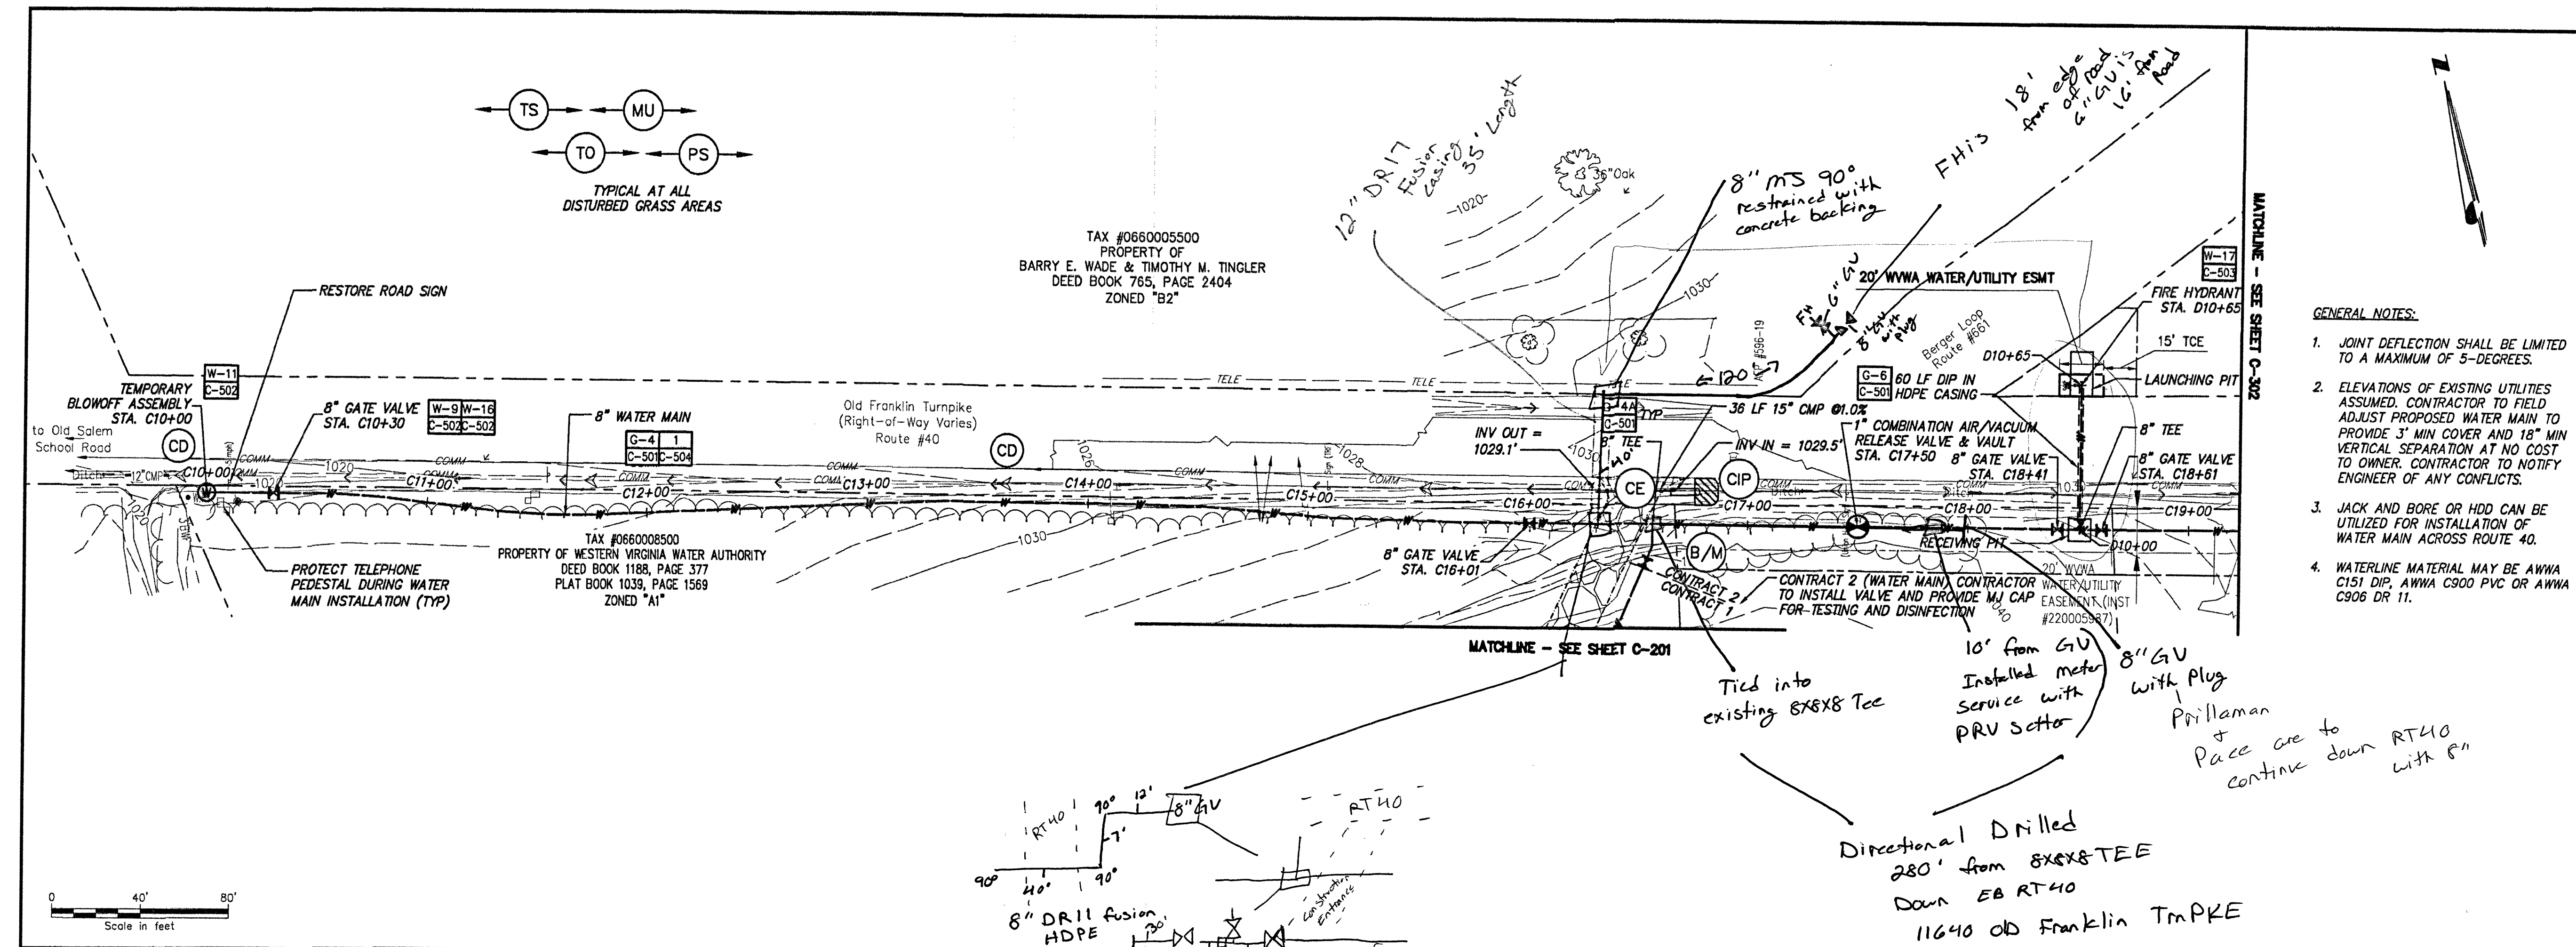

- GENERAL NOTES:
- JOINT DEFLECTION SHALL BE LIMITED TO A MAXIMUM OF 5-DEGREES.
 - ELEVATIONS OF EXISTING UTILITIES ASSUMED. CONTRACTOR TO FIELD ADJUST PROPOSED WATER MAIN TO PROVIDE 3' MIN COVER AND 18" MIN VERTICAL SEPARATION AT NO COST TO OWNER. CONTRACTOR TO NOTIFY ENGINEER OF ANY CONFLICTS.
 - JACK AND BORE OR HDD CAN BE UTILIZED FOR INSTALLATION OF WATER MAIN ACROSS ROUTE 40.
 - WATERLINE MATERIAL MAY BE AWWA C151 DIP, AWWA C906 PVC OR AWWA C906 DR 11.

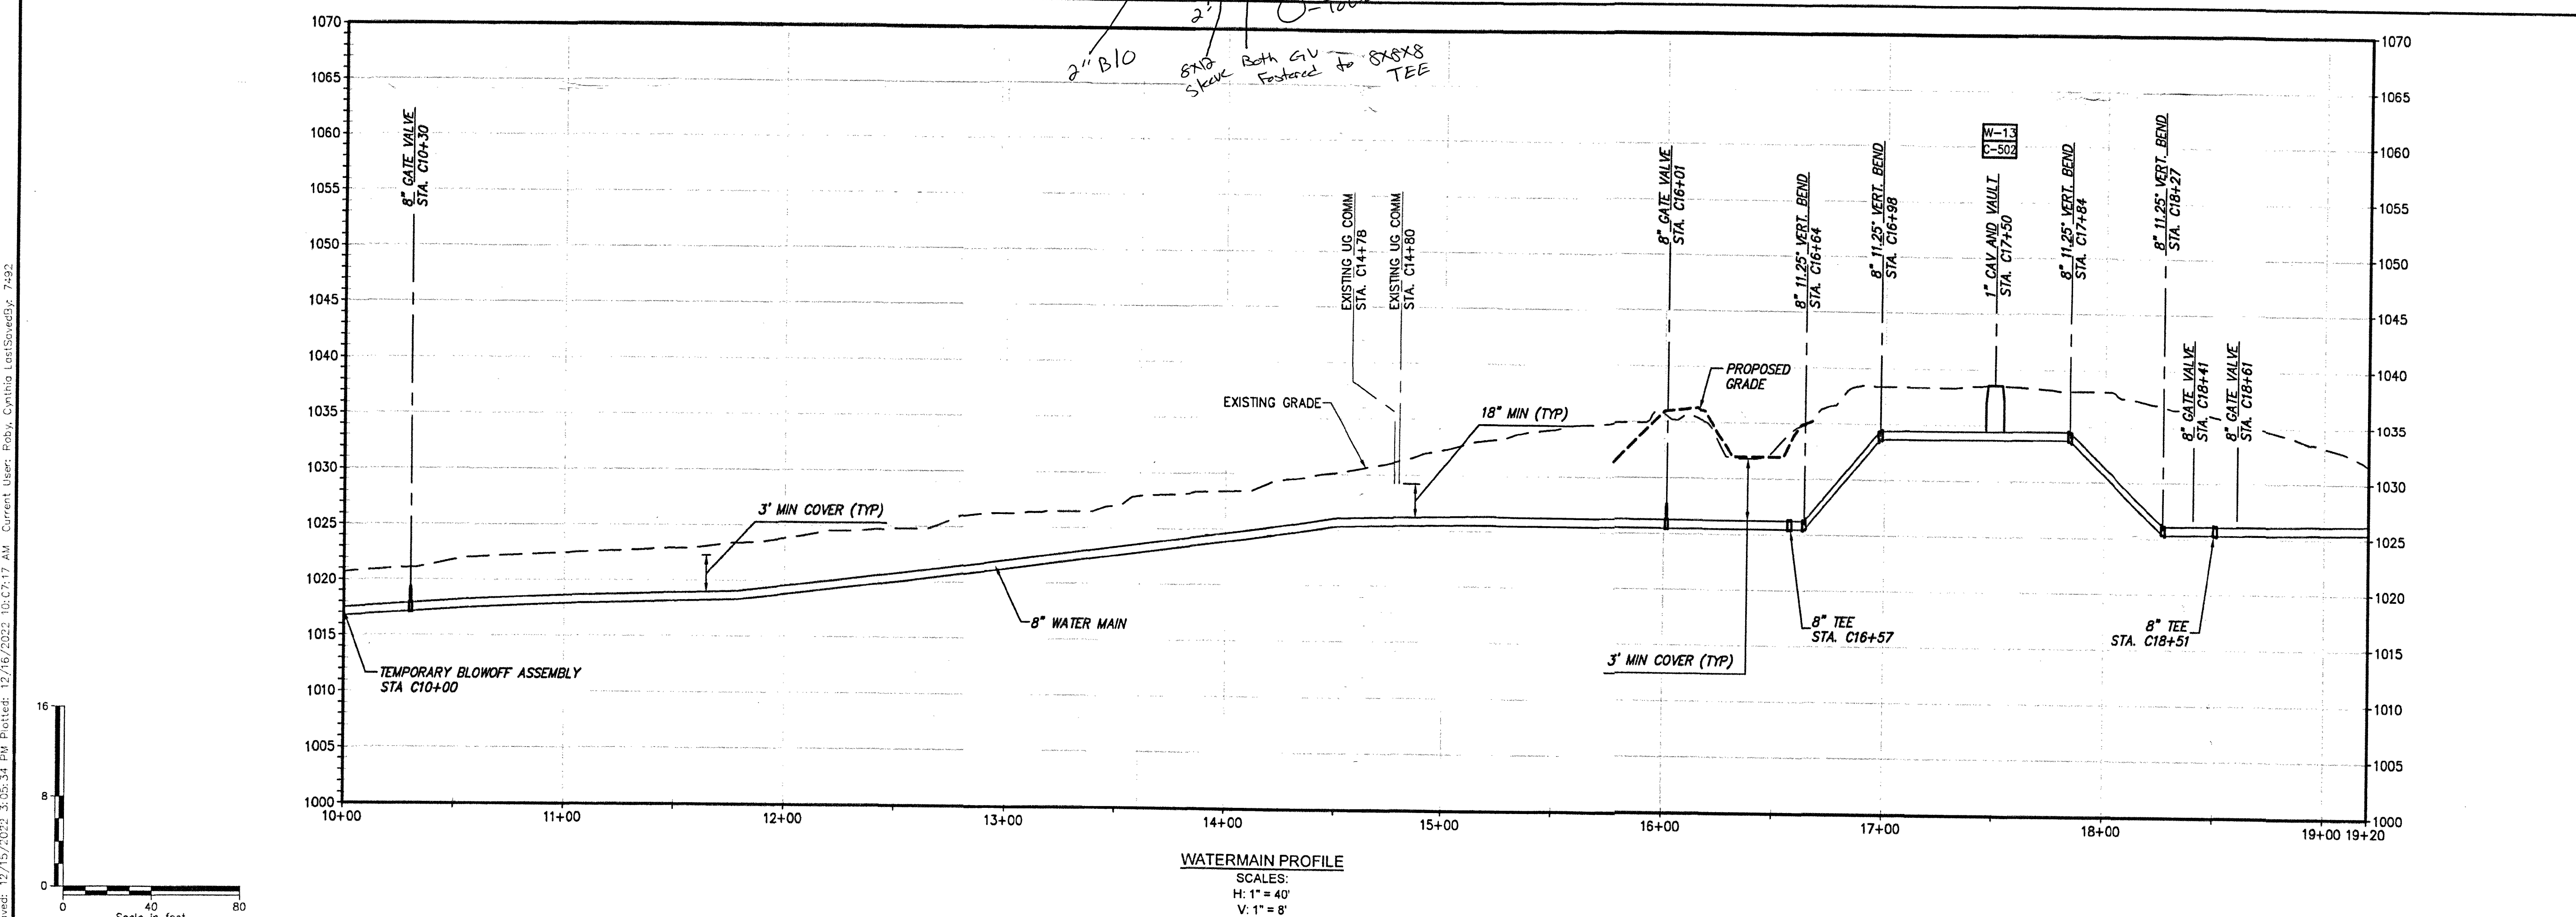

No.	Submittal / Revision	App'd. By	Date
1	BID ISSUE	ETA	12/15/22

WATERMAIN PLAN
AND PROFILE

Designed By: CDR	Drawn By: CDR	Checked By: ETA
Issue Date: 12/15/22	Project No: 073612	Scale: AS NOTED