


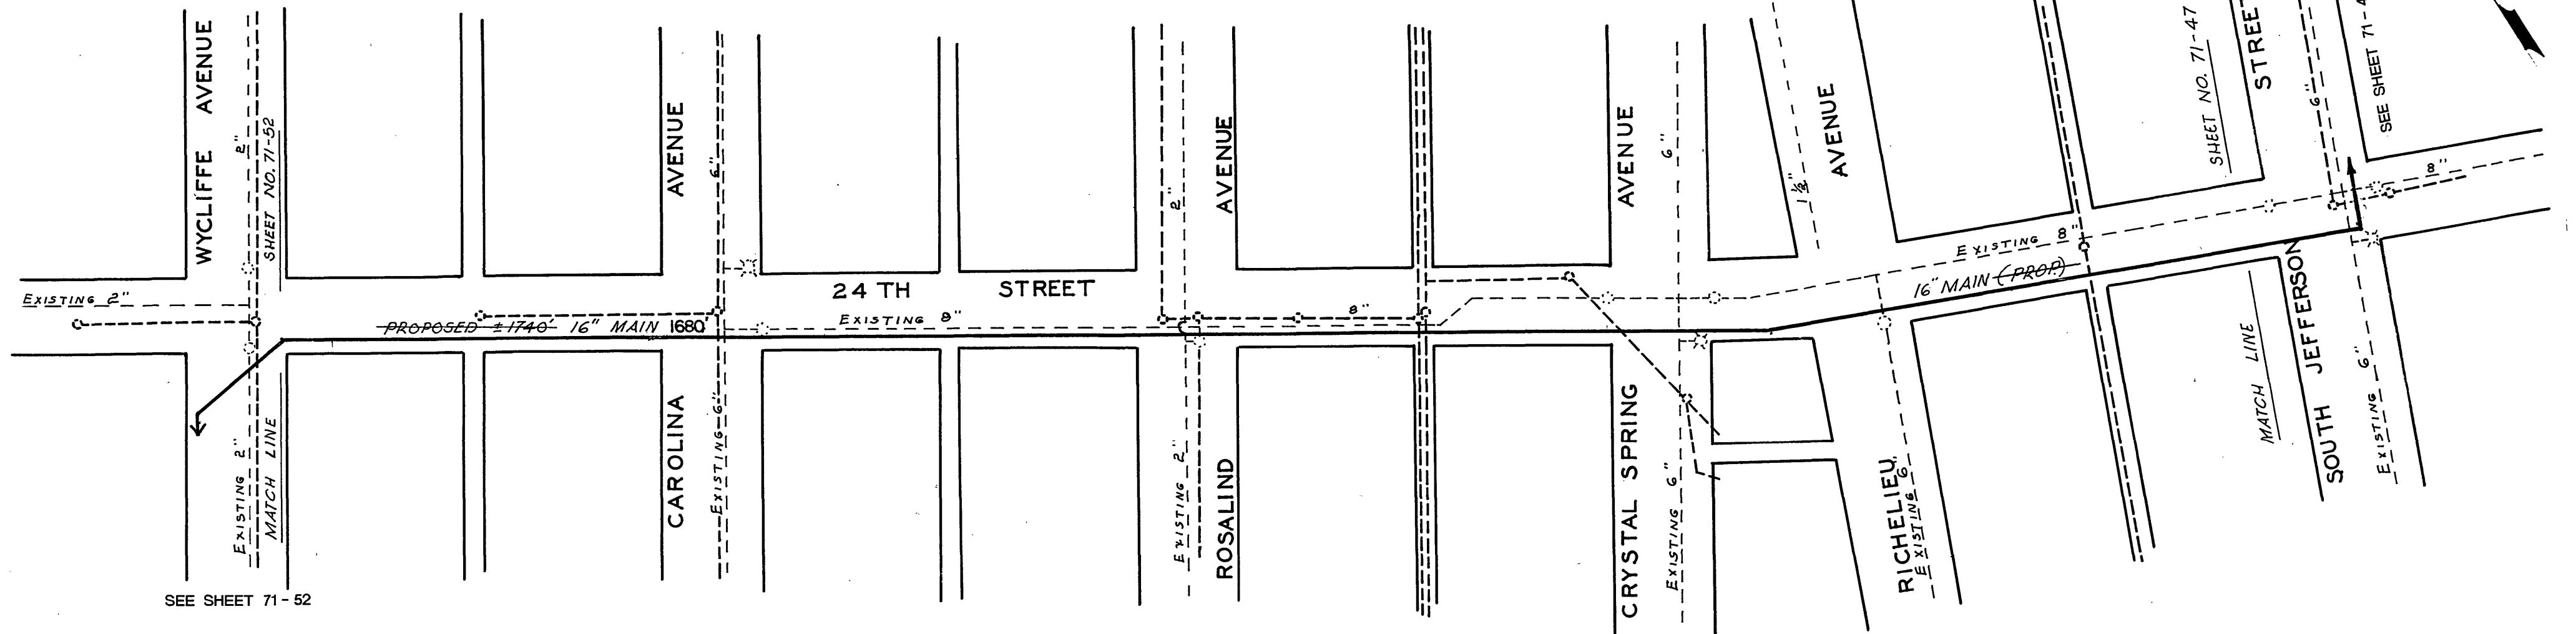

NOTE:

EXISTING UTILITIES TO BE LOCATED
PRIOR TO CONSTRUCTION.

DATE STARTED	10-9-78			
DATE COMP.	4-26-79			
FEET MAIN	SIZE	VALVE	VAULT	BOX
1680'	16"			
F. H. COMP.	0			
F. H. STUB ONLY	0			
SERV. INS. BY:				
MAIN INS. BY:	U.L.F.			
NO. 3/4" SERV. INS.				
CITY OR CO.	CITY			
DEPT. INSP.	J.W.M., U.L.F.			

16" MAIN - SOUTHWEST TRUNK LINE

WATER DEPARTMENT
CITY OF ROANOKE VA.

24TH STREET S.W.
DRAWN BY E.L.A. DECEMBER, 8, 1971
SCALE - 1" = 100'

Art B. Li
DIRECTOR OF UTILITIES & OPERATIONS

William G. Kelly
AGENT FOR ROANOKE PLANNING COMM.

Thomas F. Brady
CITY ENGINEER OF ROANOKE VA.

J. Davis
DIRECTOR OF PUBLIC WORKS

August 2, 1978
DATE

Aug. 2, 1978
DATE

8-2-78
DATE

8-3-78
DATE