



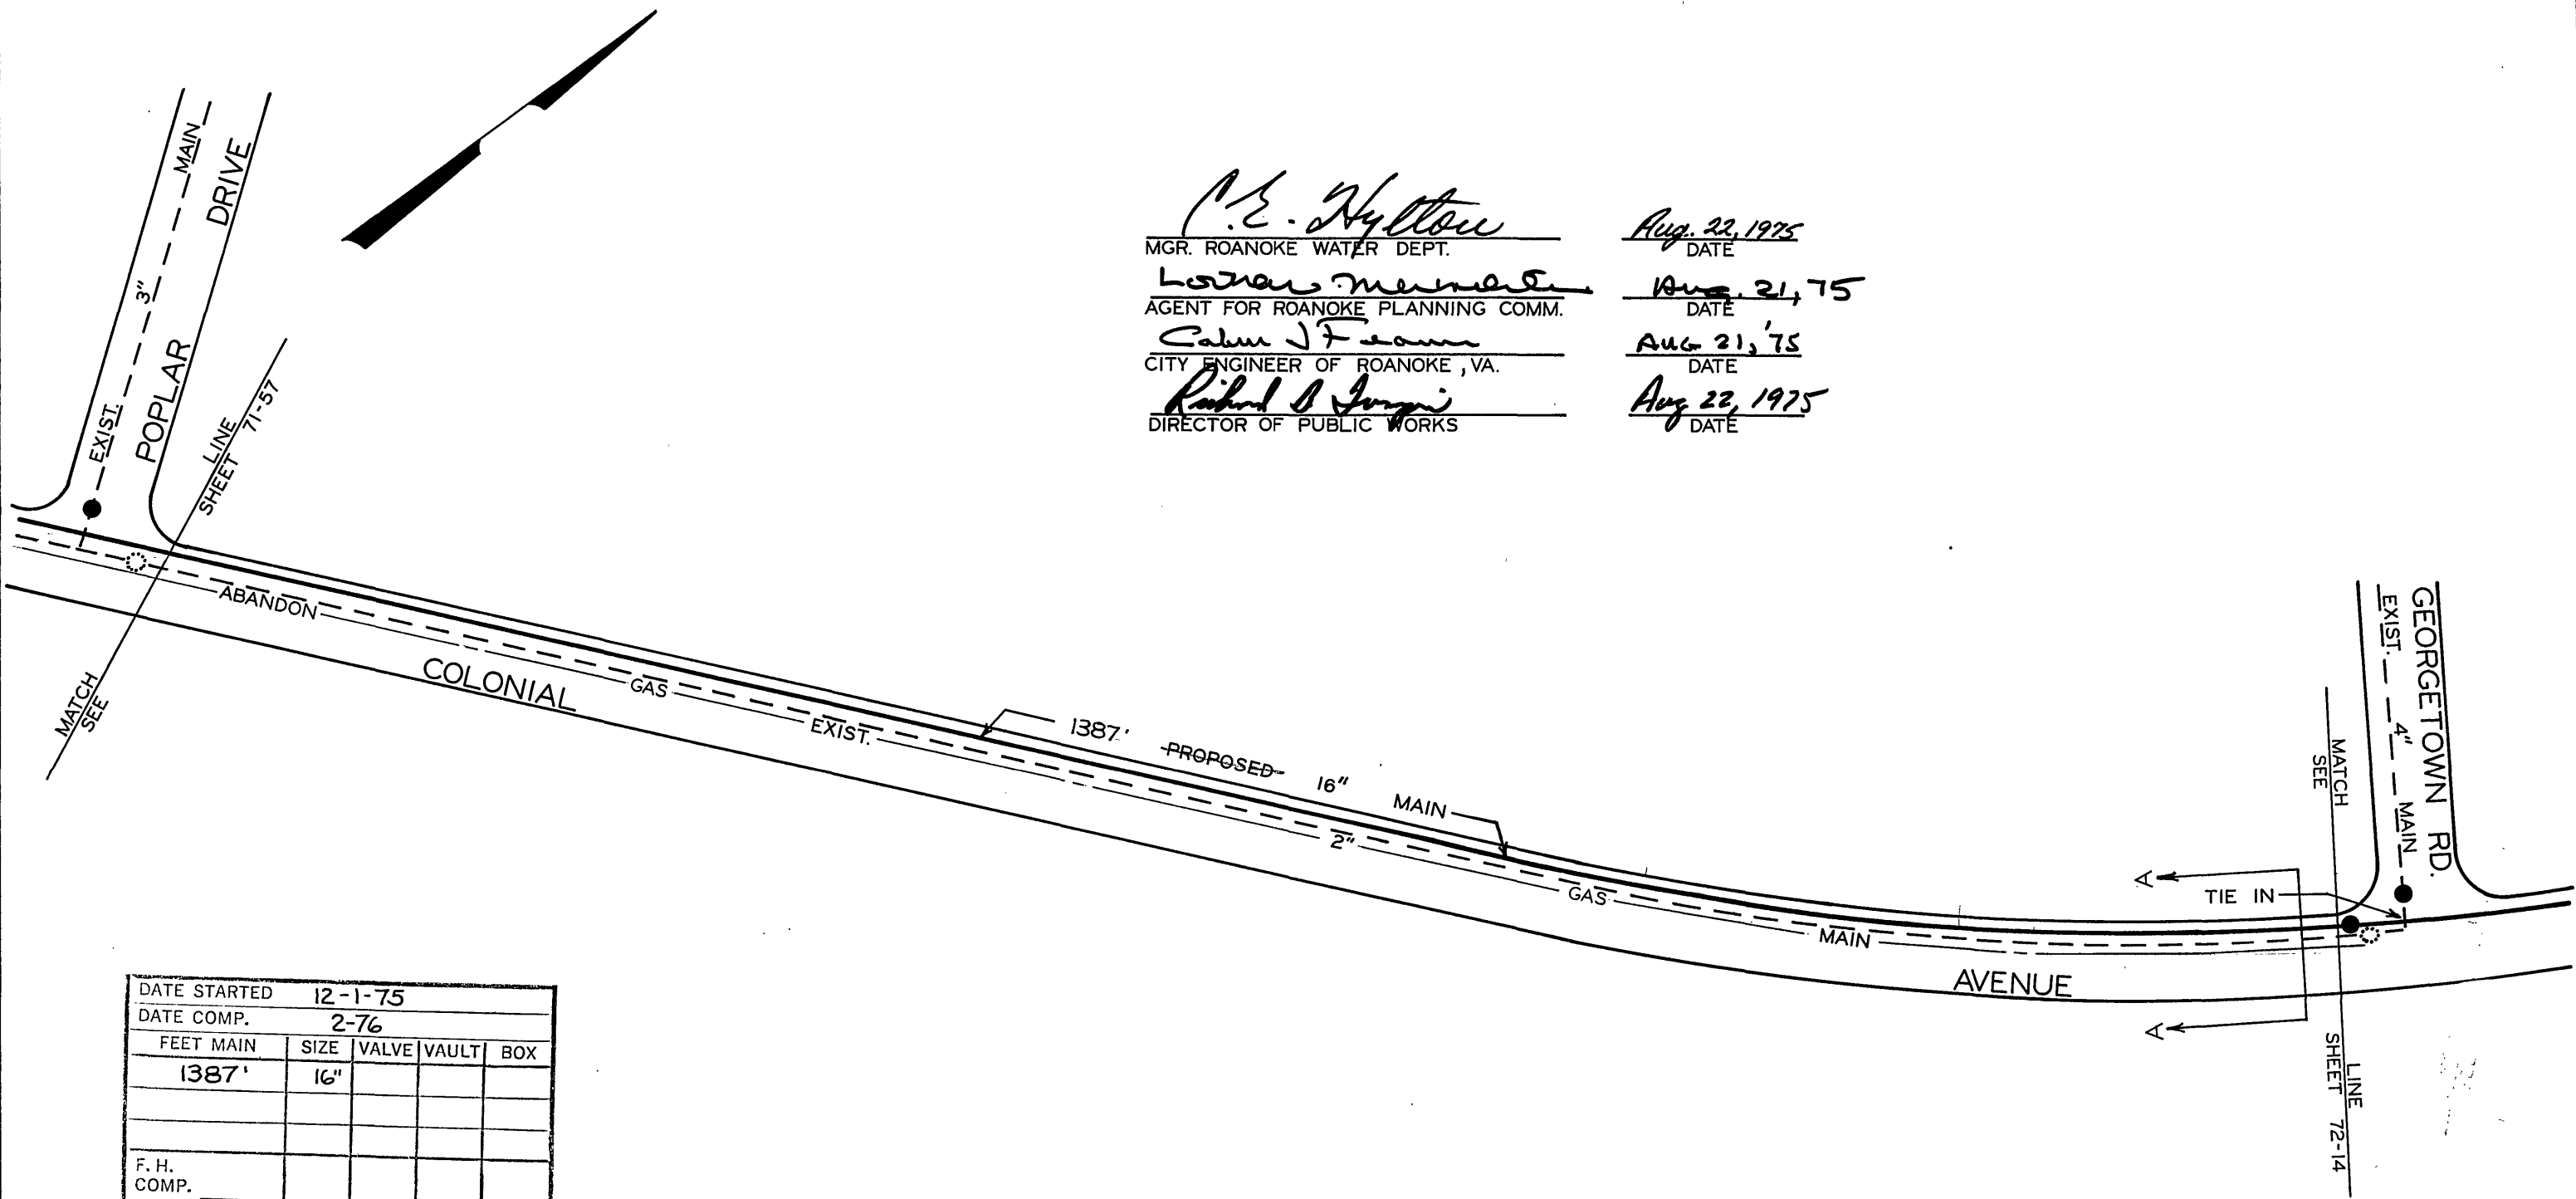

P.E. Hyatt
 MGR. ROANOKE WATER DEPT.
L. M. Mendenhall
 AGENT FOR ROANOKE PLANNING COMM.
Calvin J. Freeman
 CITY ENGINEER OF ROANOKE, VA.
Richard B. Long
 DIRECTOR OF PUBLIC WORKS

Aug. 22, 1975
 DATE
Aug. 21, 75
 DATE
Aug. 21, 75
 DATE
Aug. 22, 1975
 DATE

DATE STARTED		12-1-75			
DATE COMP.		2-76			
FEET MAIN	SIZE	VALVE	VAULT	BOX	
1387'	16"				
F. H. COMP. _____					
F. H. STUB ONLY _____					
SERV. INS. BY:					
MAIN INS. BY:		U.L.F.			
NO. ¾" SERV. INS.					
CITY OR CO.					
DEPT. INSP.					
J. W. M.					



GAS MAIN → ○
 EXIST. WATER MAIN → ○
 3' DEEP
 ← PROP. WATER MAIN

SECTION A - A

16" MAIN - SOUTHWEST TRUNK LINE
 WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 COLONIAL AVENUE S.W.
 SCALE - 1"=100'
 DRAWN BY C.A.H. DEC. 17, 1971