


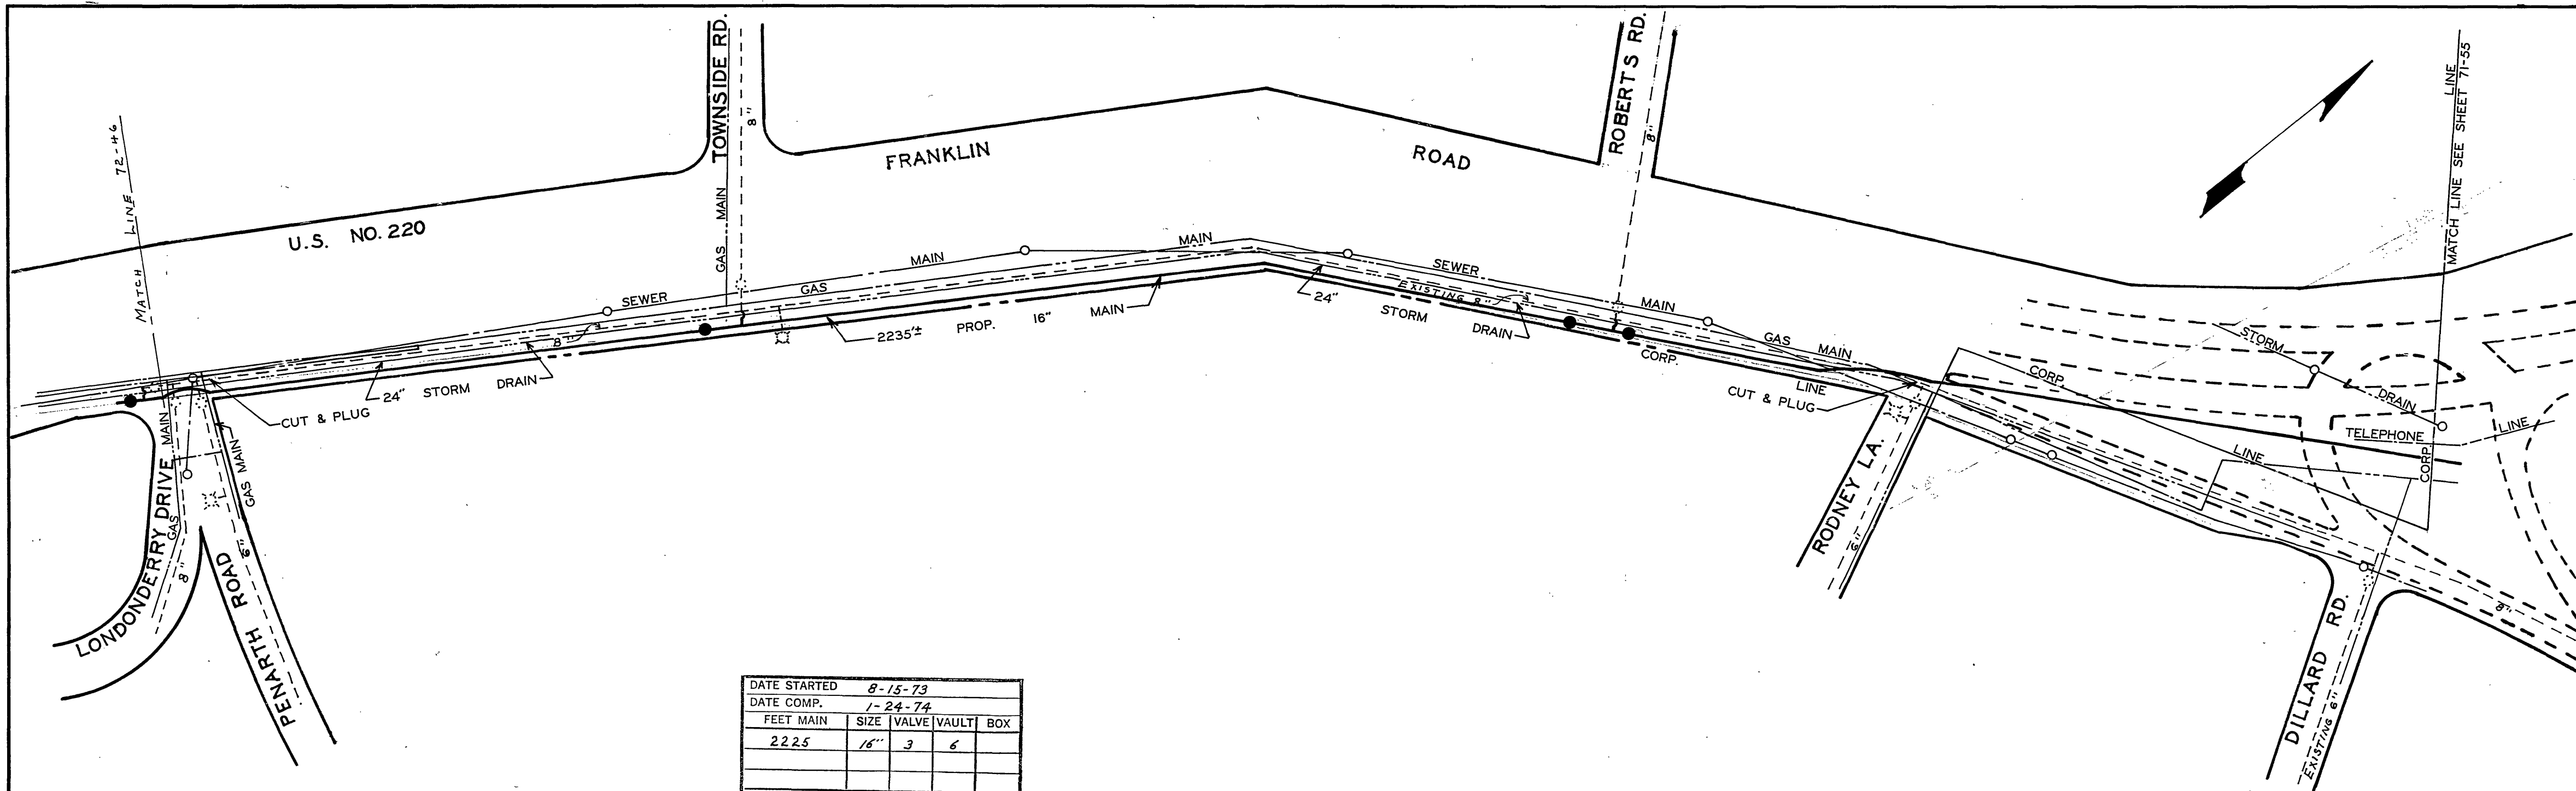

DATE STARTED	8-15-73				
DATE COMP.	1-24-74				
FEET MAIN	SIZE	VALVE	VAULT	BOX	
2225	16"	3	6		
F.H. COMP.	1	6"	1	1	
F.H. STUB ONLY					
SERV. INS. BY:					
MAIN INS. BY:	R.W.D.				
NO. 3/4" SERV. INS.					
CITY OR CO.					
DEPT. INSP.	J.W. MAXEY				

Leif R. Kim
 MGR. ROANOKE WATER DEPT.
Lorran Merand
 AGENT FOR ROANOKE PLANNING COMM.
Charles Martell
 CITY ENGINEER OF ROANOKE VA.
James H. Brown
 DIRECTOR OF PUBLIC WORKS

9/26/72
 DATE
 9/26/72
 DATE
 9/29/72
 DATE
 9/26/72
 DATE

16" MAIN - SOUTHWEST TRUNK LINE

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 FRANKLIN ROAD S.W.
 SCALE-1"=100"

DRAWN BY E.L.A. DEC. 17, 1971