


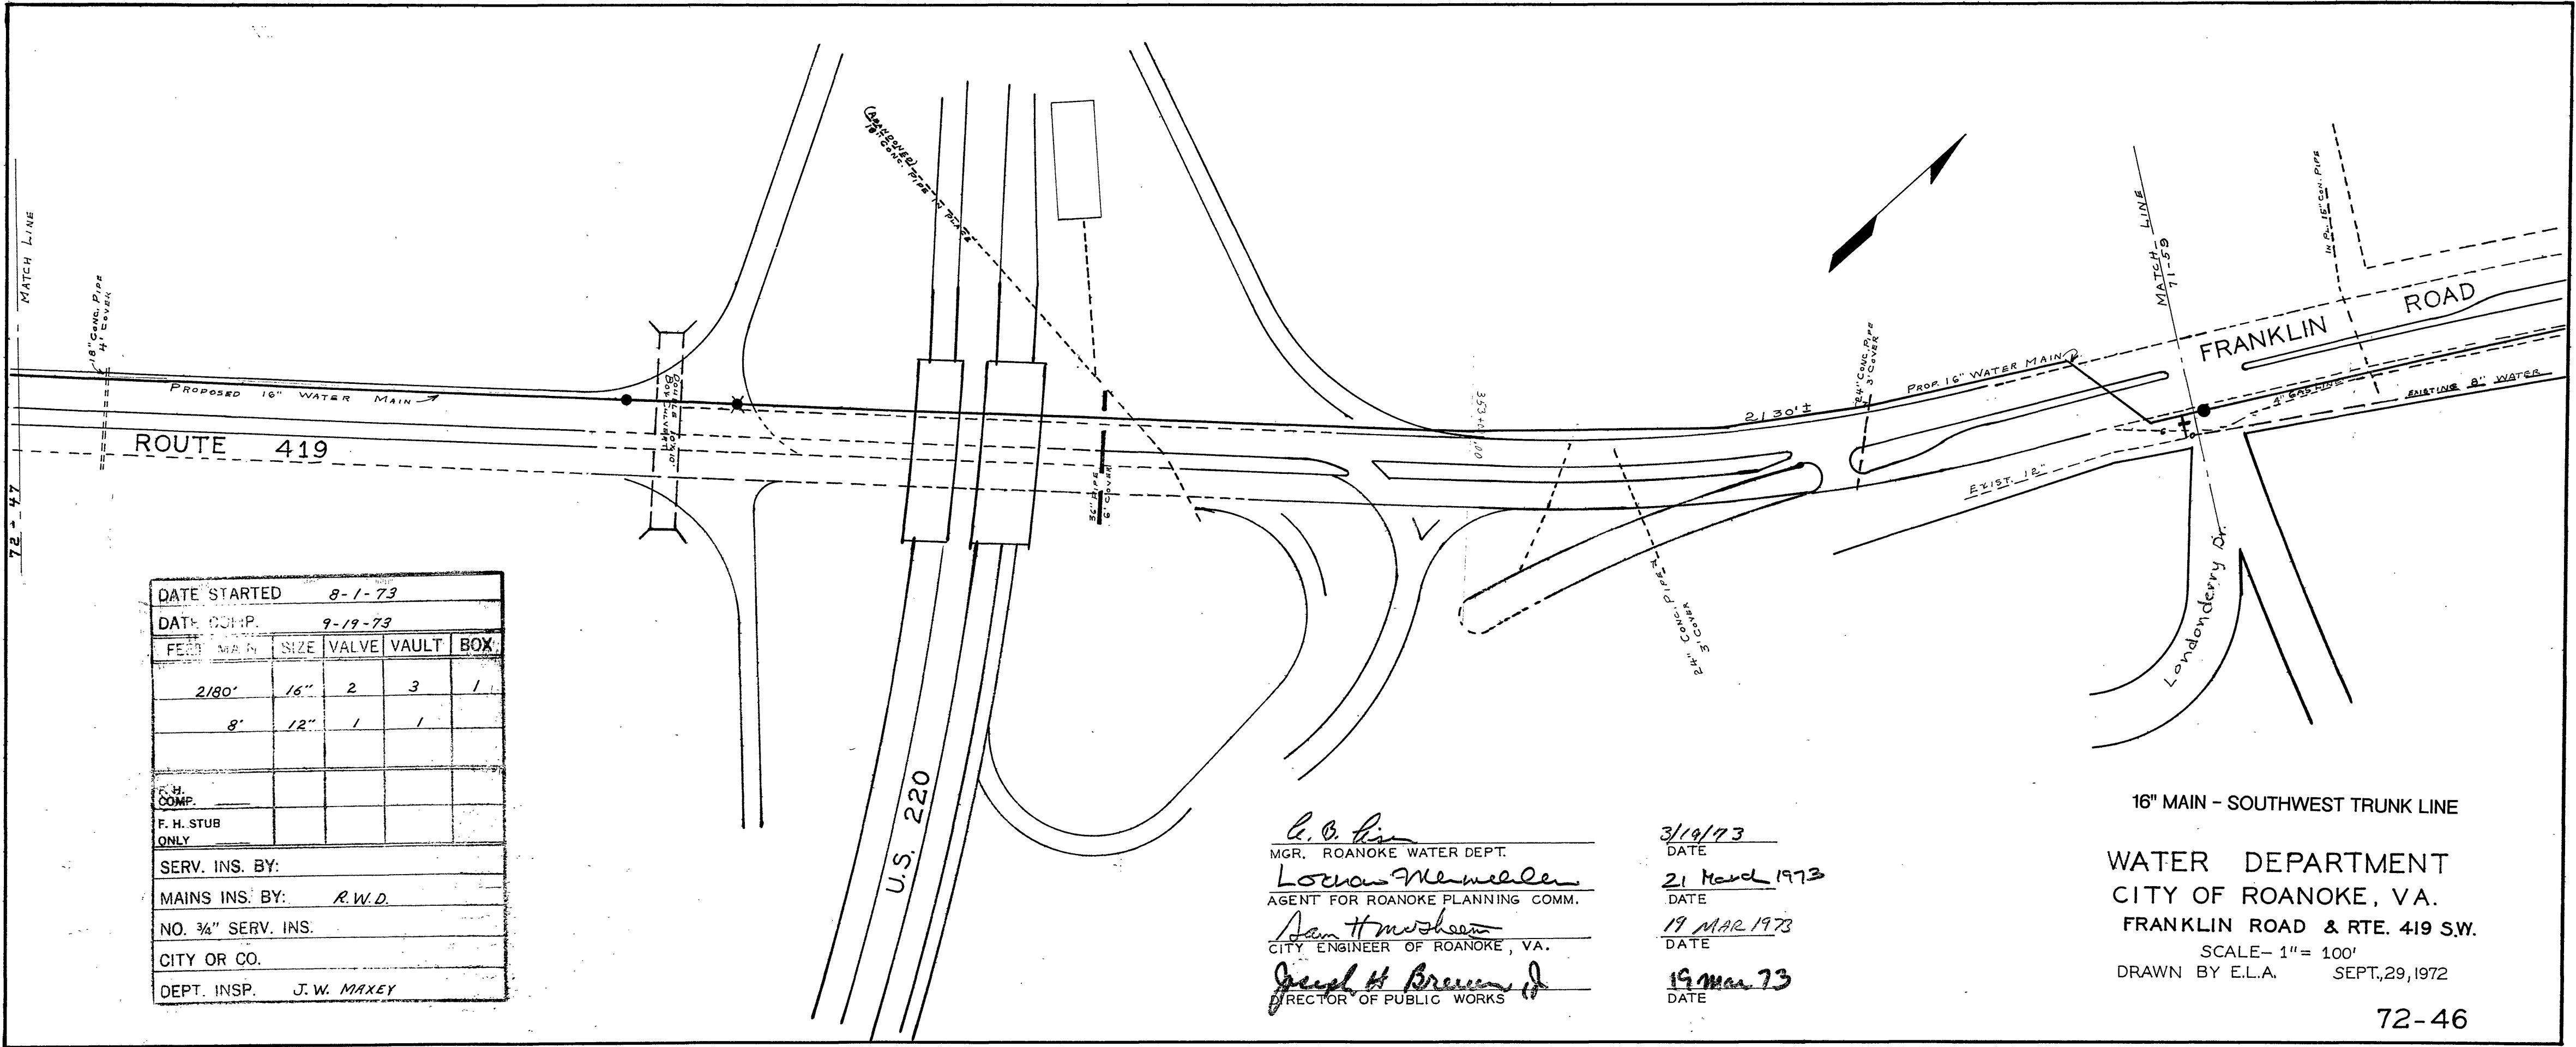

DATE STARTED						8-1-73	
DATE COMP.						9-19-73	
FEET MAIN		SIZE	VALVE	VAULT	BOX		
2180'		16"	2	3	1		
8'		12"	1	1			
F. H. COMP.							
F. H. STUB ONLY							
SERV. INS. BY:							
MAINS INS. BY: R.W.D.							
NO. 3/4" SERV. INS.							
CITY OR CO.							
DEPT. INSP. J. W. MAXEY							

G. B. Kim
MGR. ROANOKE WATER DEPT.
Lochan M. McMillen
AGENT FOR ROANOKE PLANNING COMM.
Sam H. McSheen
CITY ENGINEER OF ROANOKE, VA.
Joseph H. Breun
DIRECTOR OF PUBLIC WORKS

3/19/73
DATE
21 March 1973
DATE
19 MAR 1973
DATE
19 Mar 73
DATE

16" MAIN - SOUTHWEST TRUNK LINE
WATER DEPARTMENT
CITY OF ROANOKE, VA.
FRANKLIN ROAD & RTE. 419 S.W.
SCALE- 1"= 100'
DRAWN BY E.L.A. SEPT,29,1972