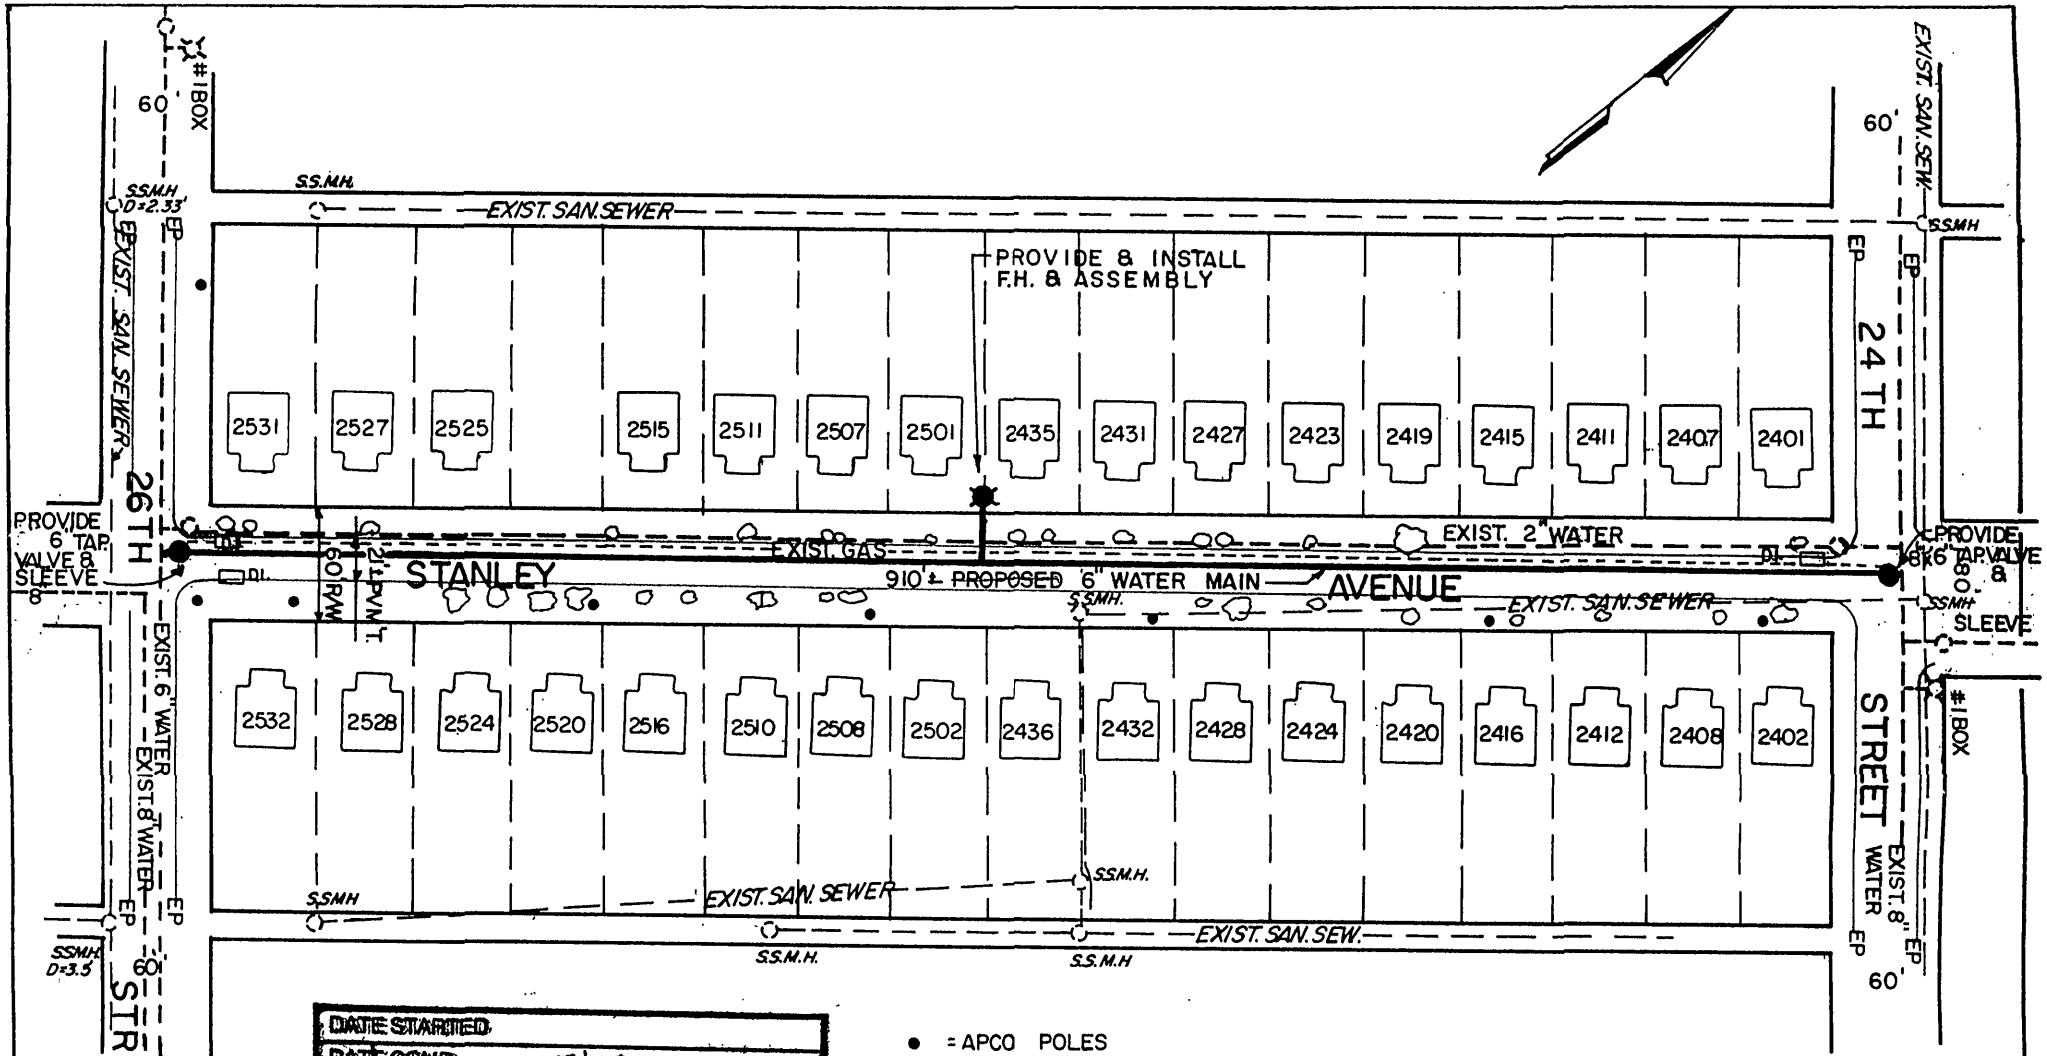

DATE STARTED				
DATE COMP.	5/98			
FEET MAIN	SIZE	VALVE	VAULT	BOX
910'±	6"	2	2	#2
F.H. COMP. 1				
F.H. STUB ONLY:				
SERV. INS. BY:				
MAIN INS. BY: U.L.S- Calvin O. Dame				
NO. ¾" SERV. INS.				
CITY OR CO. City				
DEPT. INSP. U.L.S.				

● = APCO POLES

= TREES-VARIOUS SIZES IN UTILITY STRIPS

D.I. = DROP INLET

NOTES:

- ALL UTILITIES SHALL BE ASCERTAINED IN FIELD PRIOR TO CONSTRUCTION.
- EXIST. 2" MAIN SHALL BE ABANDONED AFTER ALL SERVICES TIED OVER TO NEW 6" MAIN. (33 SERVICES)

Samuel Hazo, III

MANAGER UTILITY LINE SERVICES

WATER DEPARTMENT

ROANOKE VIRGINIA

STANLEY AVENUE, S.E.

2400, 2500 BLOCK

SCALE: 1" = 100'	
DATE: 11/3/98	DIRECTOR UTILITIES & OPERATIONS DATE
DIST. MAP: 408	
PLAN NO.: 98-08	DIRECTOR OF PUBLIC WORKS DATE