



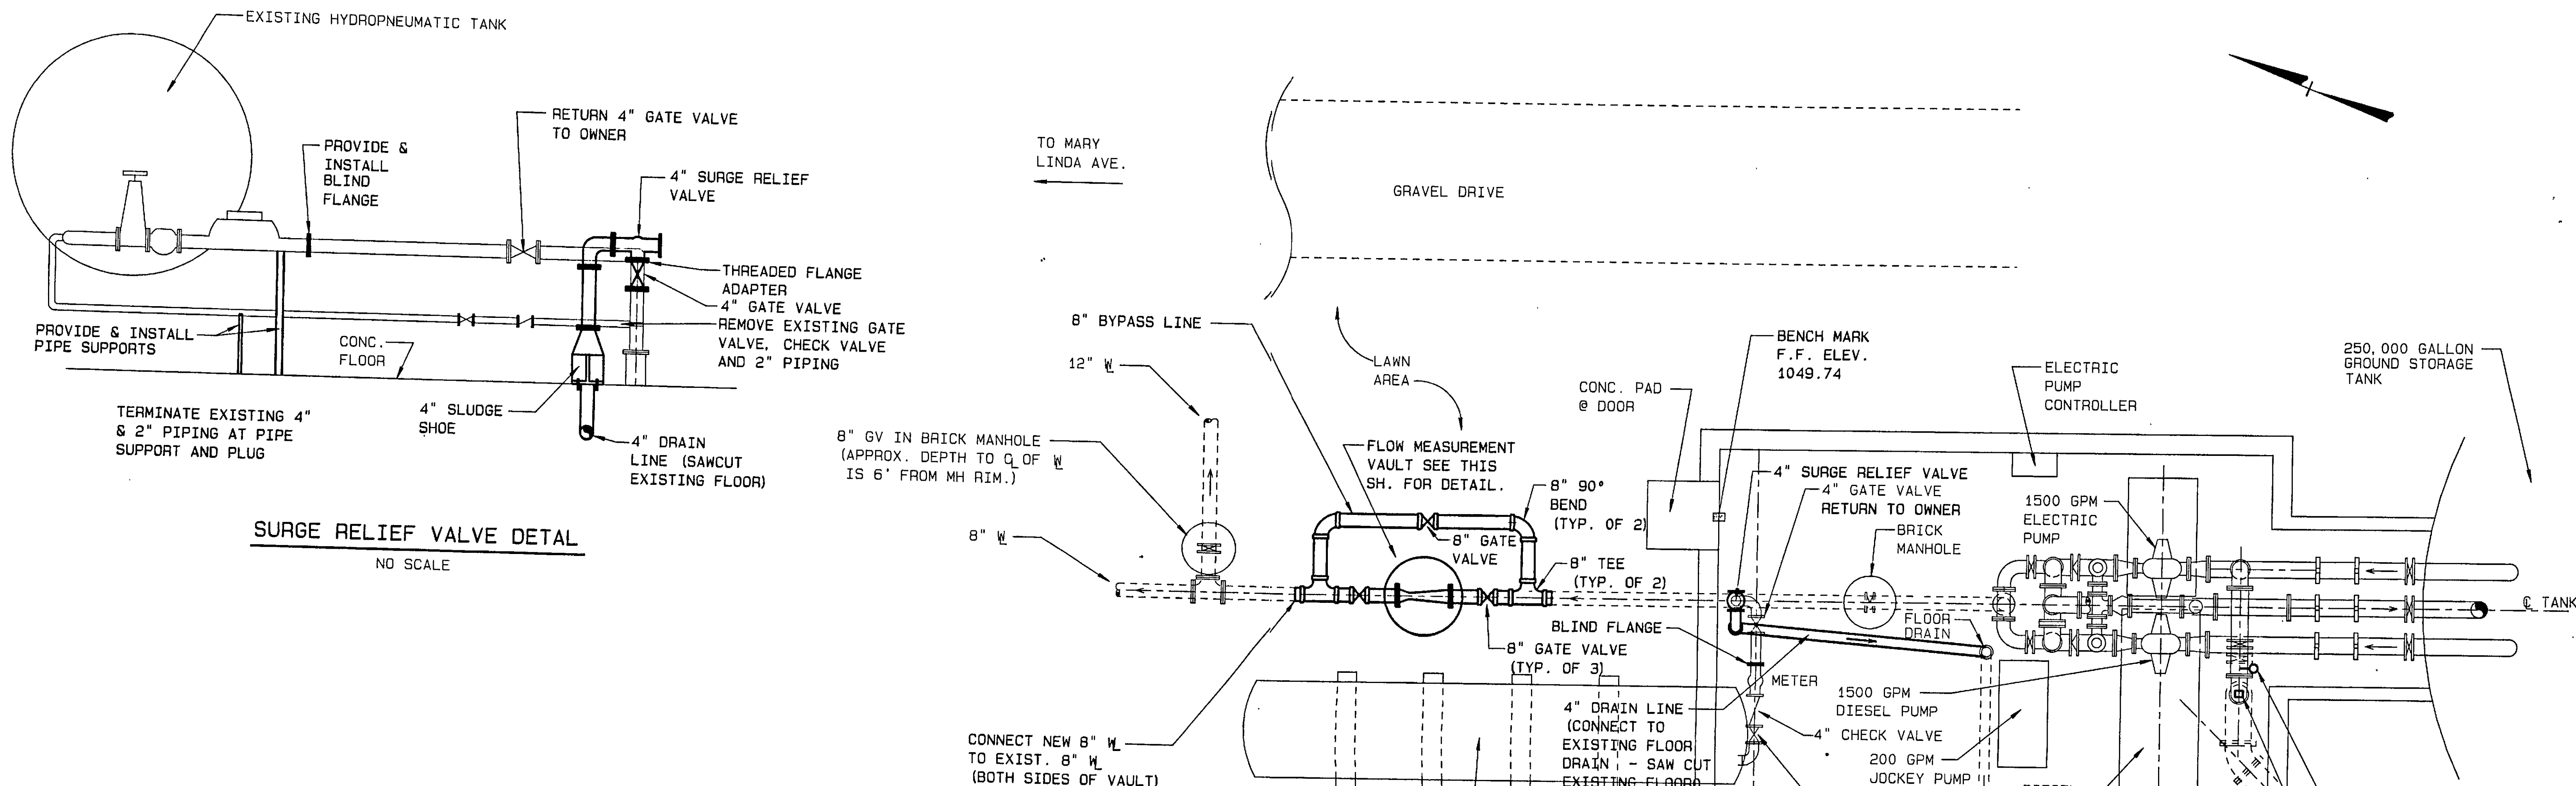

SURGE RELIEF VALVE DETAIL
NO SCALE

NOTE:
CONTRACTOR TO VERIFY ACTUAL
DEPTH PRIOR TO INSTALLATION.

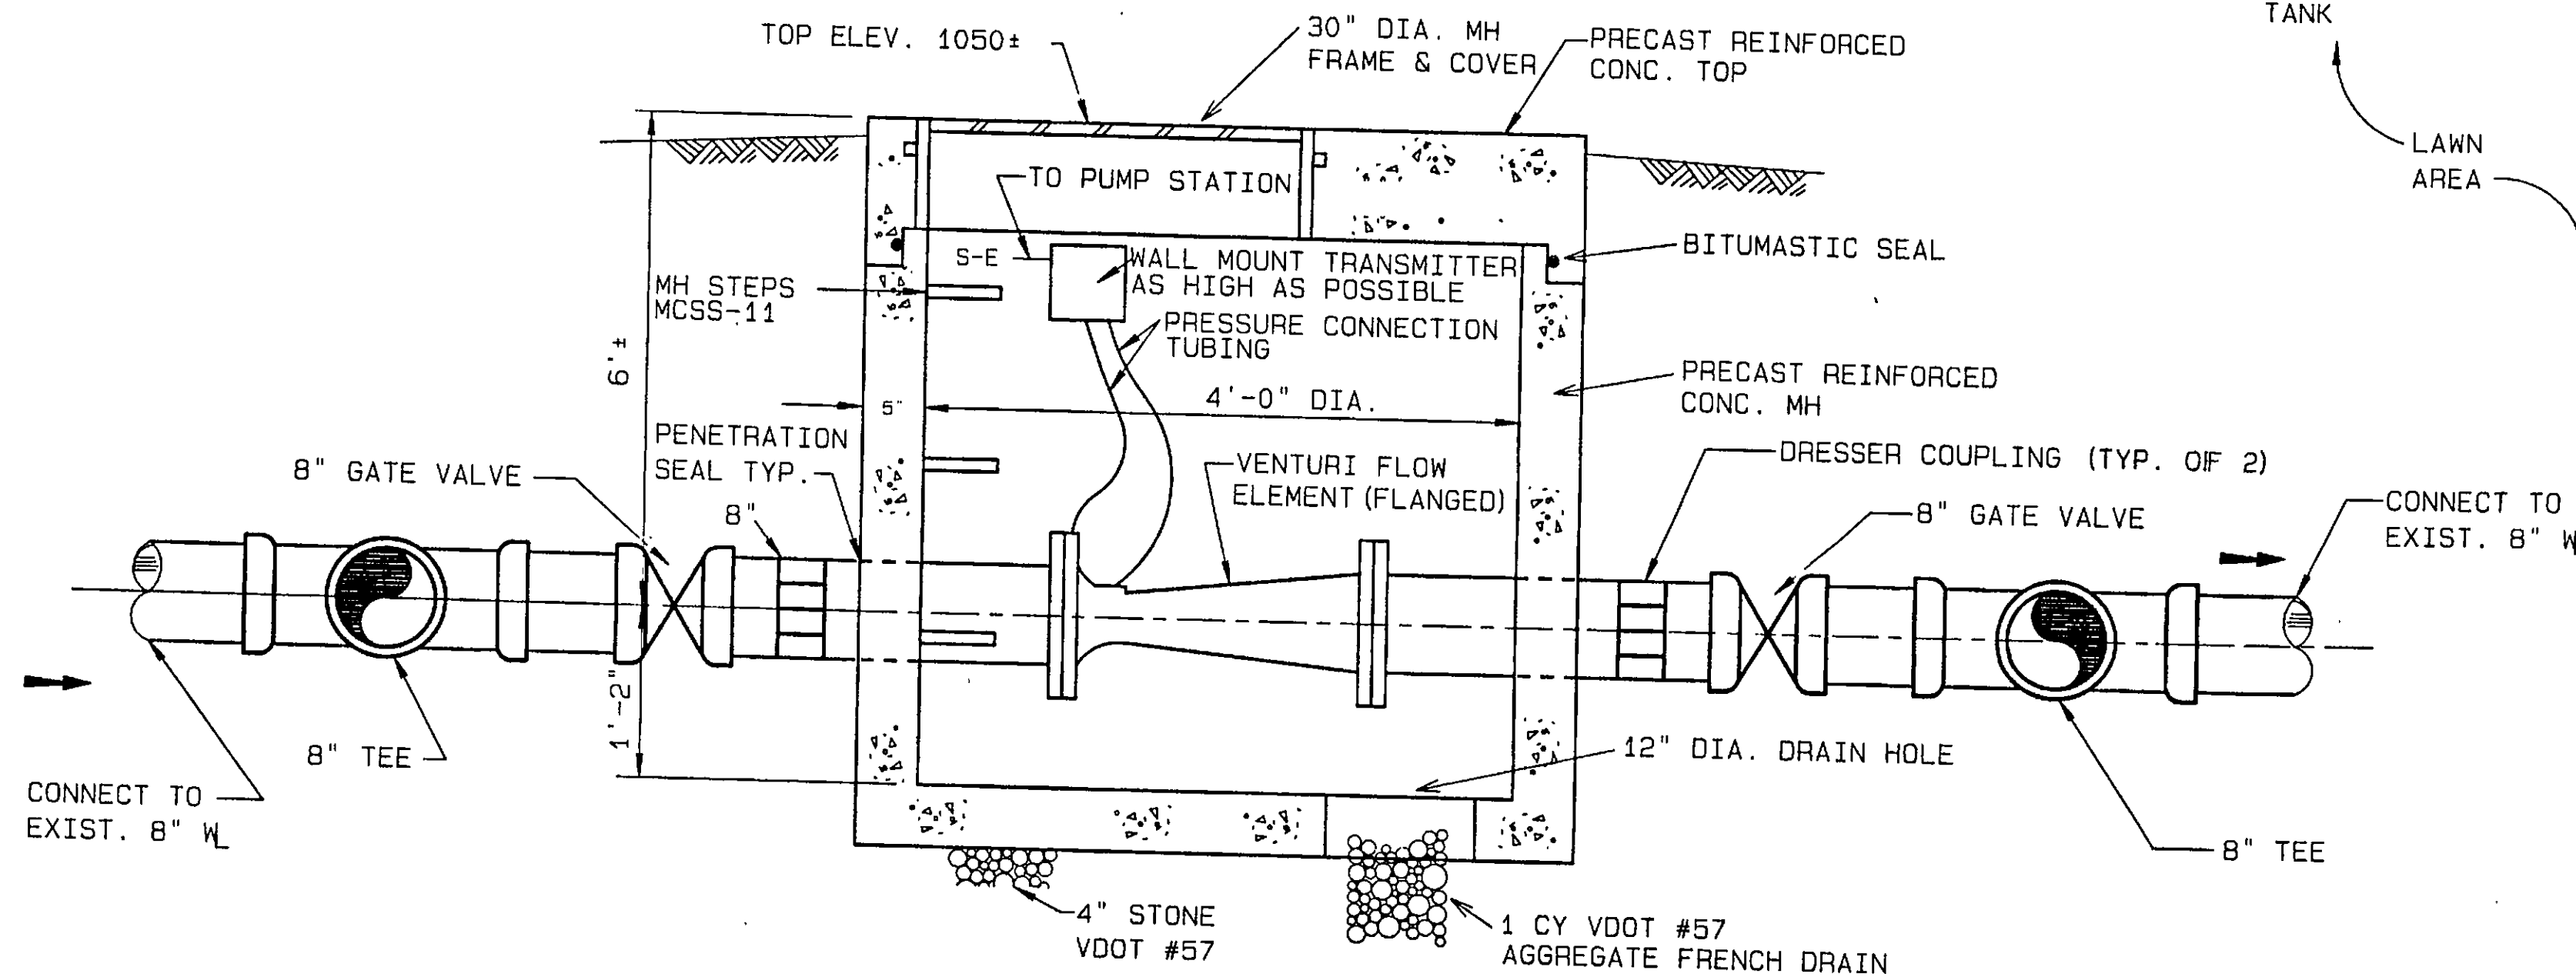


SECTION - FLOW MEASUREMENT VAULT
NO SCALE

**STATESMAN INDUSTRIAL PARK
EXISTING PUMP STATION**
SCALE: 1/4" = 1'-0"

- NOTES:
1. CONTRACTOR SHALL NOT BEGIN WORK ON FLOW MEASUREMENT VAULT UNTIL CONTRACT I IS COMPLETE. OWNER WILL NOTIFY CONTRACTOR WHEN CONTRACT I IS COMPLETE.
 2. ALL WORK ON THIS SHEET IS CONTRACT II.
 3. FOR 4" DRAIN LINE, CONCRETE FLOOR SHALL BE SAW CUT AND REPAIRED IN ACCORDANCE WITH SECTION 03300 OF SPECIFICATIONS.

DESIGNED:
Mattern & Craig
CONSULTING ENGINEERS - SURVEYORS

BCC
DRAWN:
SMM
CHECKED:
SWH

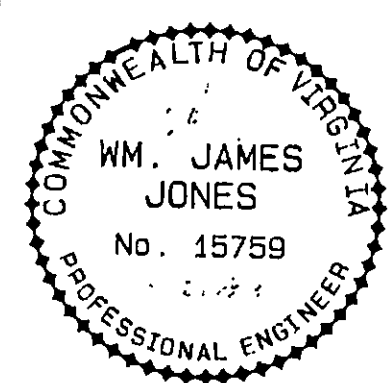

REVISION	DATE	DESCRIPTION	BY	APP

DATE
**NOVEMBER
1993**
COMM.
1165G

**ROANOKE CENTRE FOR INDUSTRY & TECHNOLOGY
WATER TANK - CONTRACT II**
CITY OF ROANOKE,
VIRGINIA
PUMP STATION

SHEET
8