



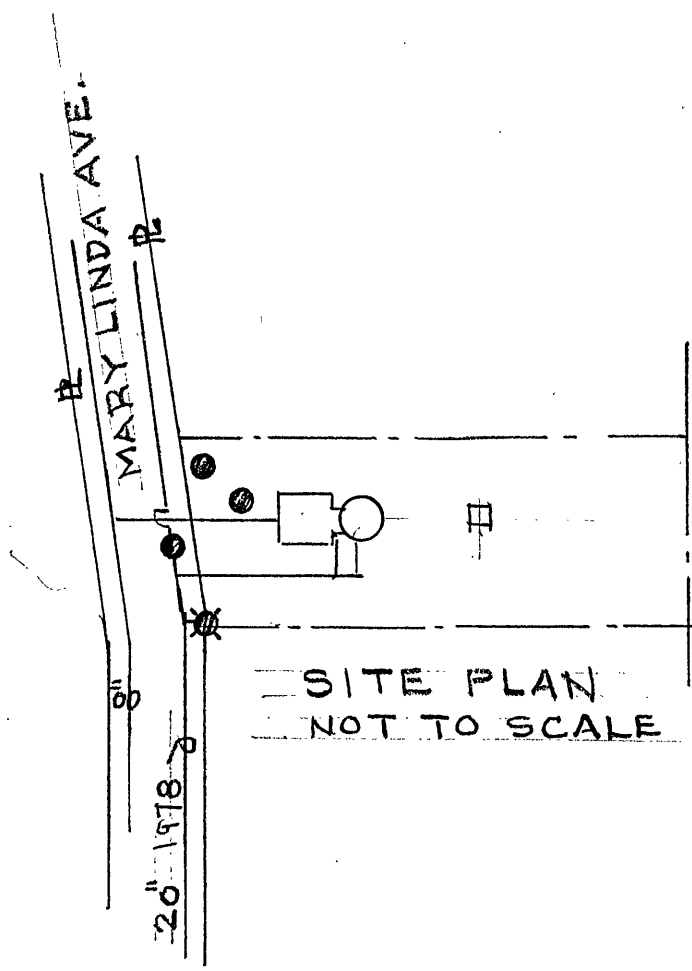


GENERAL NOTES:
 1. NEW AREAS SHALL BE SEED AS FOLLOWS:
 DISC NEW FILL, ADD 140 LBS. LIME PER 1000 SQ. FT.; 25 LBS
 5-20-10 FERTILIZER AND RAKE TO MIX; SEED WITH
 MIXTURE OF 5 LBS. K-31 FESCUE AND 1/2 LB. OF ANNUAL
 RYE GRASS - ROLL AND THEN MULCH WITH CLEAN STRAW.


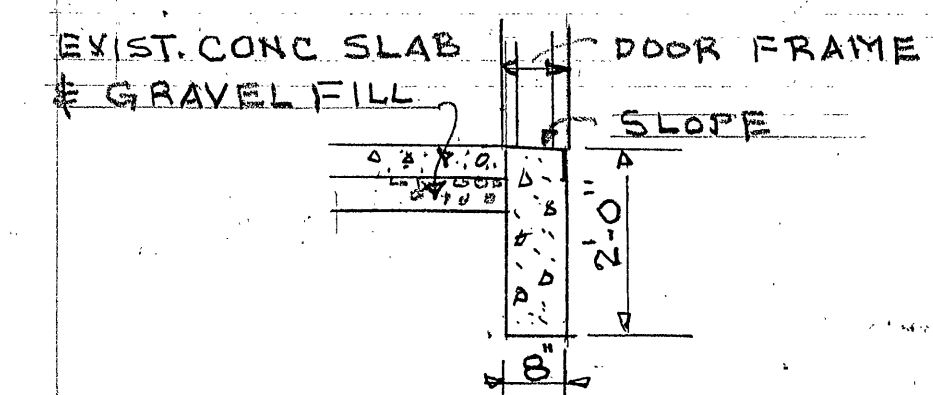


NEW FDN WALL @
 BACK OF PUMP STATION


REMOVE WALL MOUNTED
 GAGE & DISPOSE OF
 PROPERLY (MERCURY)
 6'-9 1/2"

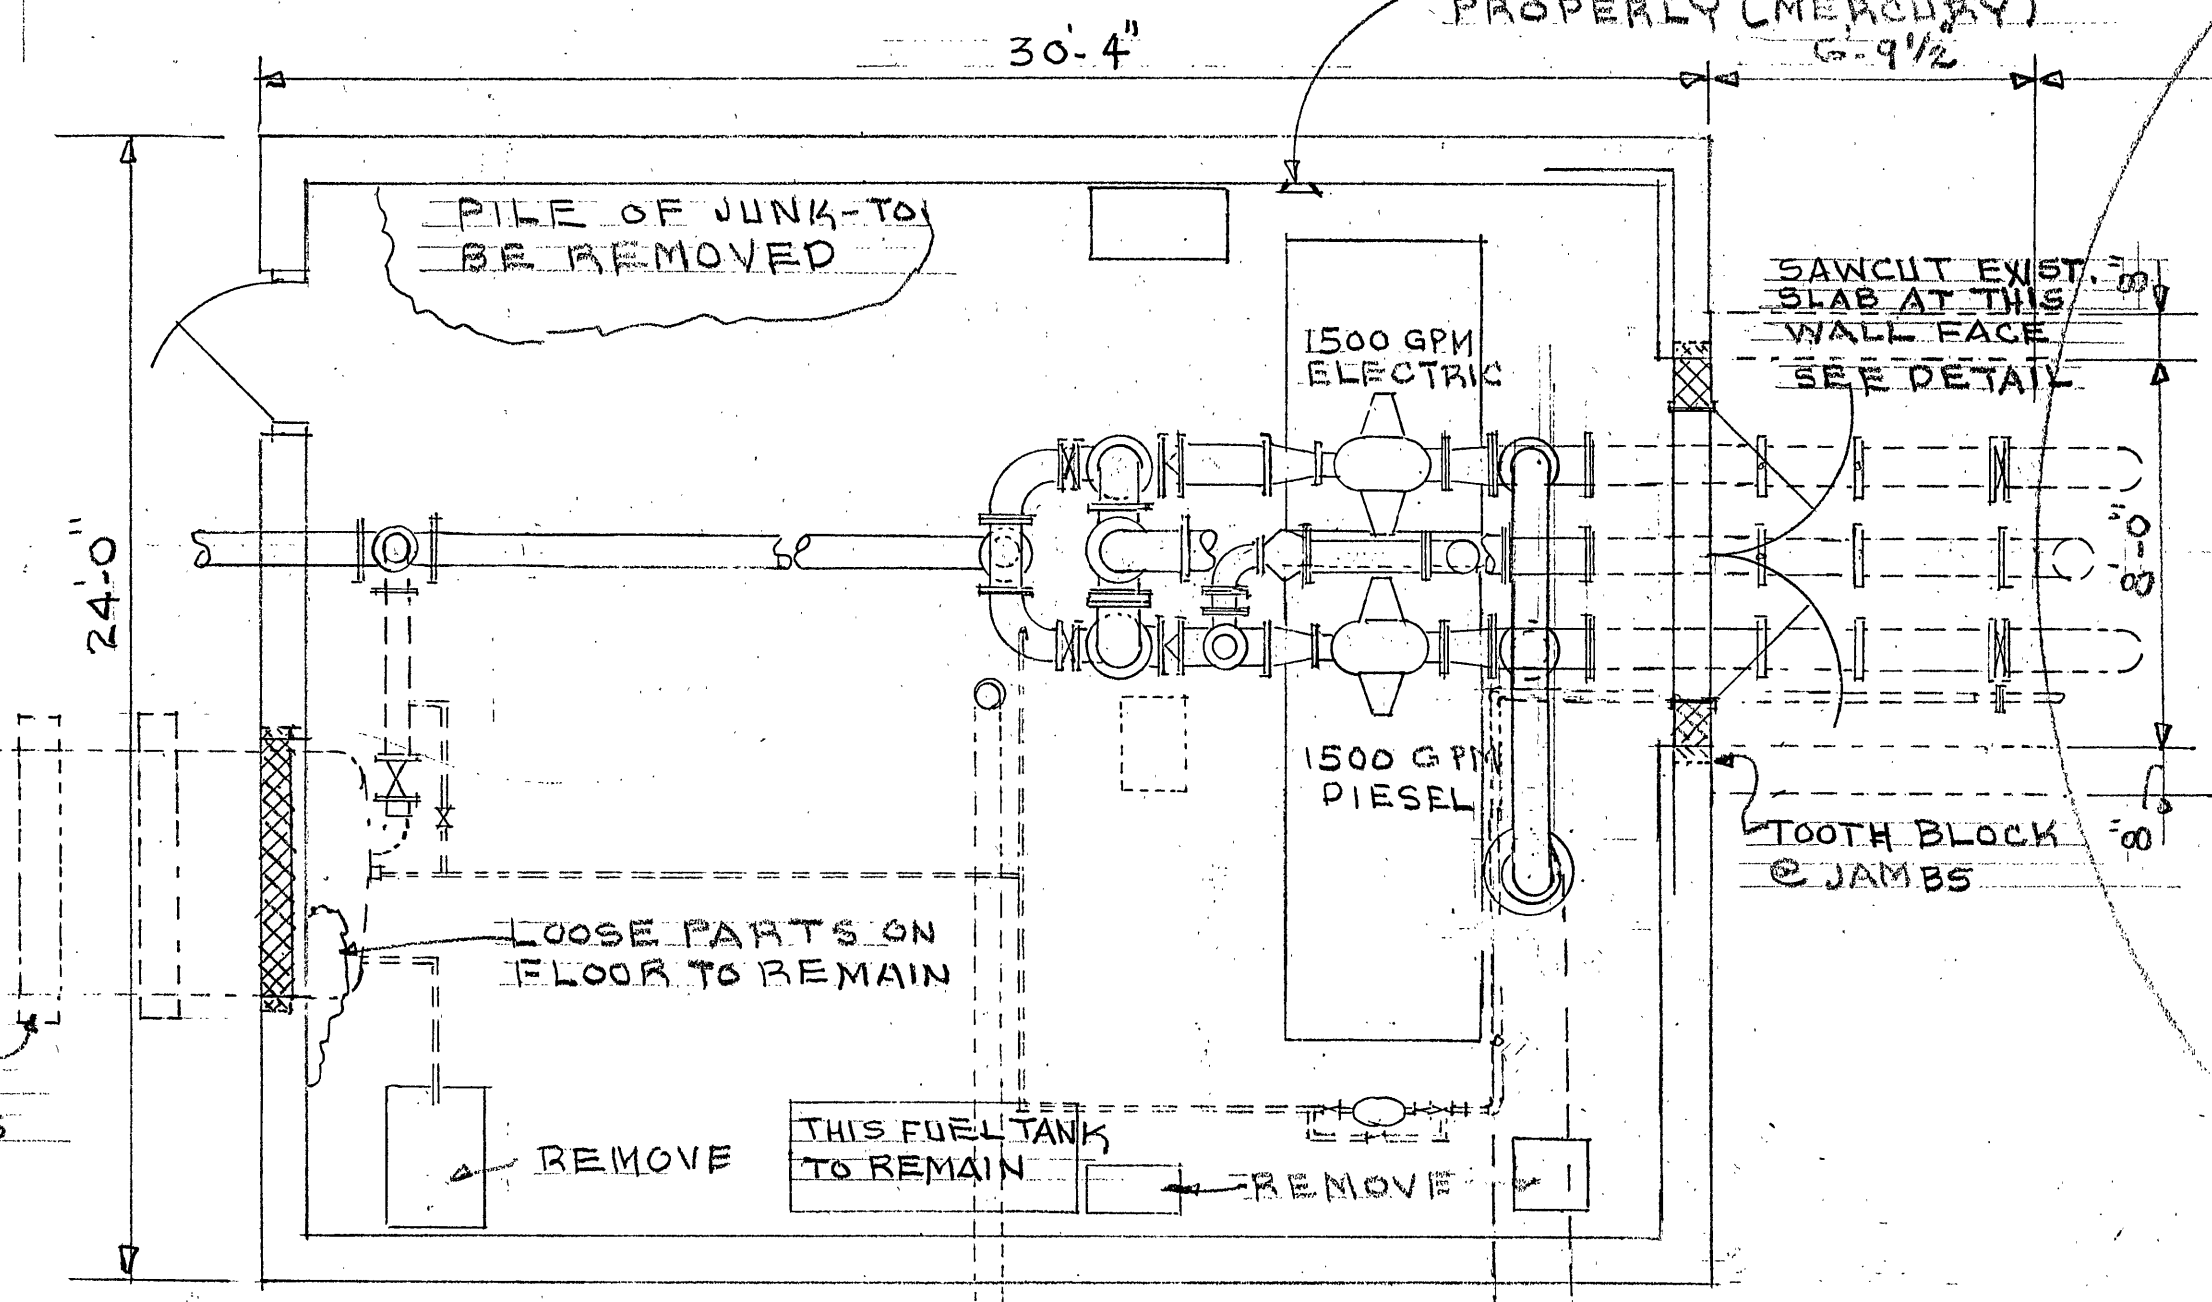

PLAN - PUMP HOUSE AND STORAGE TANK
 SCALE: 1/4" = 1'-0"

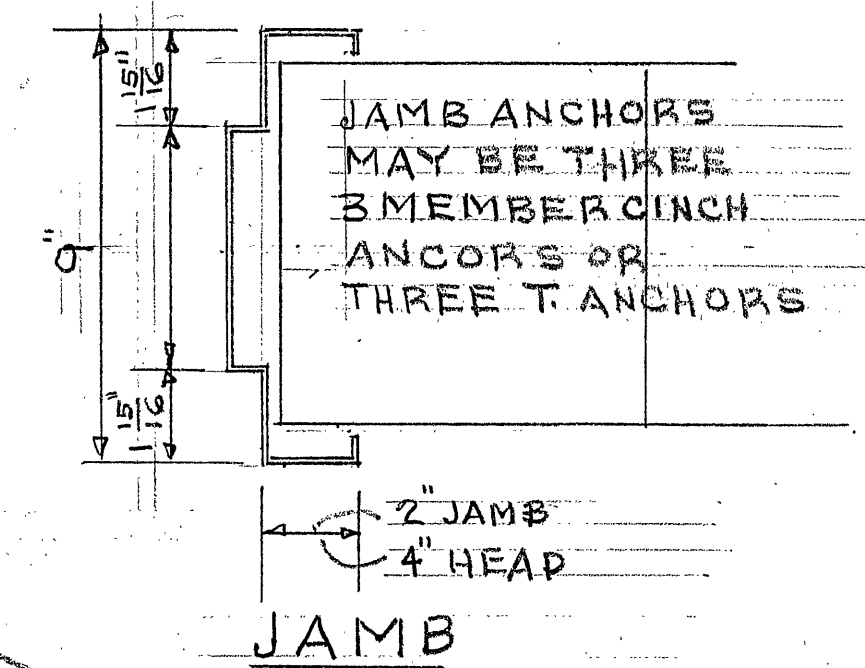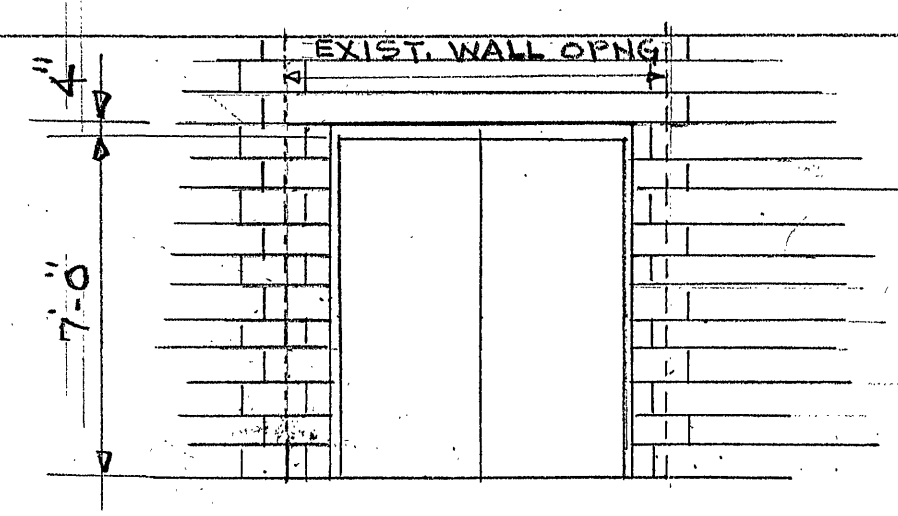

2 LBS - 4' x 3 1/2'
 1 1/4" 7'-0" LG

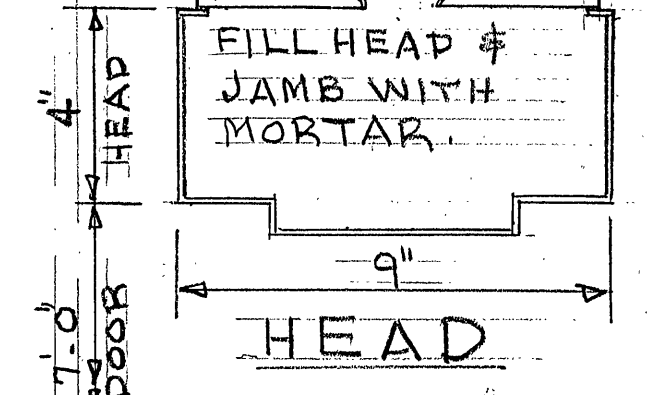


DOOR & JAMB DETAIL
 SCALE: 3/8" = 1'-0"

BLOCK WELL HOUSE

DEMOLISH WELL HOUSE
 & CAP WELL CASING
 IN ACCORDANCE WITH
 VA. DEPT OF HEALTH
 REQUIREMENTS.

TANK TO BE DEMOLISHED AND PROPERLY
 DISPOSED OF. DEMOLISH CONCRETE RING
 AND 10' OF SAND & DISPOSE OF PROPERLY.
 FILL WITH TOPSOIL, CULTIVATE & SEED. USE
 THE FOLLOWING PER 1000 SQ. FT.: 140 LBS.
 LIME; 25 LBS OF 5-20-10 FERTILIZER - 5 LBS K-31
 FESCUE + 1/2 LB ANNUAL RYE, RAKE IN & MULCH
 WITH CLEAN STRAW & SOAK WITH WATER.
 USE SAME @ WELL HOUSE, B.T.N. TANK & PUMP
 HOUSE & AT FRONT TANK PIERS.

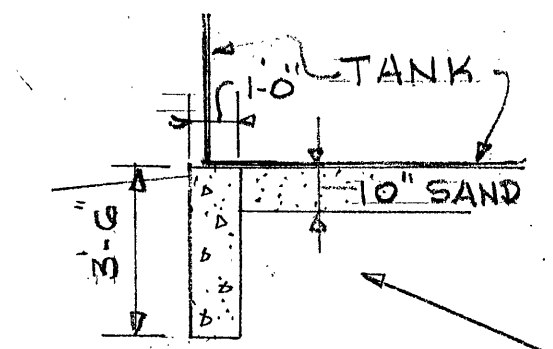

250,000 GALLON TANK

ALTITUDE VALVE
 VAULT - NO CHANGE

REMOVE PIPE TO BELOW
 FROST LINE & INSTALL
 BLIND FLANGE

VALVE VAULT
 NO CHANGE

4-20-01	1	APPENDUM I	LBC
DATE	REV.	DESCRIPTION	BY
CITY ENGINEER			
DEMOLITION & REPAIR OF STATESMAN PARK TANK, ETC.			DRAWN LBC.
2751 MARY LINDA AVE, N.E.			CHECKED
WATER DEPARTMENT			APPROVED
ROANOKE, VIRGINIA			DATE 3-25-01
OFFICE OF CITY ENGINEER			PLAN NO. 01-03-65
MUNICIPAL BUILDING, ROOM 350			SHEET 1
215 CHURCH AVENUE, S.W.			OF 1
ROANOKE, VIRGINIA 24011			