

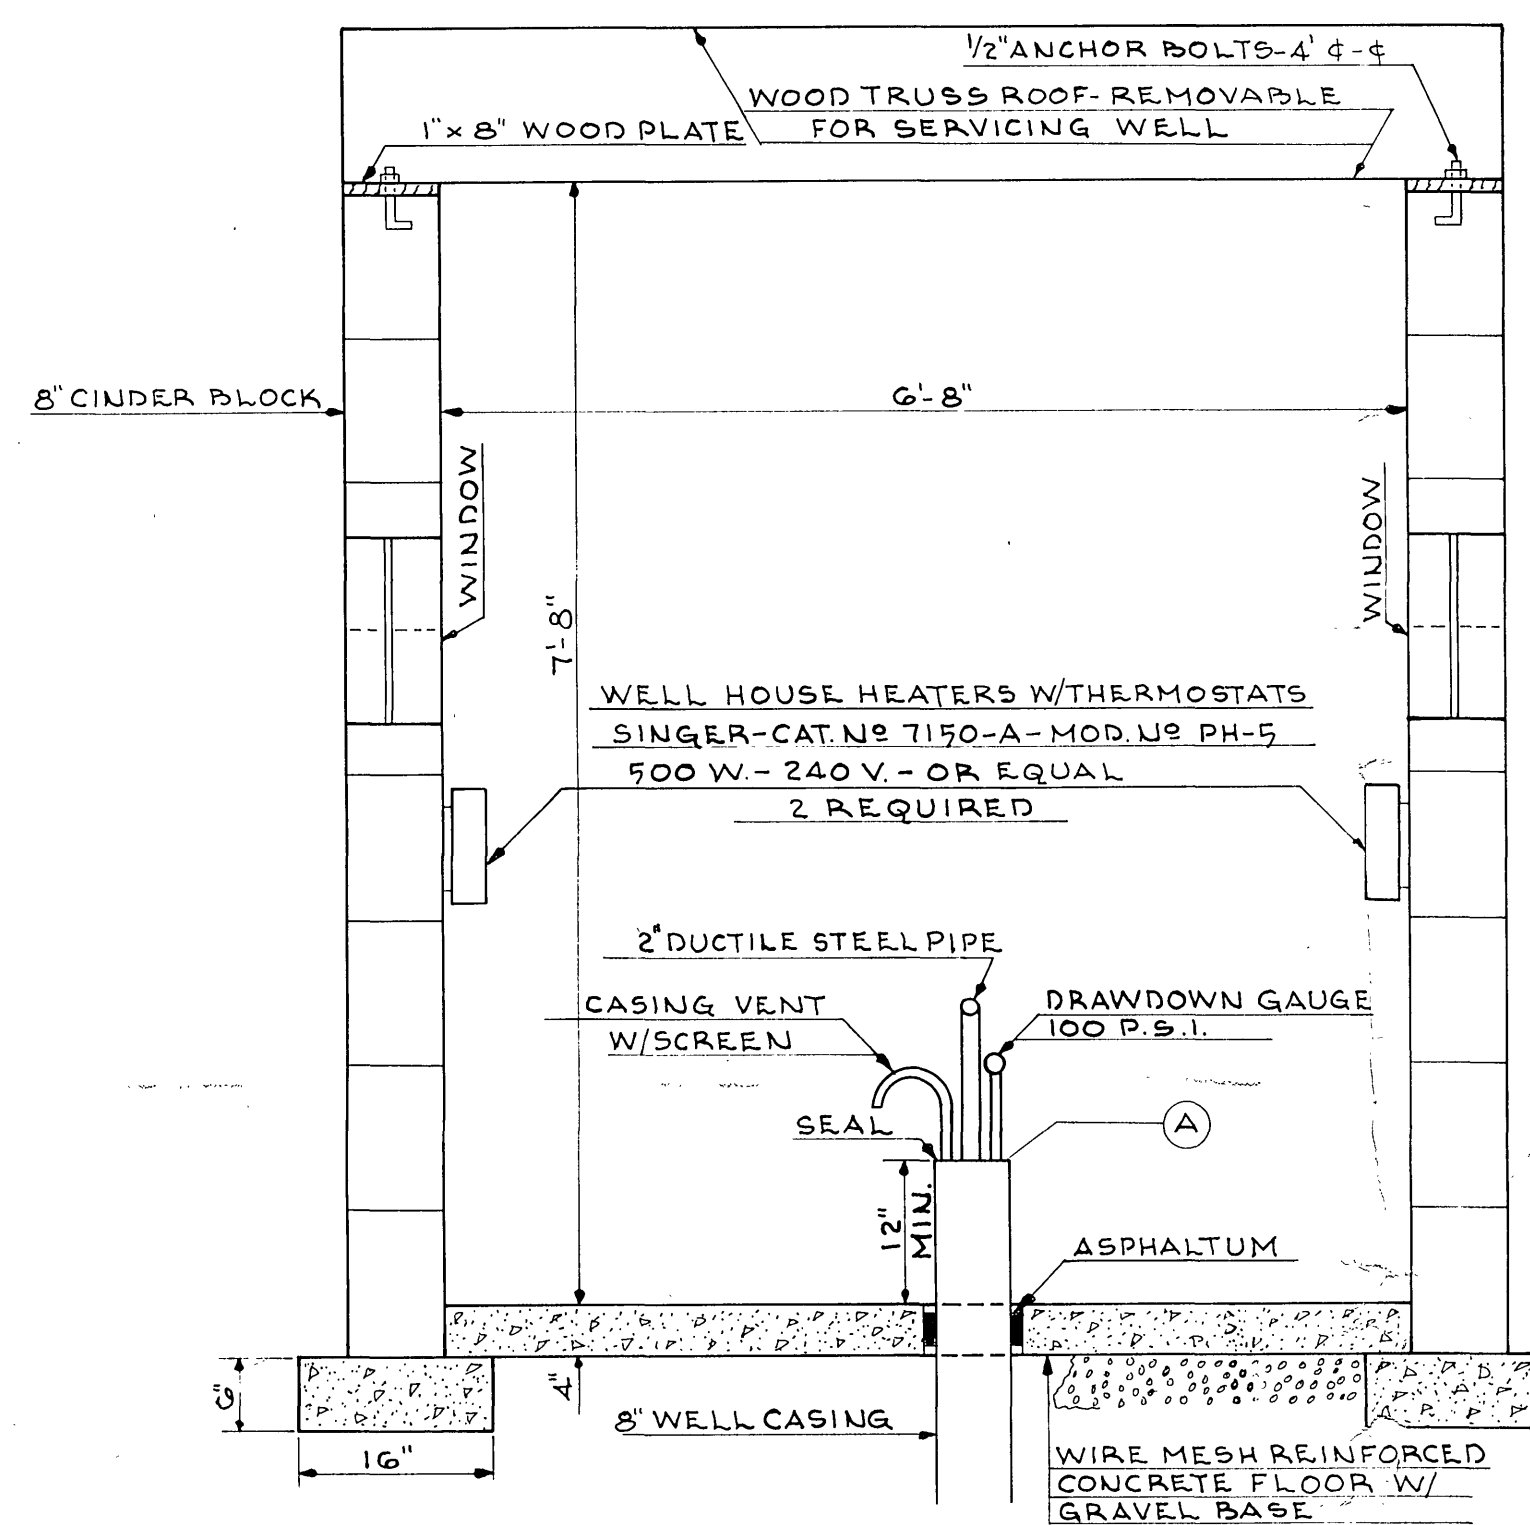
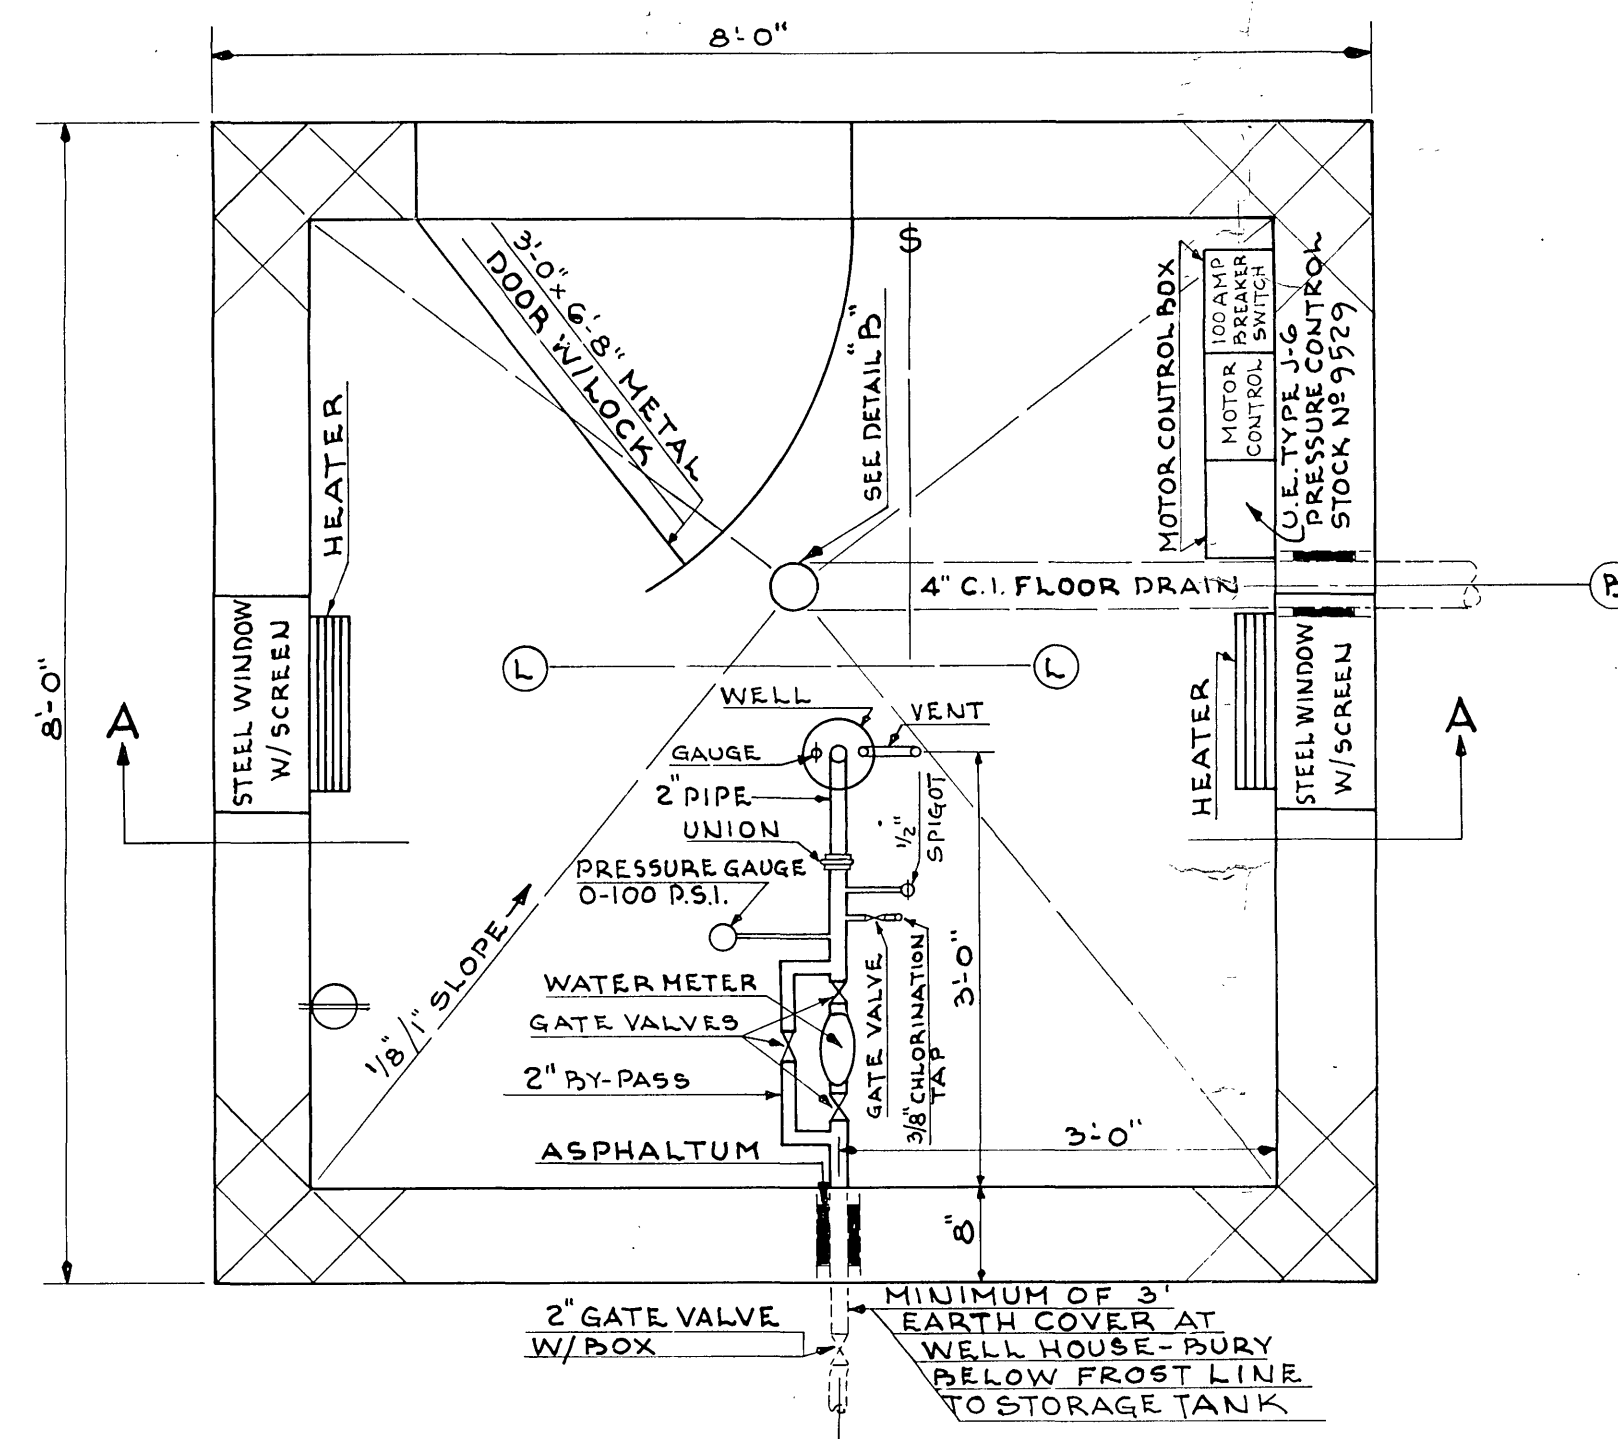
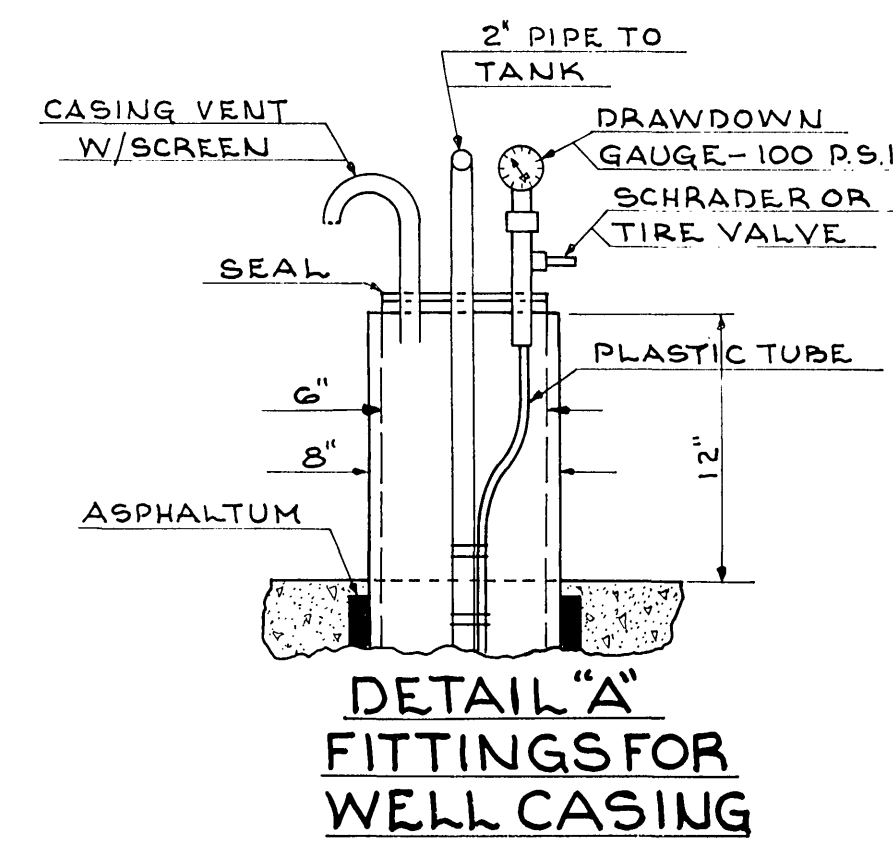


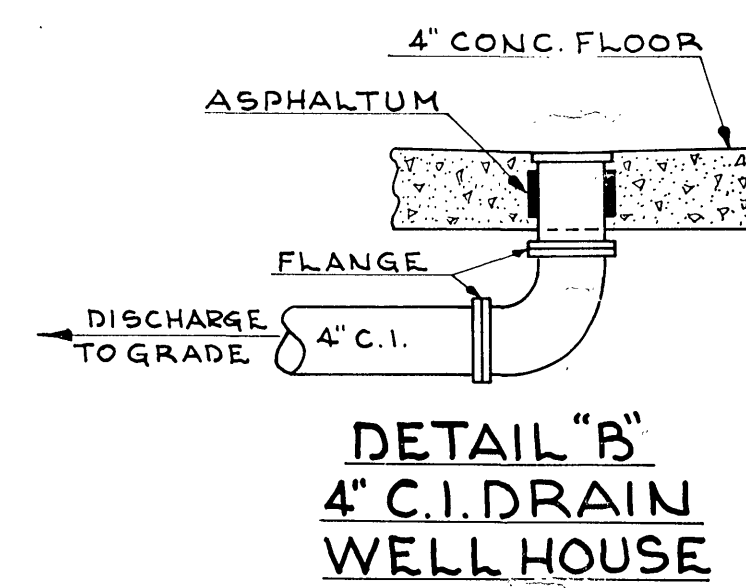


SECTION A-A

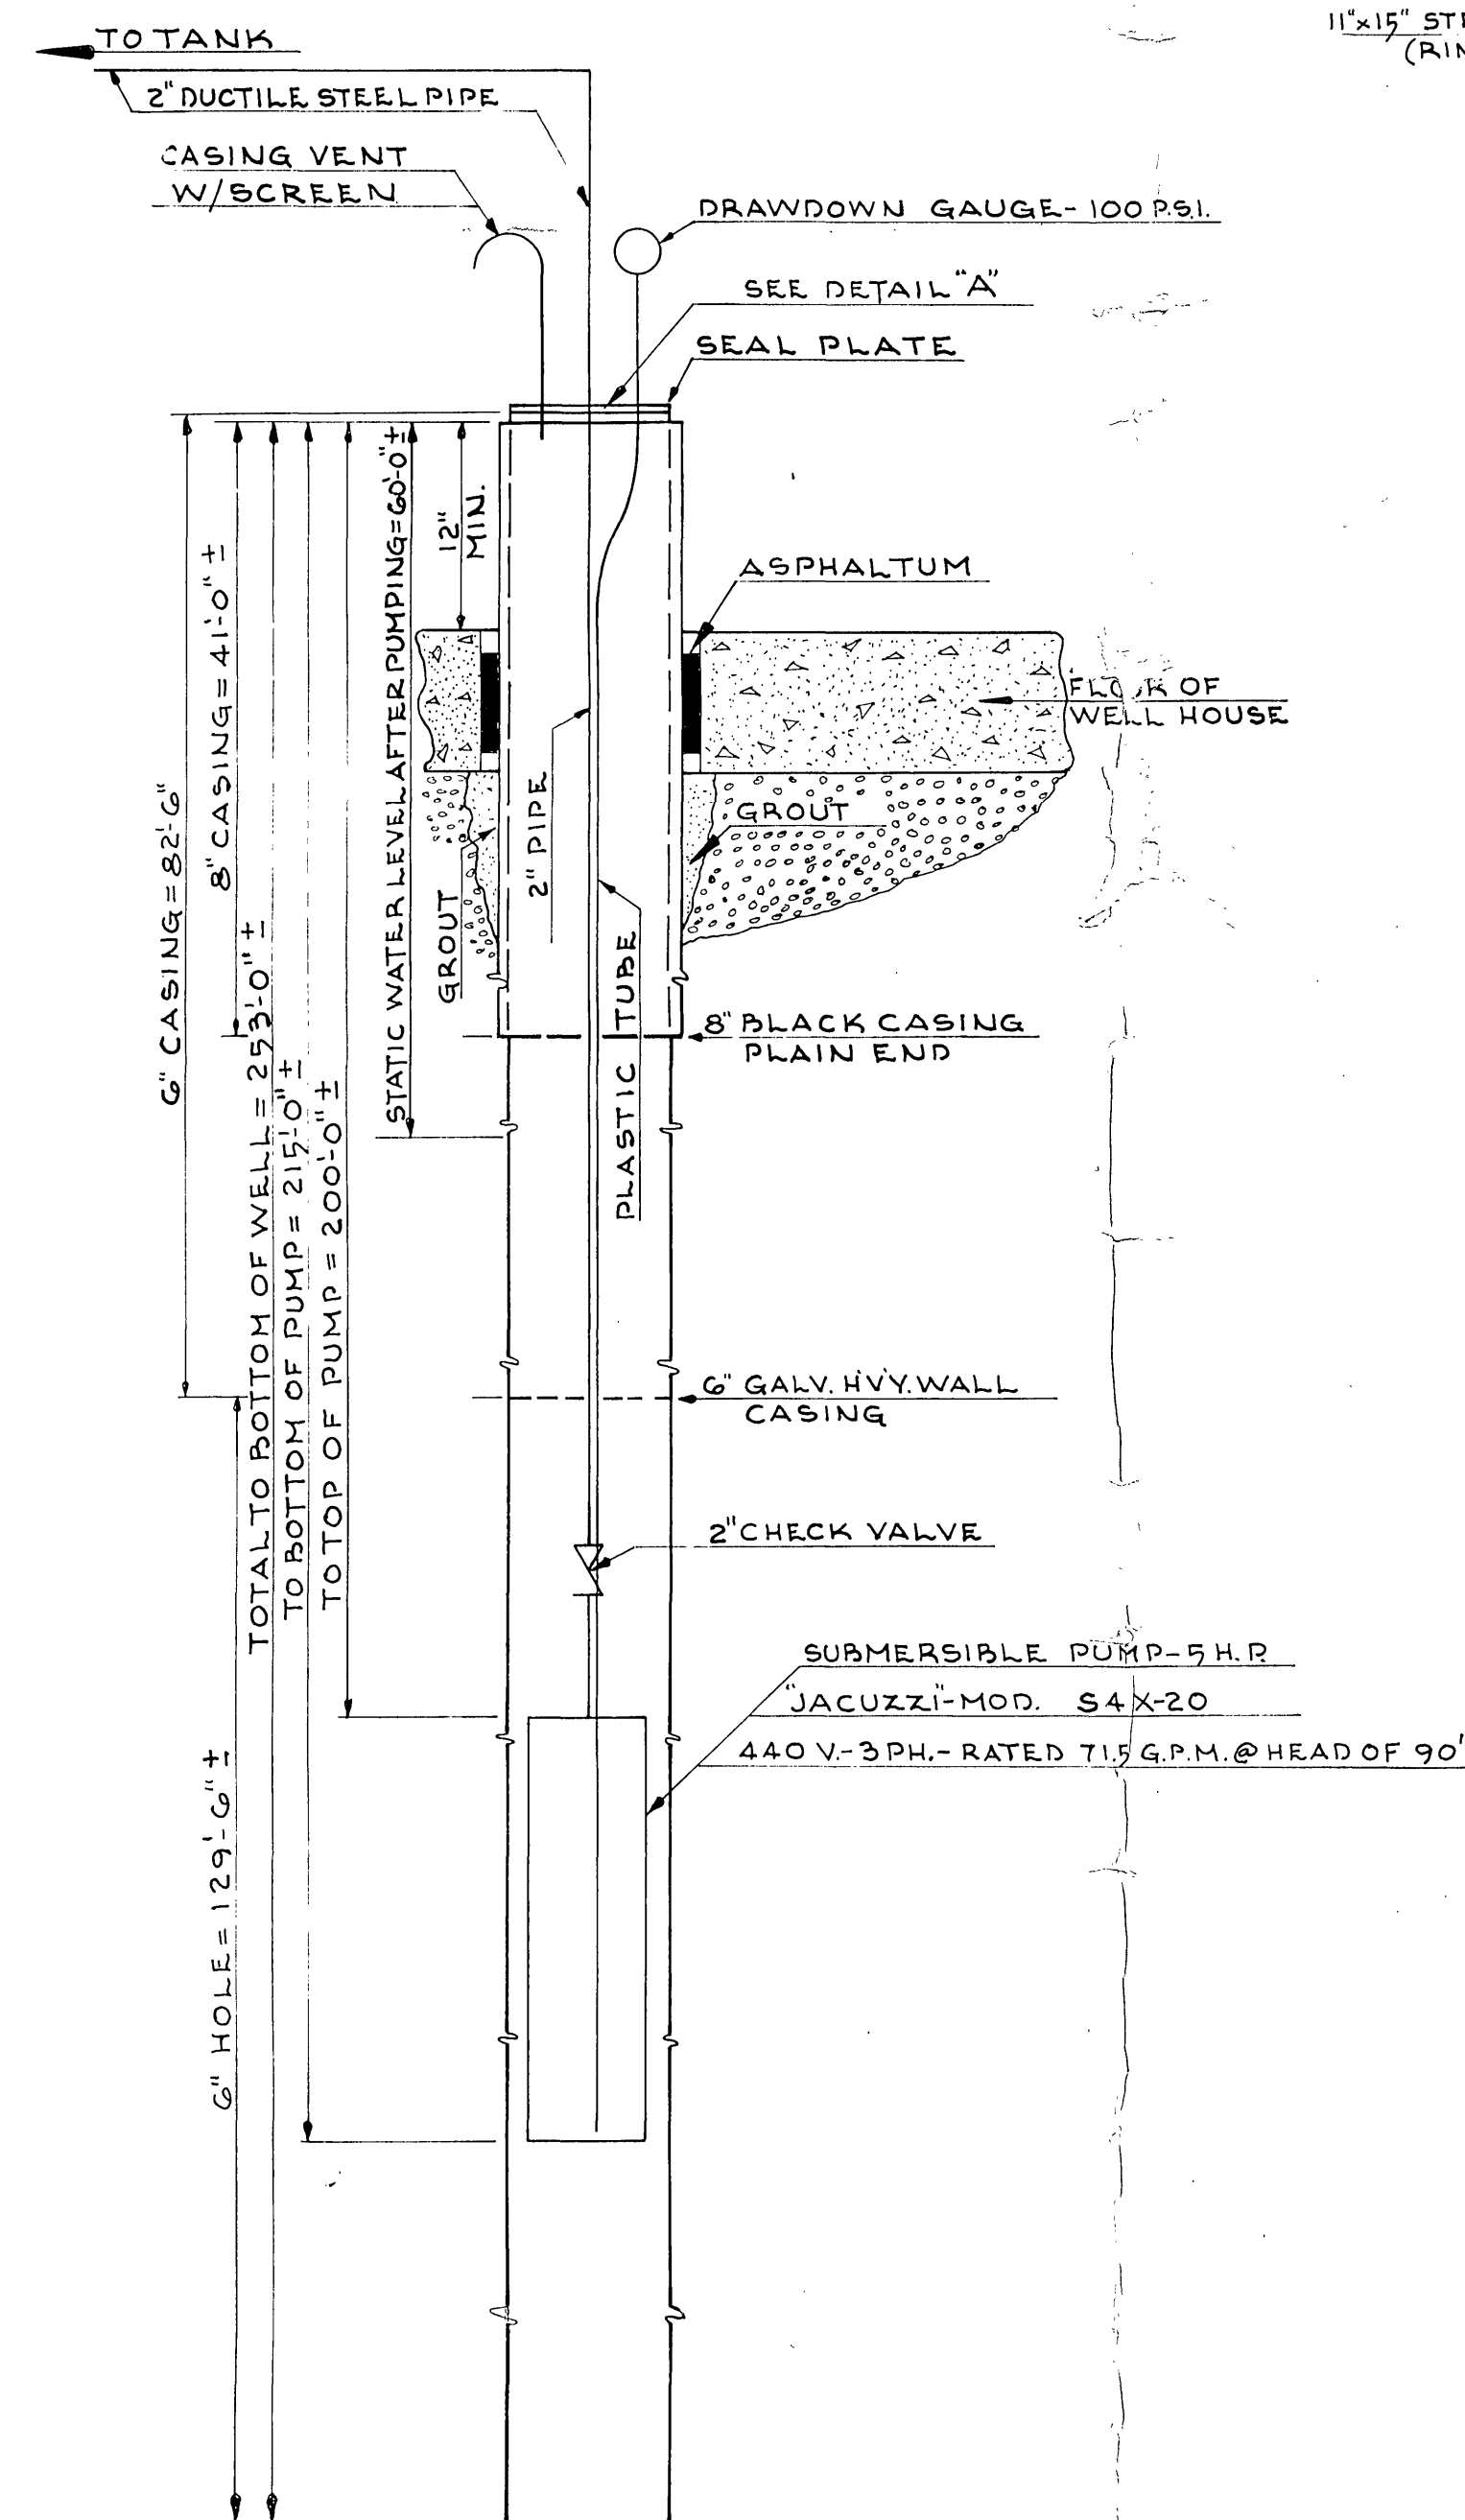

WELL HOUSE


DETAIL "A"
FITTINGS FOR
WELL CASINGDETAIL "B"
4" C.I. DRAIN
WELL HOUSE

WELL DIAGRAM

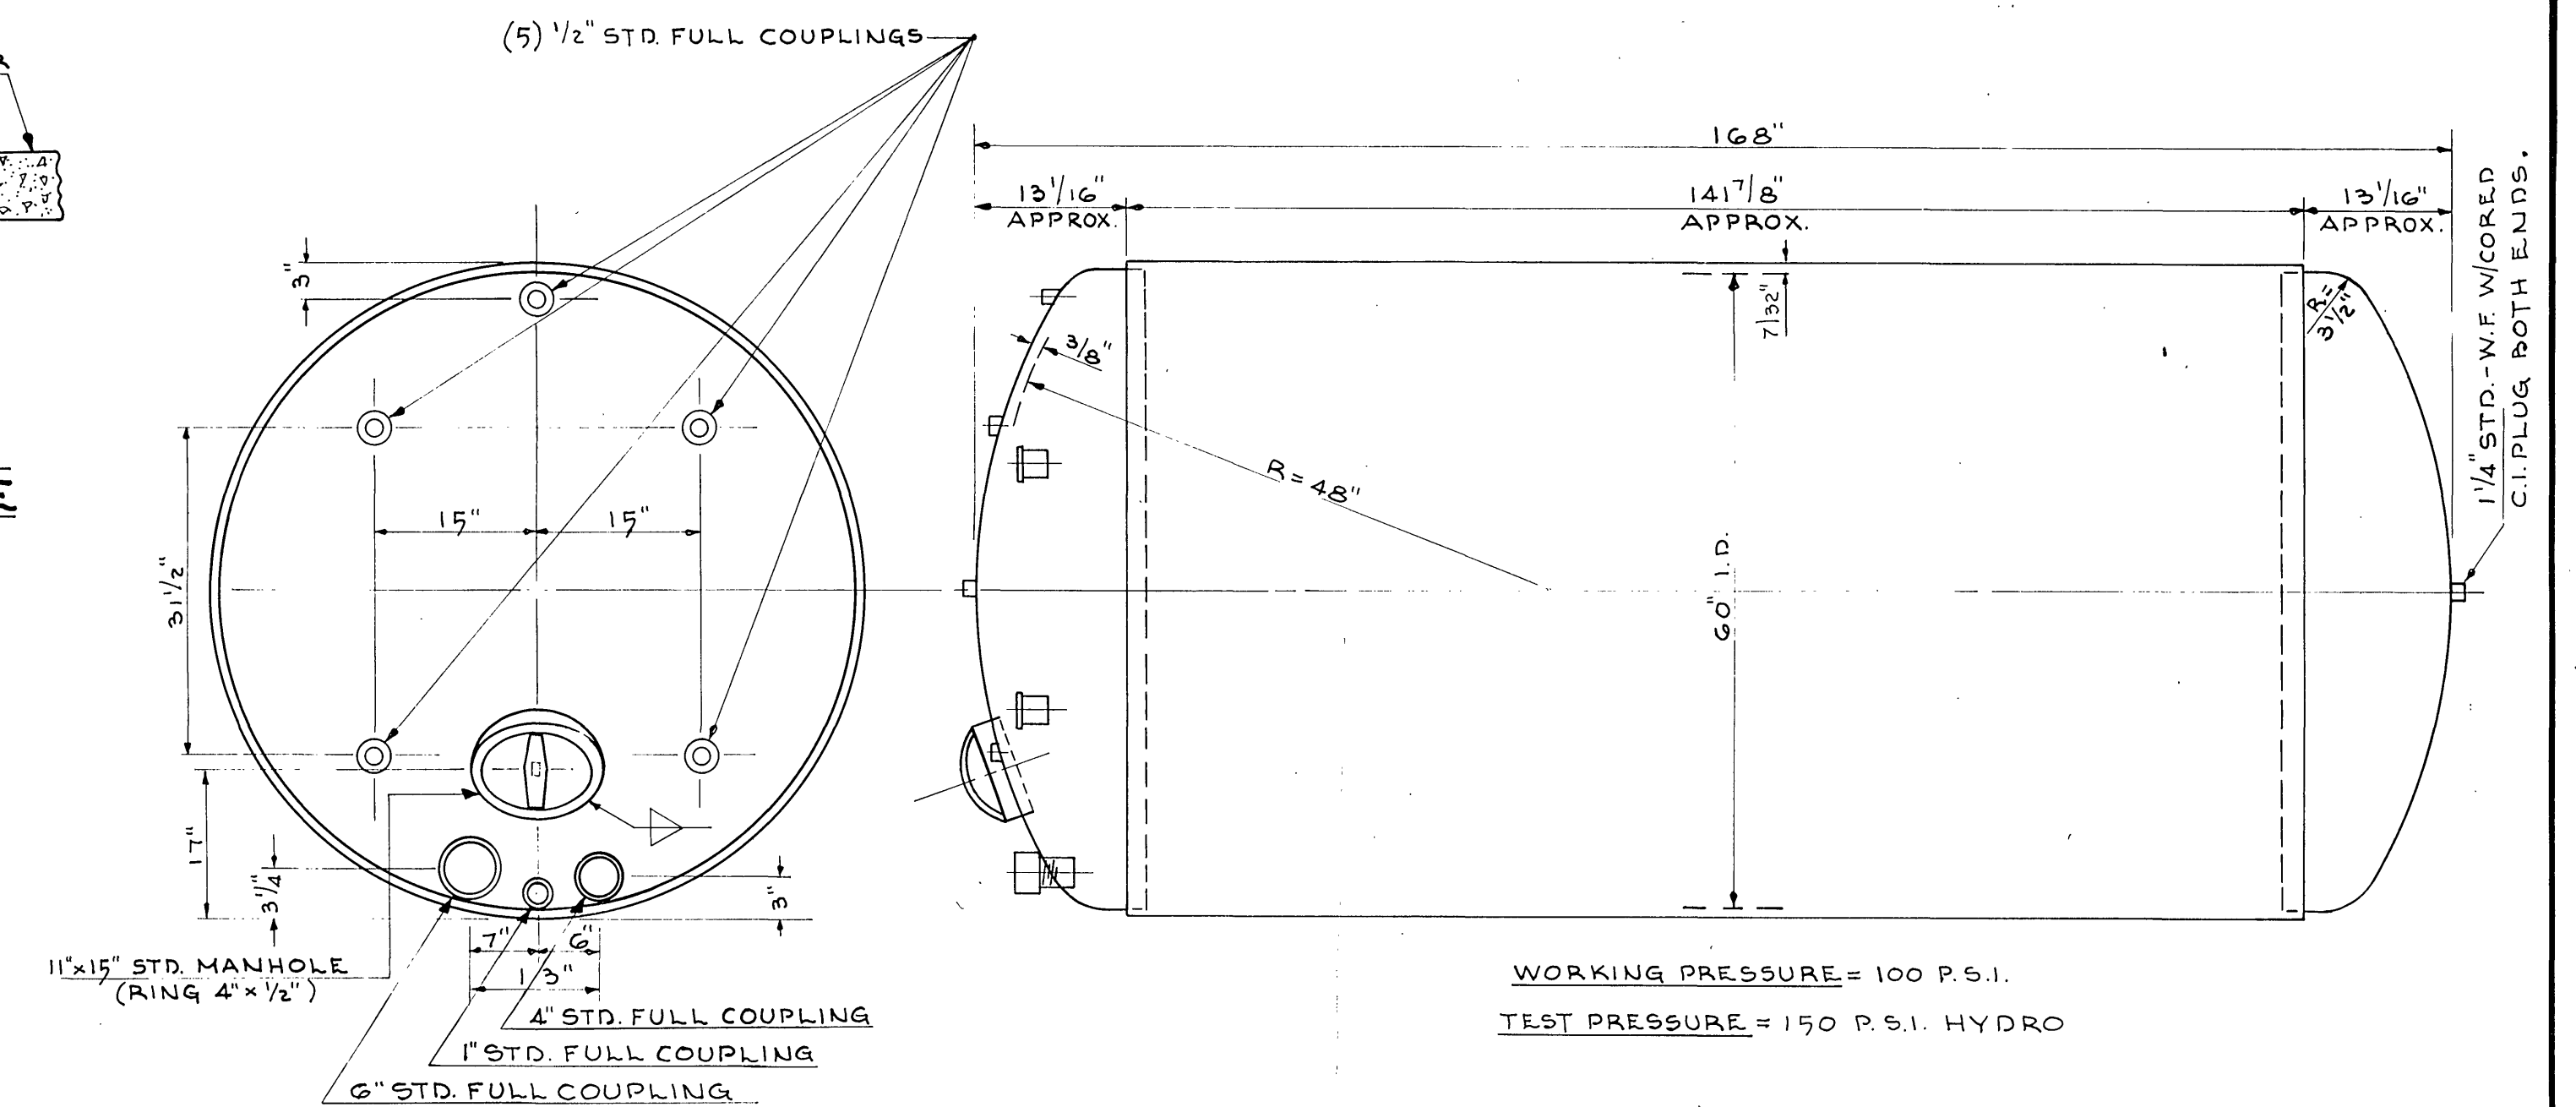


WORKING PRESSURE = 100 P.S.I.
TEST PRESSURE = 150 P.S.I. HYDRO


NOTE:
ALL MATERIAL IS A-212
OR BETTER.
ALL PAINTED TO A.W.W.A.
SPECIFICATIONS AFTER
SAND BLAST.
DISINFECT AS PER A.W.W.A.
STANDARD D-102-64, SECTION
5.3.1.

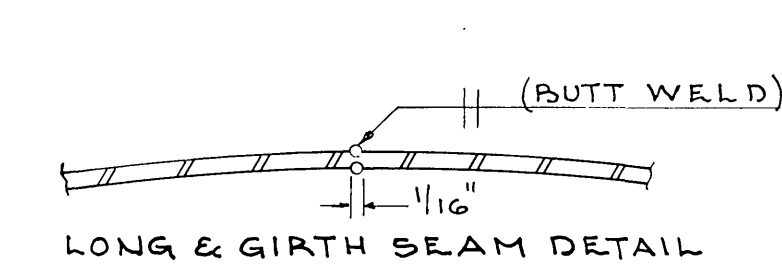


LONG & GIRTH BEAM DETAIL

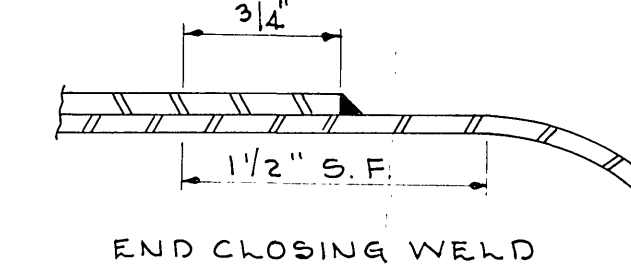

END CLOSING WELD

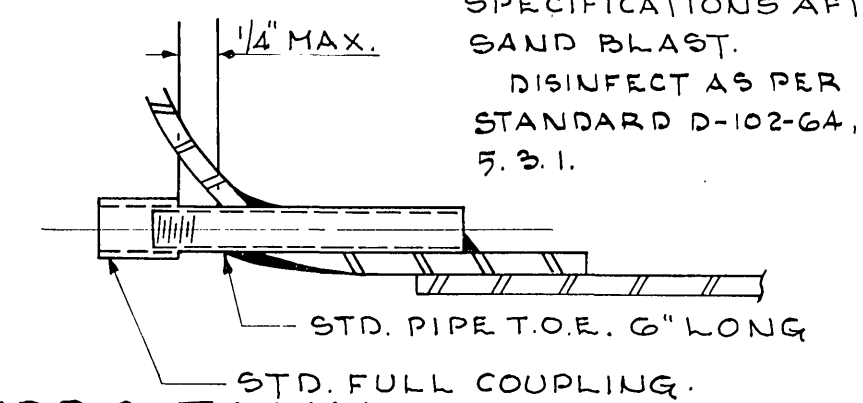STD. PIPE T.O.E. 6" LONG
STD. FULL COUPLING.

2000 GAL. STANDARD AWWA HYDRO TANK

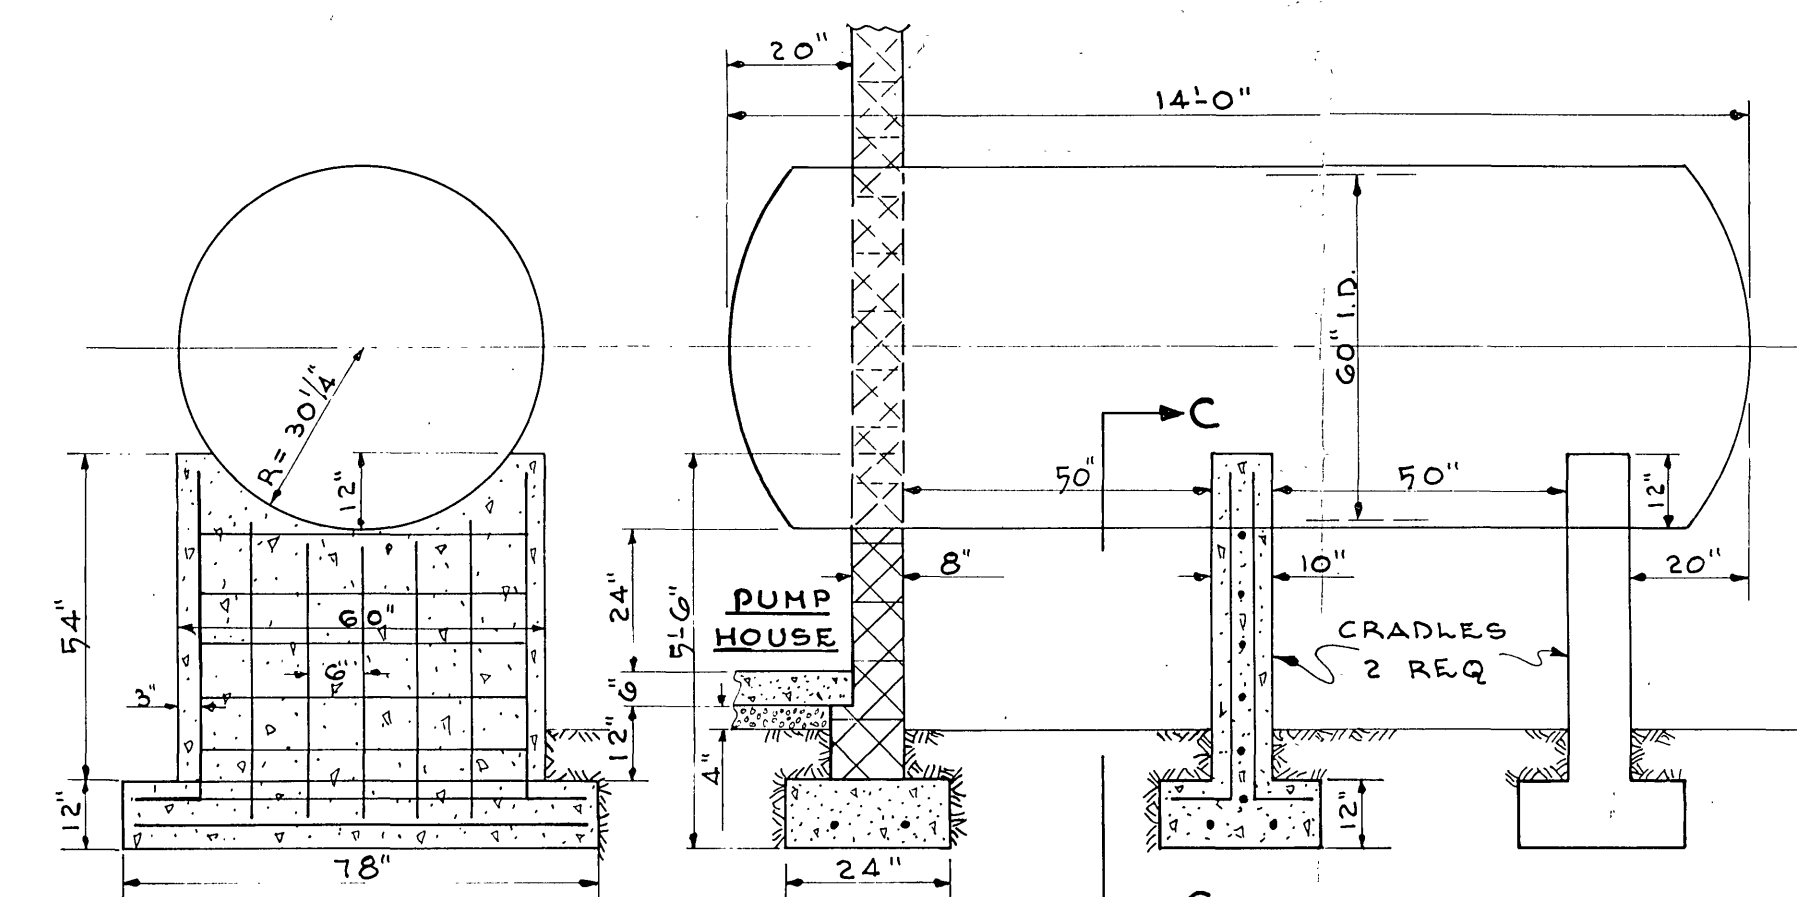

SEC. "C-C"

DETAIL-CONCRETE CRADLE

NOTE:
ALL REINFORCING TO BE NO. 4
DEFORMED STEEL BARS.

**STATESMAN PARK
WATER SYSTEM
WELL HOUSE & PRESSURE TANK**
PROPERTY OF
STATESMAN PARK WATER COMPANY
SITUATE ON U.S. RTE. 460 - EAST OF CITY OF ROANOKE
ROANOKE COUNTY, VIRGINIA.
DATE: MAY 24, 1974 SCALE: NONE
T. P. PARKER & SON
ENGINEERS & SURVEYORS
SALEM VIRGINIA

REVISED JULY 26, 1974 - DISINFECTION STANDARDS ADDED.