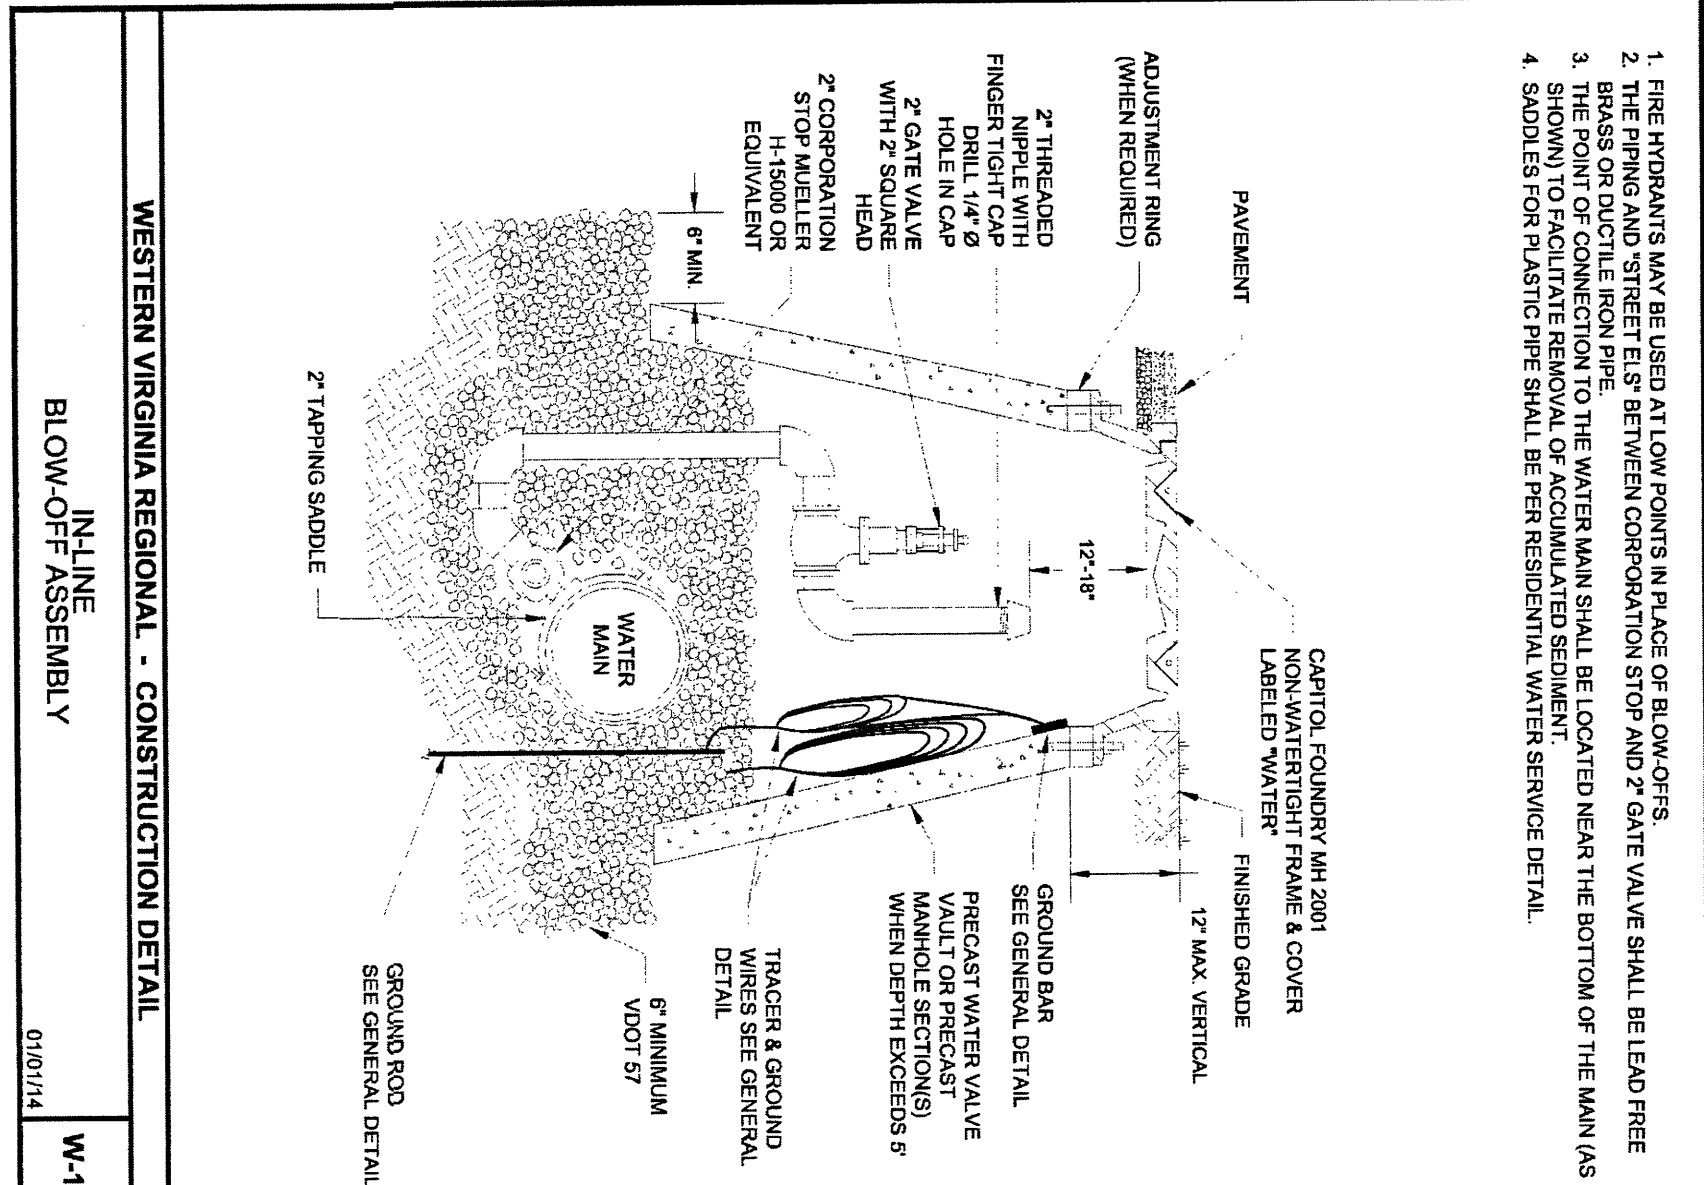
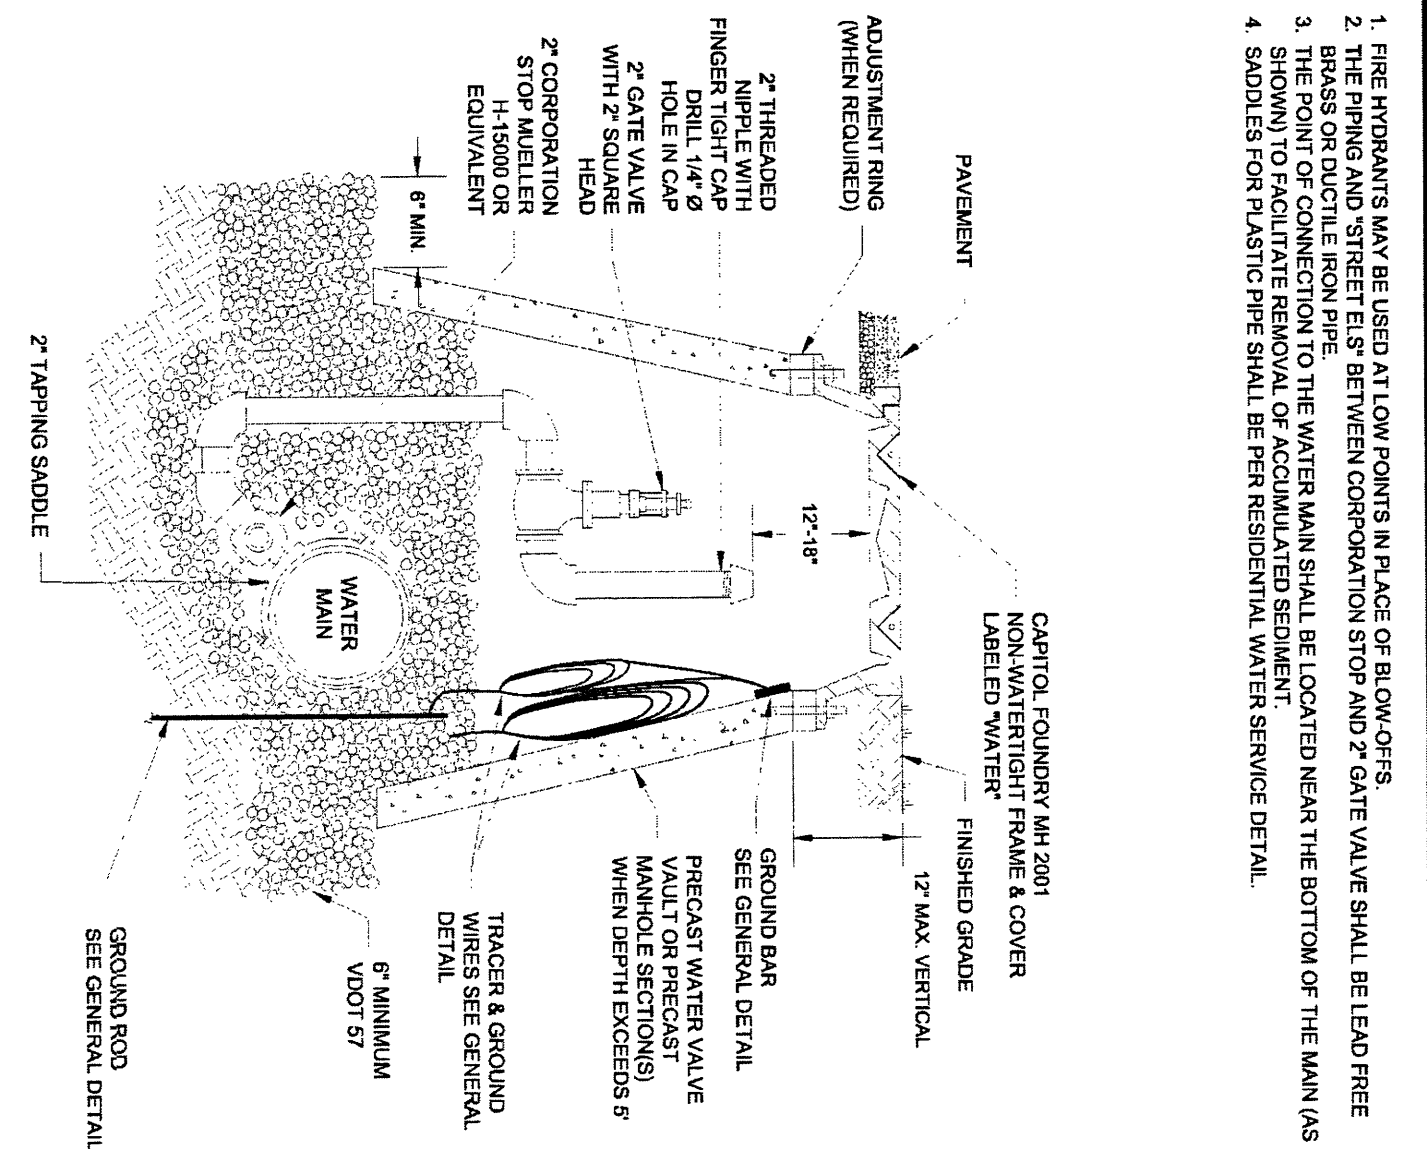
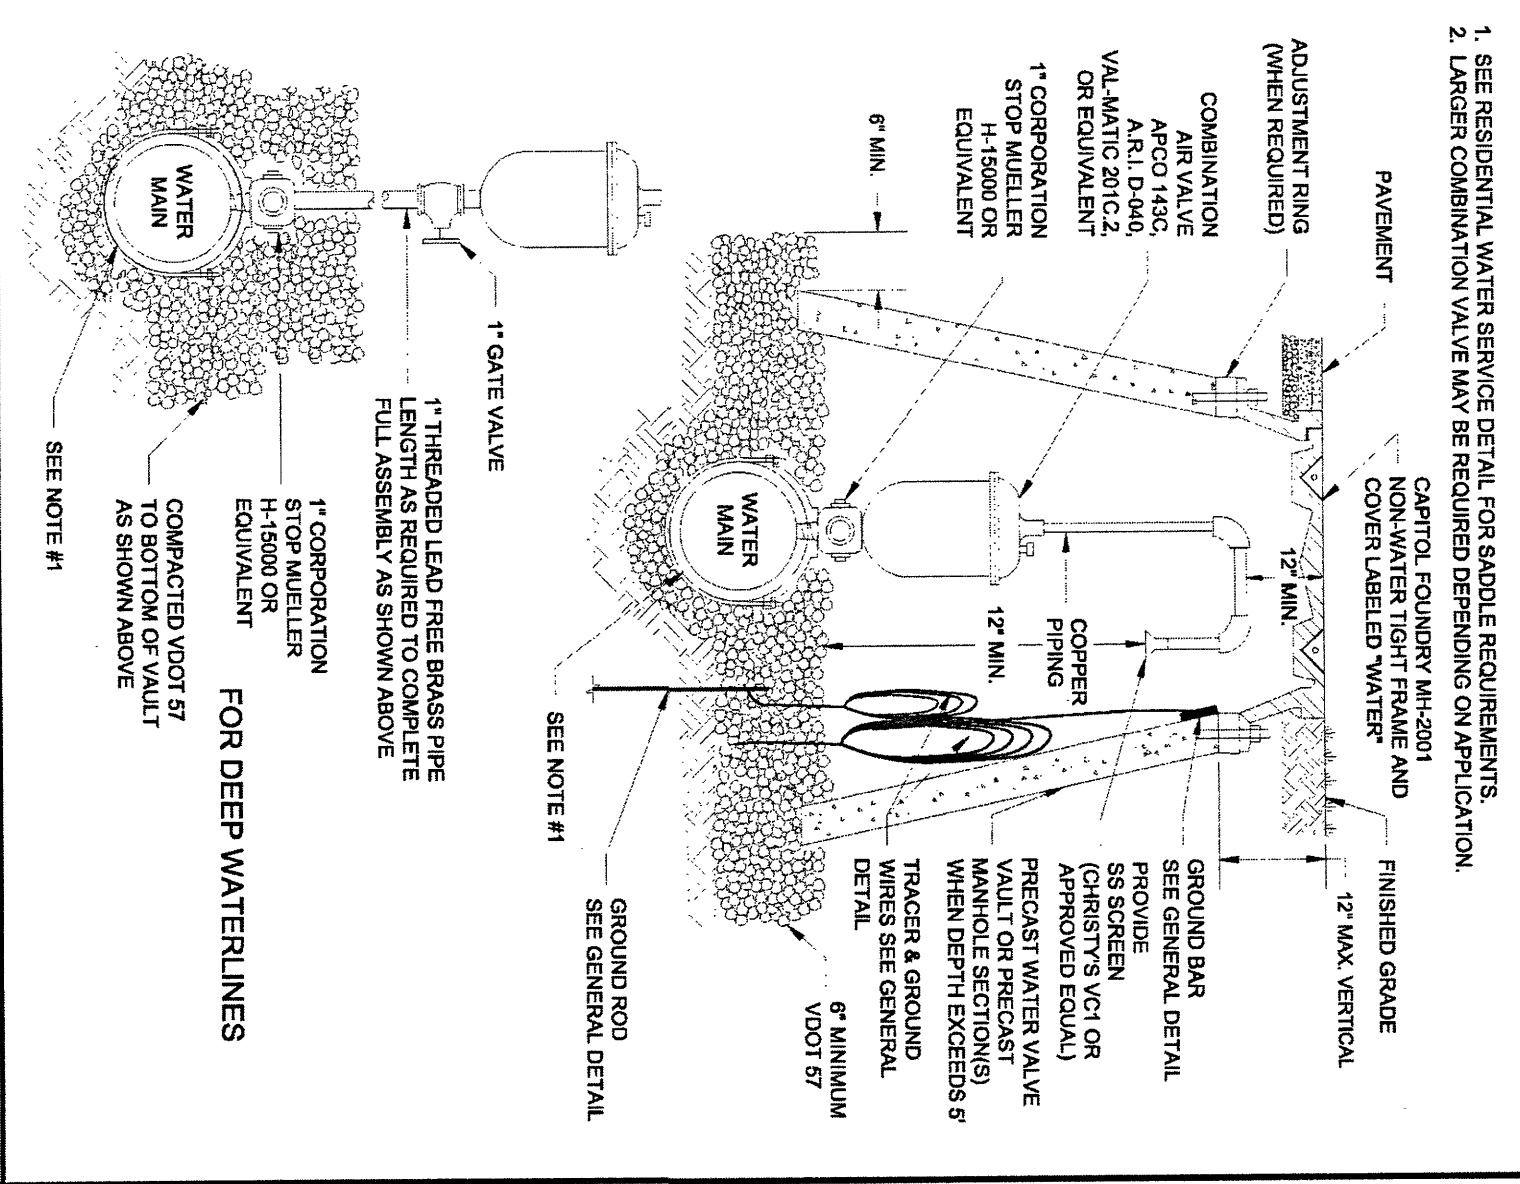
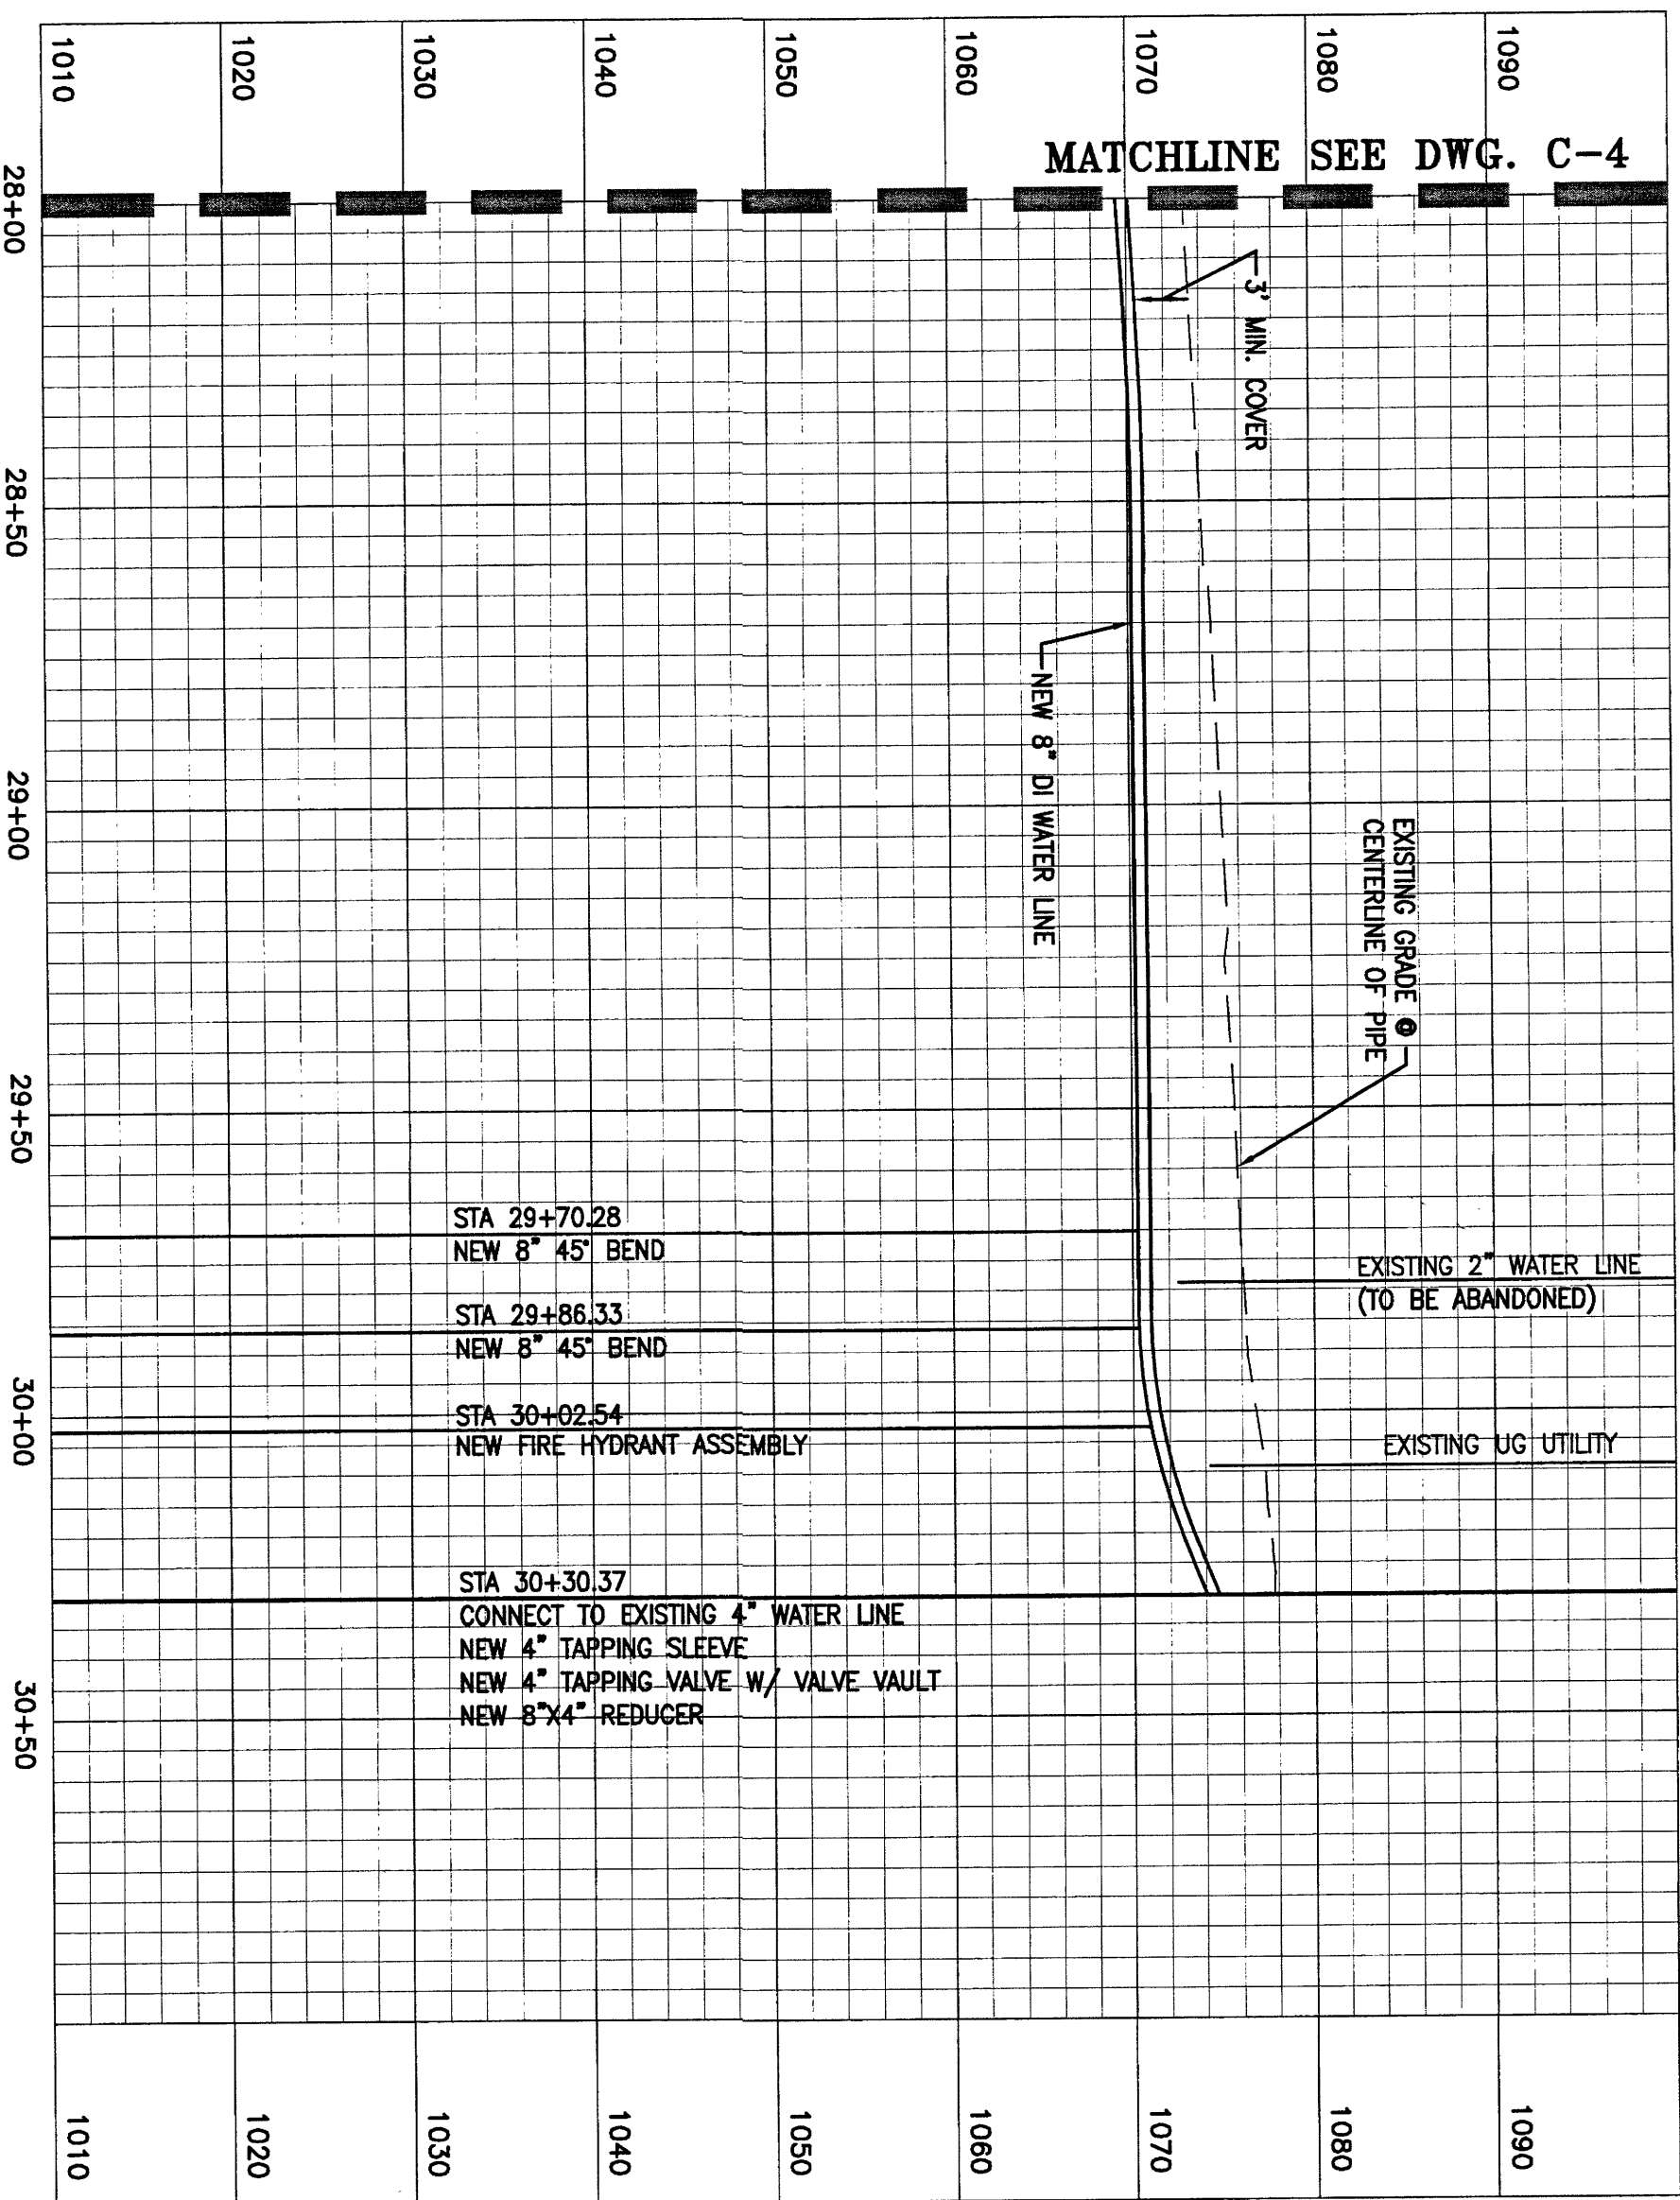
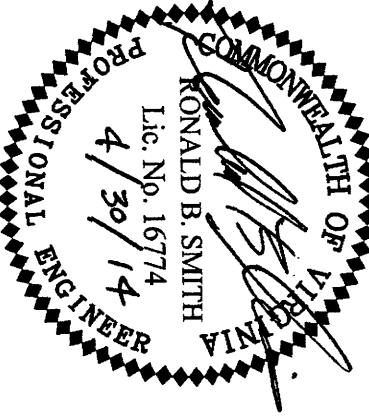


BLOWUP
SCALE: 1" = 10'

EXISTING 4" WATER LINE. CONTRACTOR SHALL FIELD VERIFY LOCATION, SIZE, AND DEPTH OF EXISTING WATER LINE PRIOR TO CONSTRUCTION. COORDINATE CONNECTION WITH TOWN OF WINTON.
 REQ'D:
 NEW 4" TAPPING SLEEVE
 NEW 4" TAPPING VALVE W/ VALVE VAULT
 NEW 8" x 4" REDUCER

[illegible]

W
W

**ENGINEERS
SURVEYORS
PLANNERS**

ASSOCIATES

PO Box 4119
Lyonsburg, VA 24562
Phone: 434.316.0680

3000 Avenue Square Pl
Charlottesville, VA 22901
Phone: 434.984.2700

www.wvaassociates.net

DATE: 1/1/2005	1
DRAWN BY: JMC	DRAWING NUMBER: C-5
WMA NUMBER: 214005.01	SHEET NUMBER: 5 of 7

