

2X2X1/4" TUBE STEEL FRAMI

FULL WELDED CONNECTION

- 1X6 CEDAR SIDING @ 6" O.C

HORIZONTAL AND VERTICA

SUPPORTS. BOLT TO STEEL

6" DIA. PIPE W/ COLLAR HINGE PROVIDE STOP AT COLLAR

HINGE TO PREVENT DOOR

PIPE FLANGE SUPPORT HINGE

FROM SWINGING INWARD

CONCRETE FOOTING

- SEE STRUCTURAL


(TYP.)

FIXED LEAF SPRING-LOADED


ANCHOR PIN (BEYOND)

5 DUMPSTER ENCLOSURE ELEVATION


A-0.1) Scale: 1/4"=1'-0"

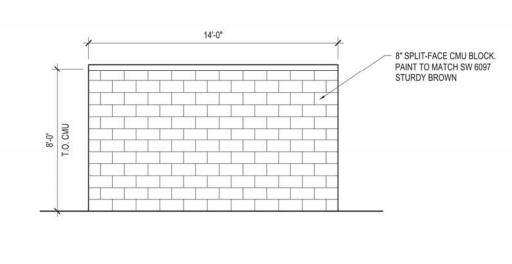




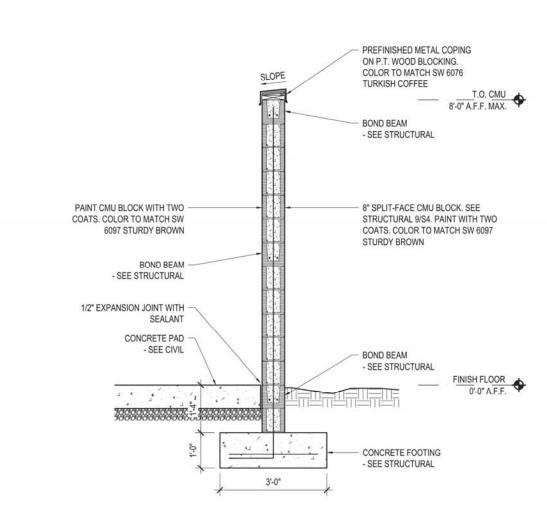



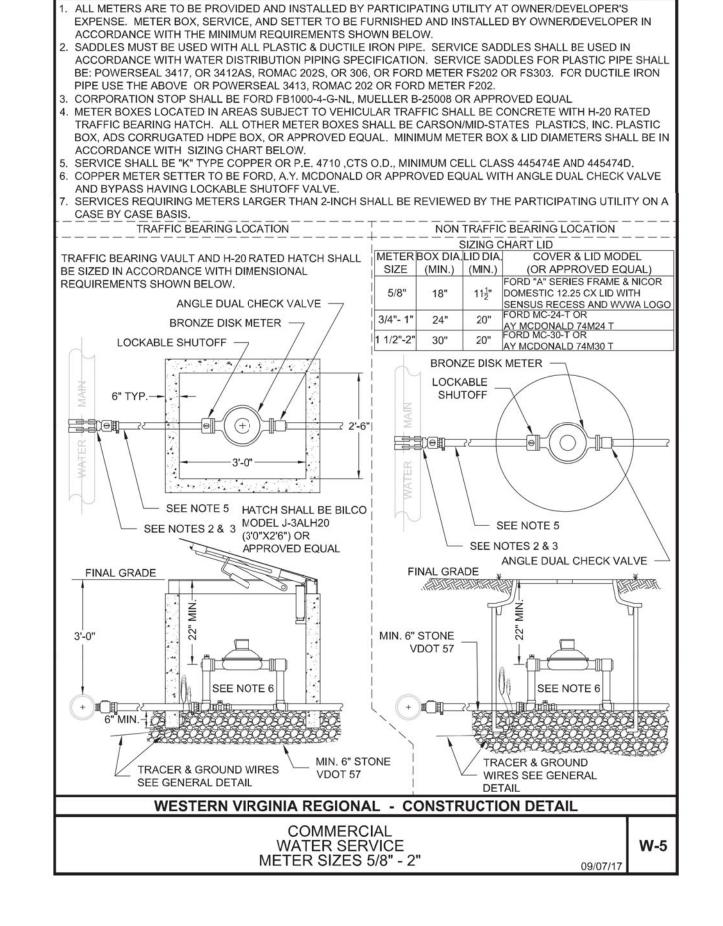

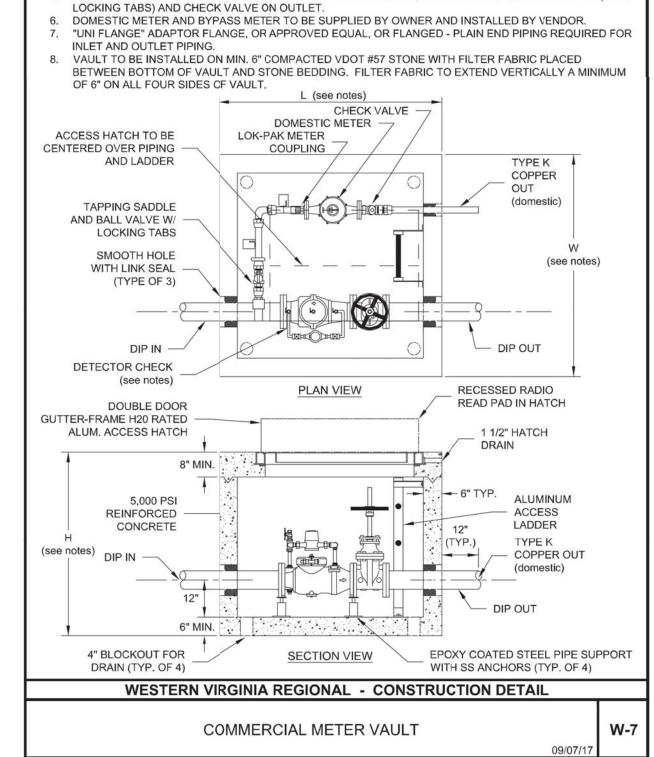

FOR 6" FIRE LINE, EXTERIOR VAULT DIMENSIONS SHALL BE (L x W x H) 6' X 6' X 5' WITH DOMESTIC TAP

FOR 8" FIRE LINE EXTERIOR VAULT DIMENSIONS SHALL BE (L X W X H) 6' X 6' X 6' WITH DOMESTIC TAP

MADE OUTSIDE VAULT. BALL VALVE WITH LOCKING TABS SHALL BE PROVIDED INSIDE VAULT TO ALLOW

SINGLE DETECTOR CHECK VALVE SHALL BE WILKINS 310 DALM , WATTS ES-SS07F - BP, OR APPROVED

DOMESTIC SHALL BE TYPE K COPPER WITH GRIP JOINT FITTINGS, BALL VALVE AT TAPPING SADDLE (WITH

EQUAL WITH FLANGED END CONNECTIONS, BYPASS ASSEMBLY, AND ONE OS&Y GATE VALVE.

BYPASS ASSEMBLY SHALL INCLUDE 2 BALL VALVES TO ISOLATE METER.

MADE INSIDE VAULT AS SHOWN BELOW.

FOR ISOLATION OF DOMESTIC METER.



0