


NOTE: G.C. TO PROVIDE NECESSARY TRENCH BOXES FOR CONSTRUCTION AND COMPLY WITH ALL OSHA STANDARDS AND PROCEDURES

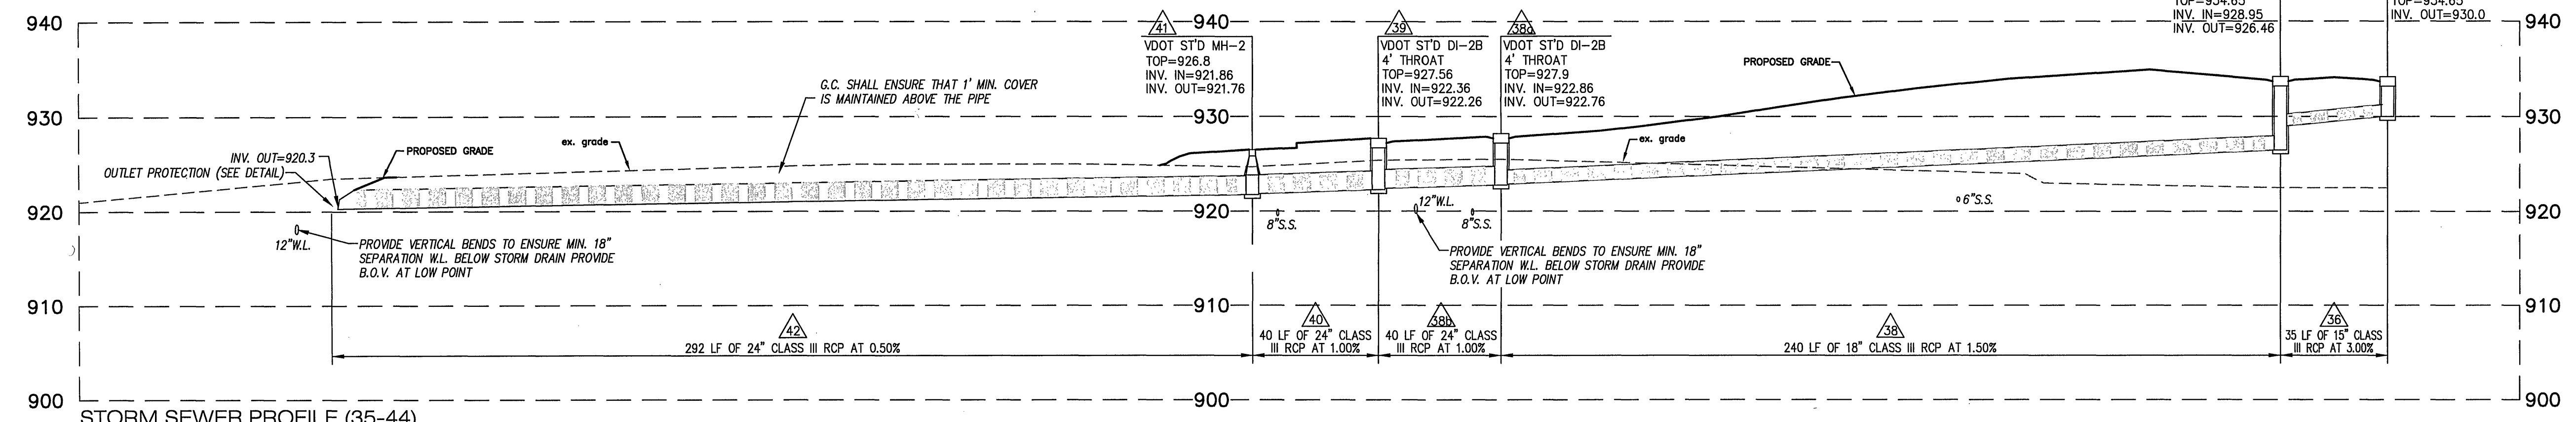


STORM SEWER PROFILE (35-44)
1"=30' HORIZONTAL
1"=10' VERTICAL

UTILITY SEPARATION NOTE:
THE CONTRACTOR/DEVELOPER SHALL MAINTAIN A MINIMUM OF 18" SEPARATION BETWEEN THE PROPOSED UTILITIES AND PROPOSED STORM DRAIN. IF THIS CANNOT BE ACHIEVED, THEN ADDITIONAL MEASURES MAY BE REQUIRED IN THE FIELD WITH OWNER, CONTRACTOR, PROJECT ENGINEER, CITY OF ROANOKE AND/OR W.V.W.A. REVIEW/APPROVAL.

UTILITY SEPARATION NOTE:
THE CONTRACTOR/DEVELOPER SHALL MAINTAIN A MINIMUM OF 18" SEPARATION BETWEEN THE PROPOSED UTILITIES AND PROPOSED STORM DRAIN. IF THIS CANNOT BE ACHIEVED, THEN ADDITIONAL MEASURES MAY BE REQUIRED IN THE FIELD WITH OWNER, CONTRACTOR, PROJECT ENGINEER, CITY OF ROANOKE AND/OR W.V.W.A. REVIEW/APPROVAL.

* SEE SHEET C18 FOR OTHER WATERLINE PROFILES *

NOTE: G.C. TO PROVIDE NECESSARY TRENCH BOXES FOR CONSTRUCTION AND COMPLY WITH ALL OSHA STANDARDS AND PROCEDURES

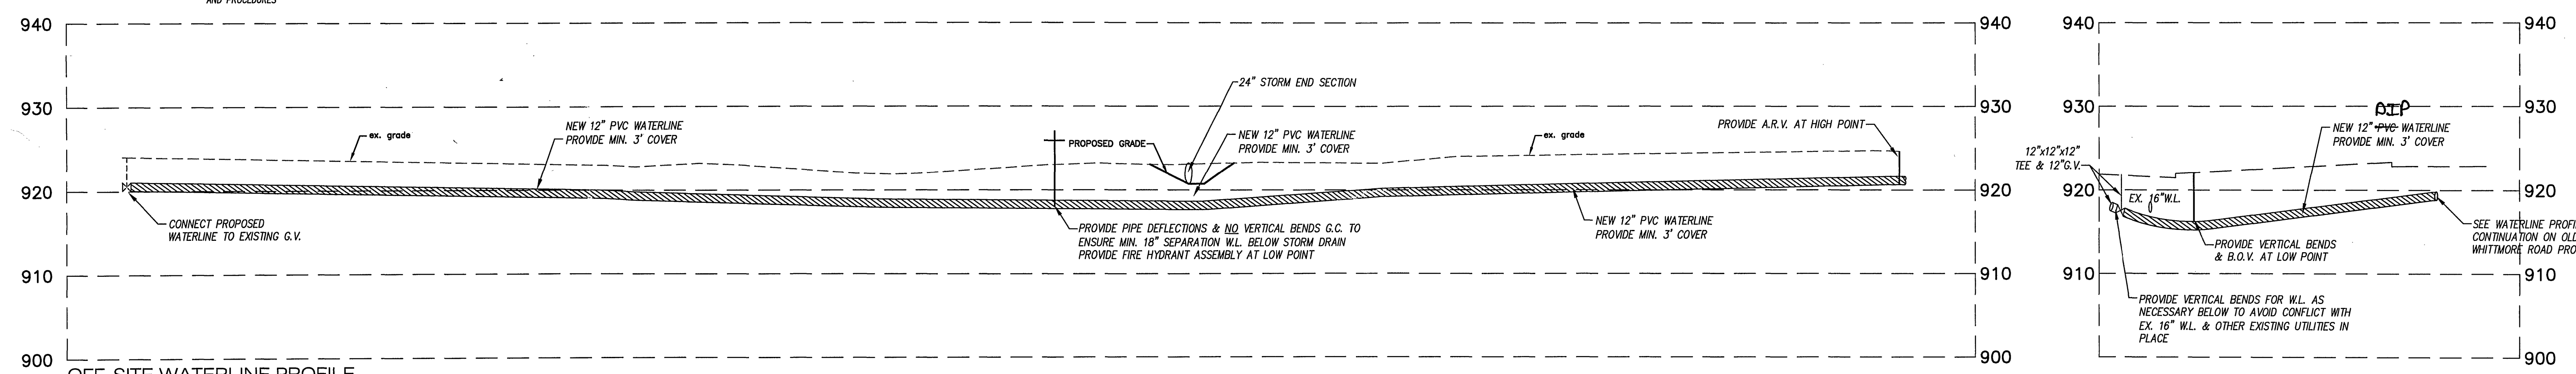


OFF-SITE WATERLINE PROFILE
1"=30' HORIZONTAL
1"=10' VERTICAL

UTILITY SEPARATION NOTE:
THE CONTRACTOR/DEVELOPER SHALL MAINTAIN A MINIMUM OF 18" SEPARATION BETWEEN THE PROPOSED WATERLINE AND PROPOSED STORM DRAIN. IF THIS CANNOT BE ACHIEVED, THEN ADDITIONAL MEASURES MAY BE REQUIRED IN THE FIELD WITH OWNER, CONTRACTOR, PROJECT ENGINEER, CITY OF ROANOKE AND/OR W.V.W.A. REVIEW/APPROVAL.

JEFFERSON STREET WATERLINE PROFILE:
1"=30' HORIZONTAL
1"=10' VERTICAL

WATERLINE EXTENSION: SCALE 1"=30'

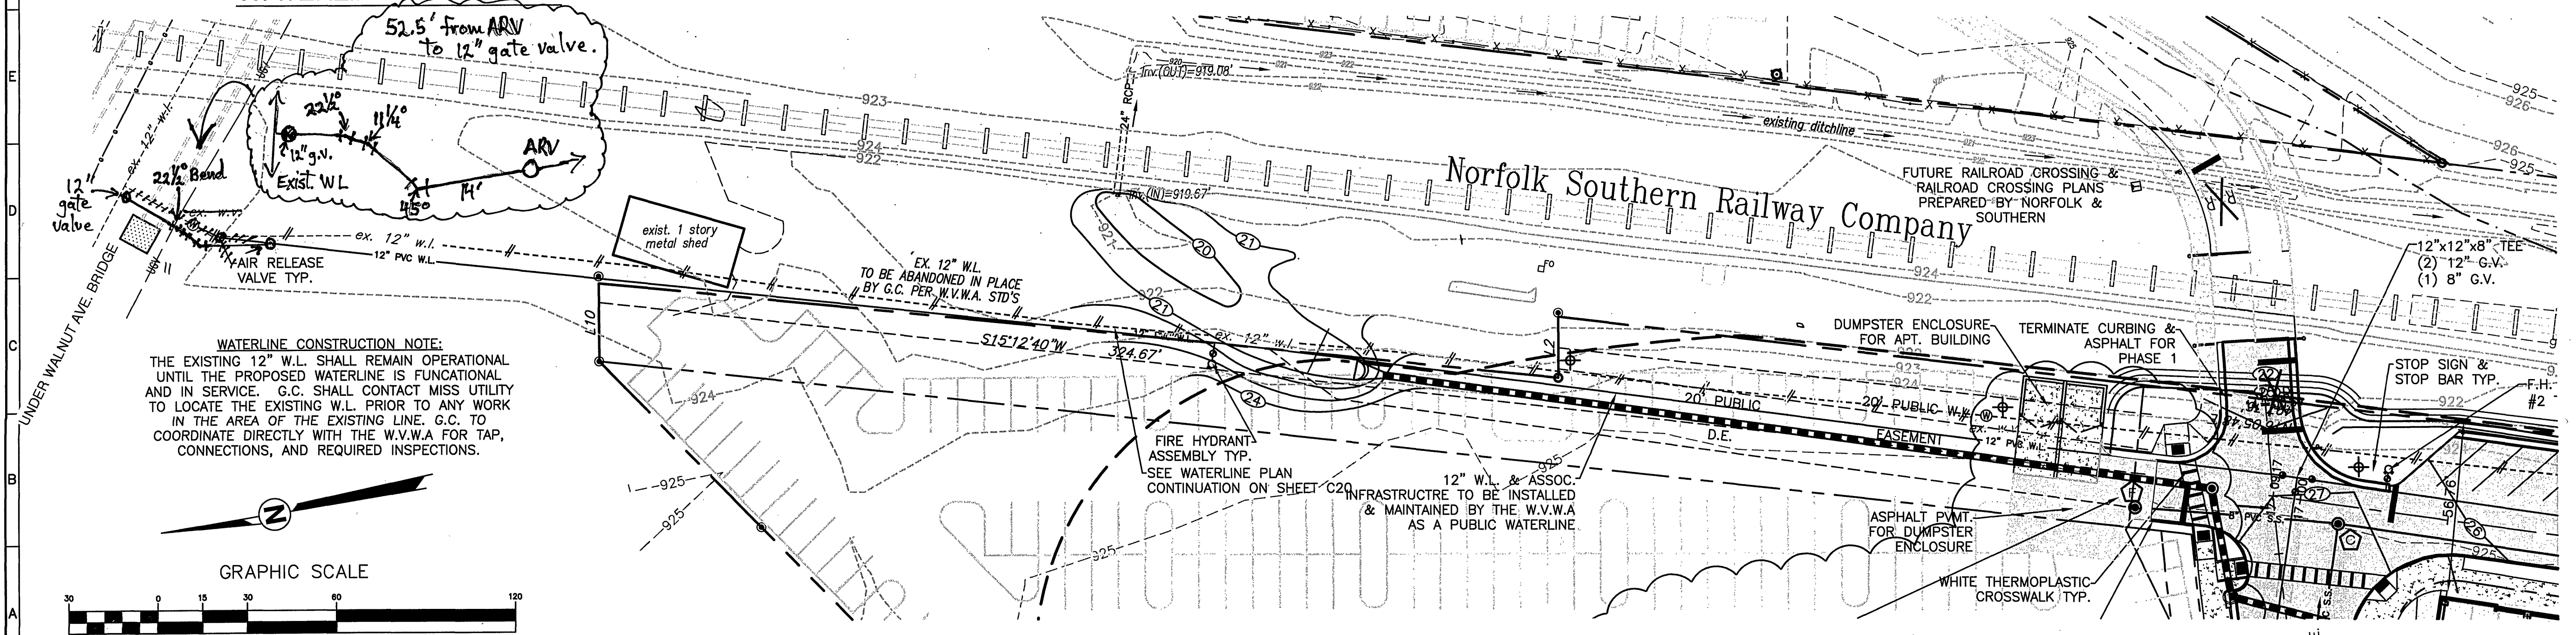

WATERLINE CONSTRUCTION NOTE:
THE EXISTING 12" W.L. SHALL REMAIN OPERATIONAL UNTIL THE PROPOSED WATERLINE IS FUNCTIONAL AND IN SERVICE. G.C. SHALL CONTACT MISS UTILITY TO LOCATE THE EXISTING W.L. PRIOR TO ANY WORK IN THE AREA OF THE EXISTING LINE. G.C. TO COORDINATE DIRECTLY WITH THE W.V.W.A. FOR TAP, CONNECTIONS, AND REQUIRED INSPECTIONS.

GRAPHIC SCALE

