
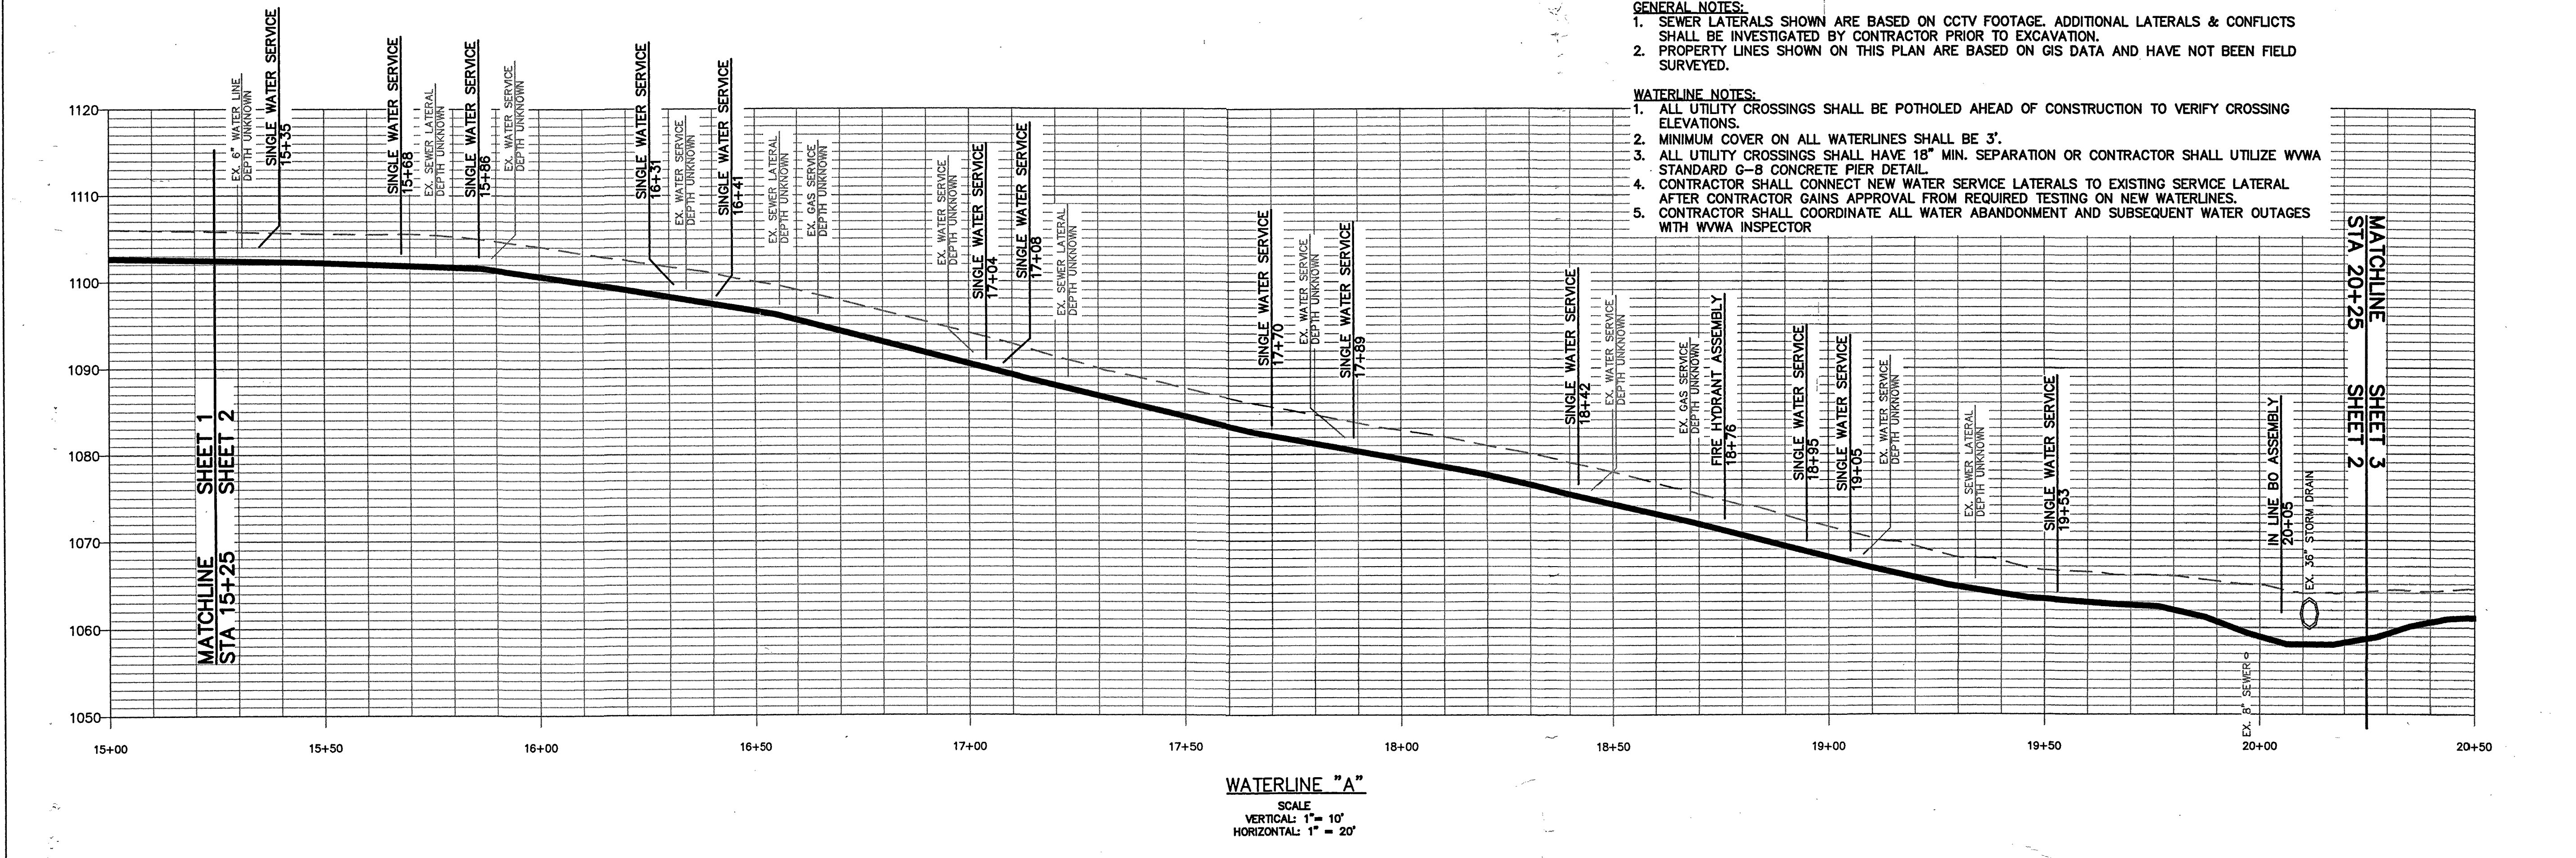


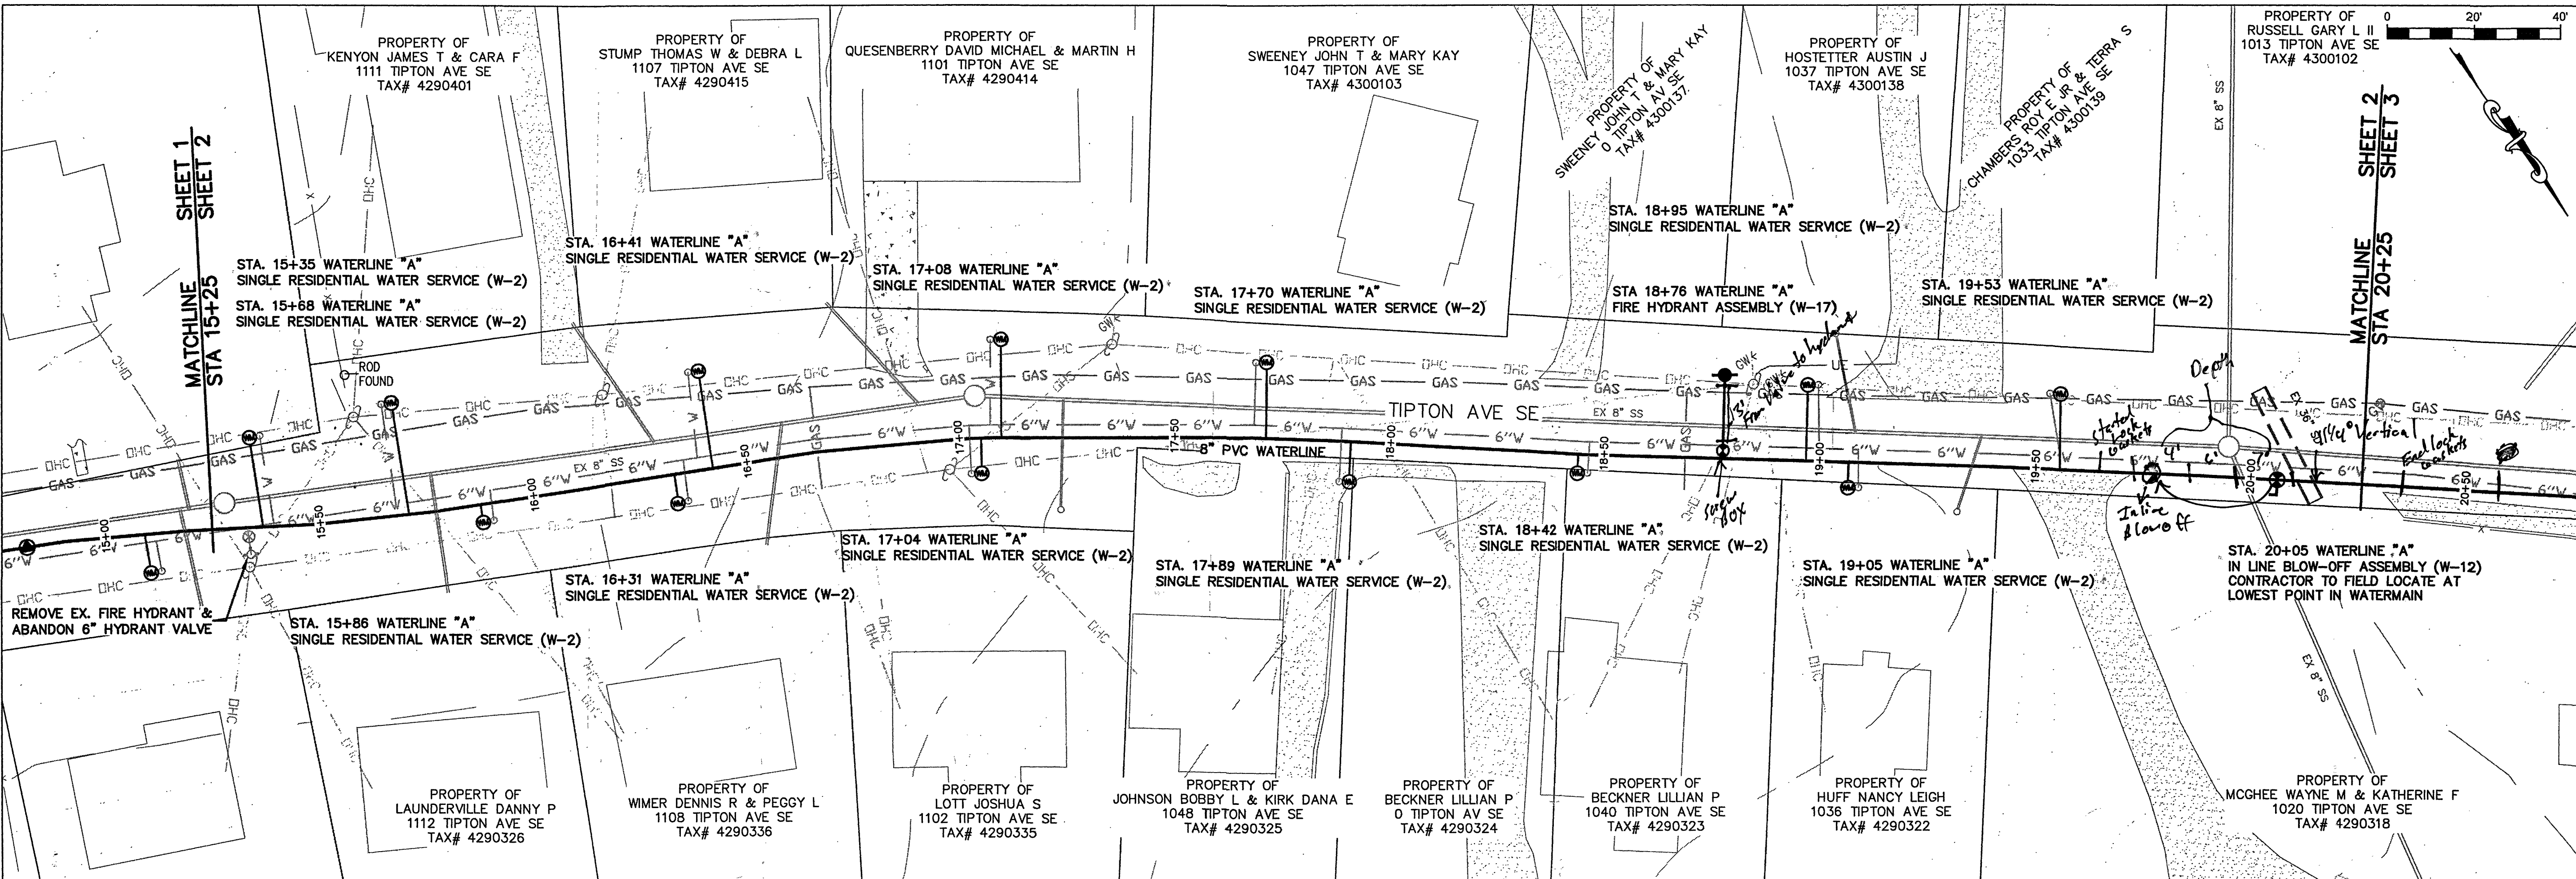

- GENERAL NOTES:**
1. SEWER LATERALS SHOWN ARE BASED ON CCTV FOOTAGE. ADDITIONAL LATERALS & CONFLICTS SHALL BE INVESTIGATED BY CONTRACTOR PRIOR TO EXCAVATION.
 2. PROPERTY LINES SHOWN ON THIS PLAN ARE BASED ON GIS DATA AND HAVE NOT BEEN FIELD SURVEYED.
- WATERLINE NOTES:**
1. ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 2. MINIMUM COVER ON ALL WATERLINES SHALL BE 3'.
 3. ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYWA STANDARD G-8 CONCRETE PIER DETAIL.
 4. CONTRACTOR SHALL CONNECT NEW WATER SERVICE LATERALS TO EXISTING SERVICE LATERAL AFTER CONTRACTOR GAINS APPROVAL FROM REQUIRED TESTING ON NEW WATERLINES.
 5. CONTRACTOR SHALL COORDINATE ALL WATER ABANDONMENT AND SUBSEQUENT WATER OUTAGES WITH WYWA INSPECTOR.

WESTERN VIRGINIA
WATER AUTHORITY
ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

TIPTON AVE WATERLINE
REPLACEMENT

PLAN & PROFILE

Rev	Description	Date	By

Designed: CDA
Drawn: DRJ
Checked: NSS
Approved:
Date:
Project:

2
Sheet 2 of 3