


DATE STARTED Dec. 16, 1960				
DATE COMP. JAN. 23, 1961				
FEET MAIN	SIZE	VALVE	VAULT	BOX
1345	8"			
F. H. COMP.				
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: WEDDLE PLUMBING & HEATING				
NO. 3/4" SERV. INS. NONE				
CITY OR CO. CITY				
DEPT. INSP. D.T. MAXEY				

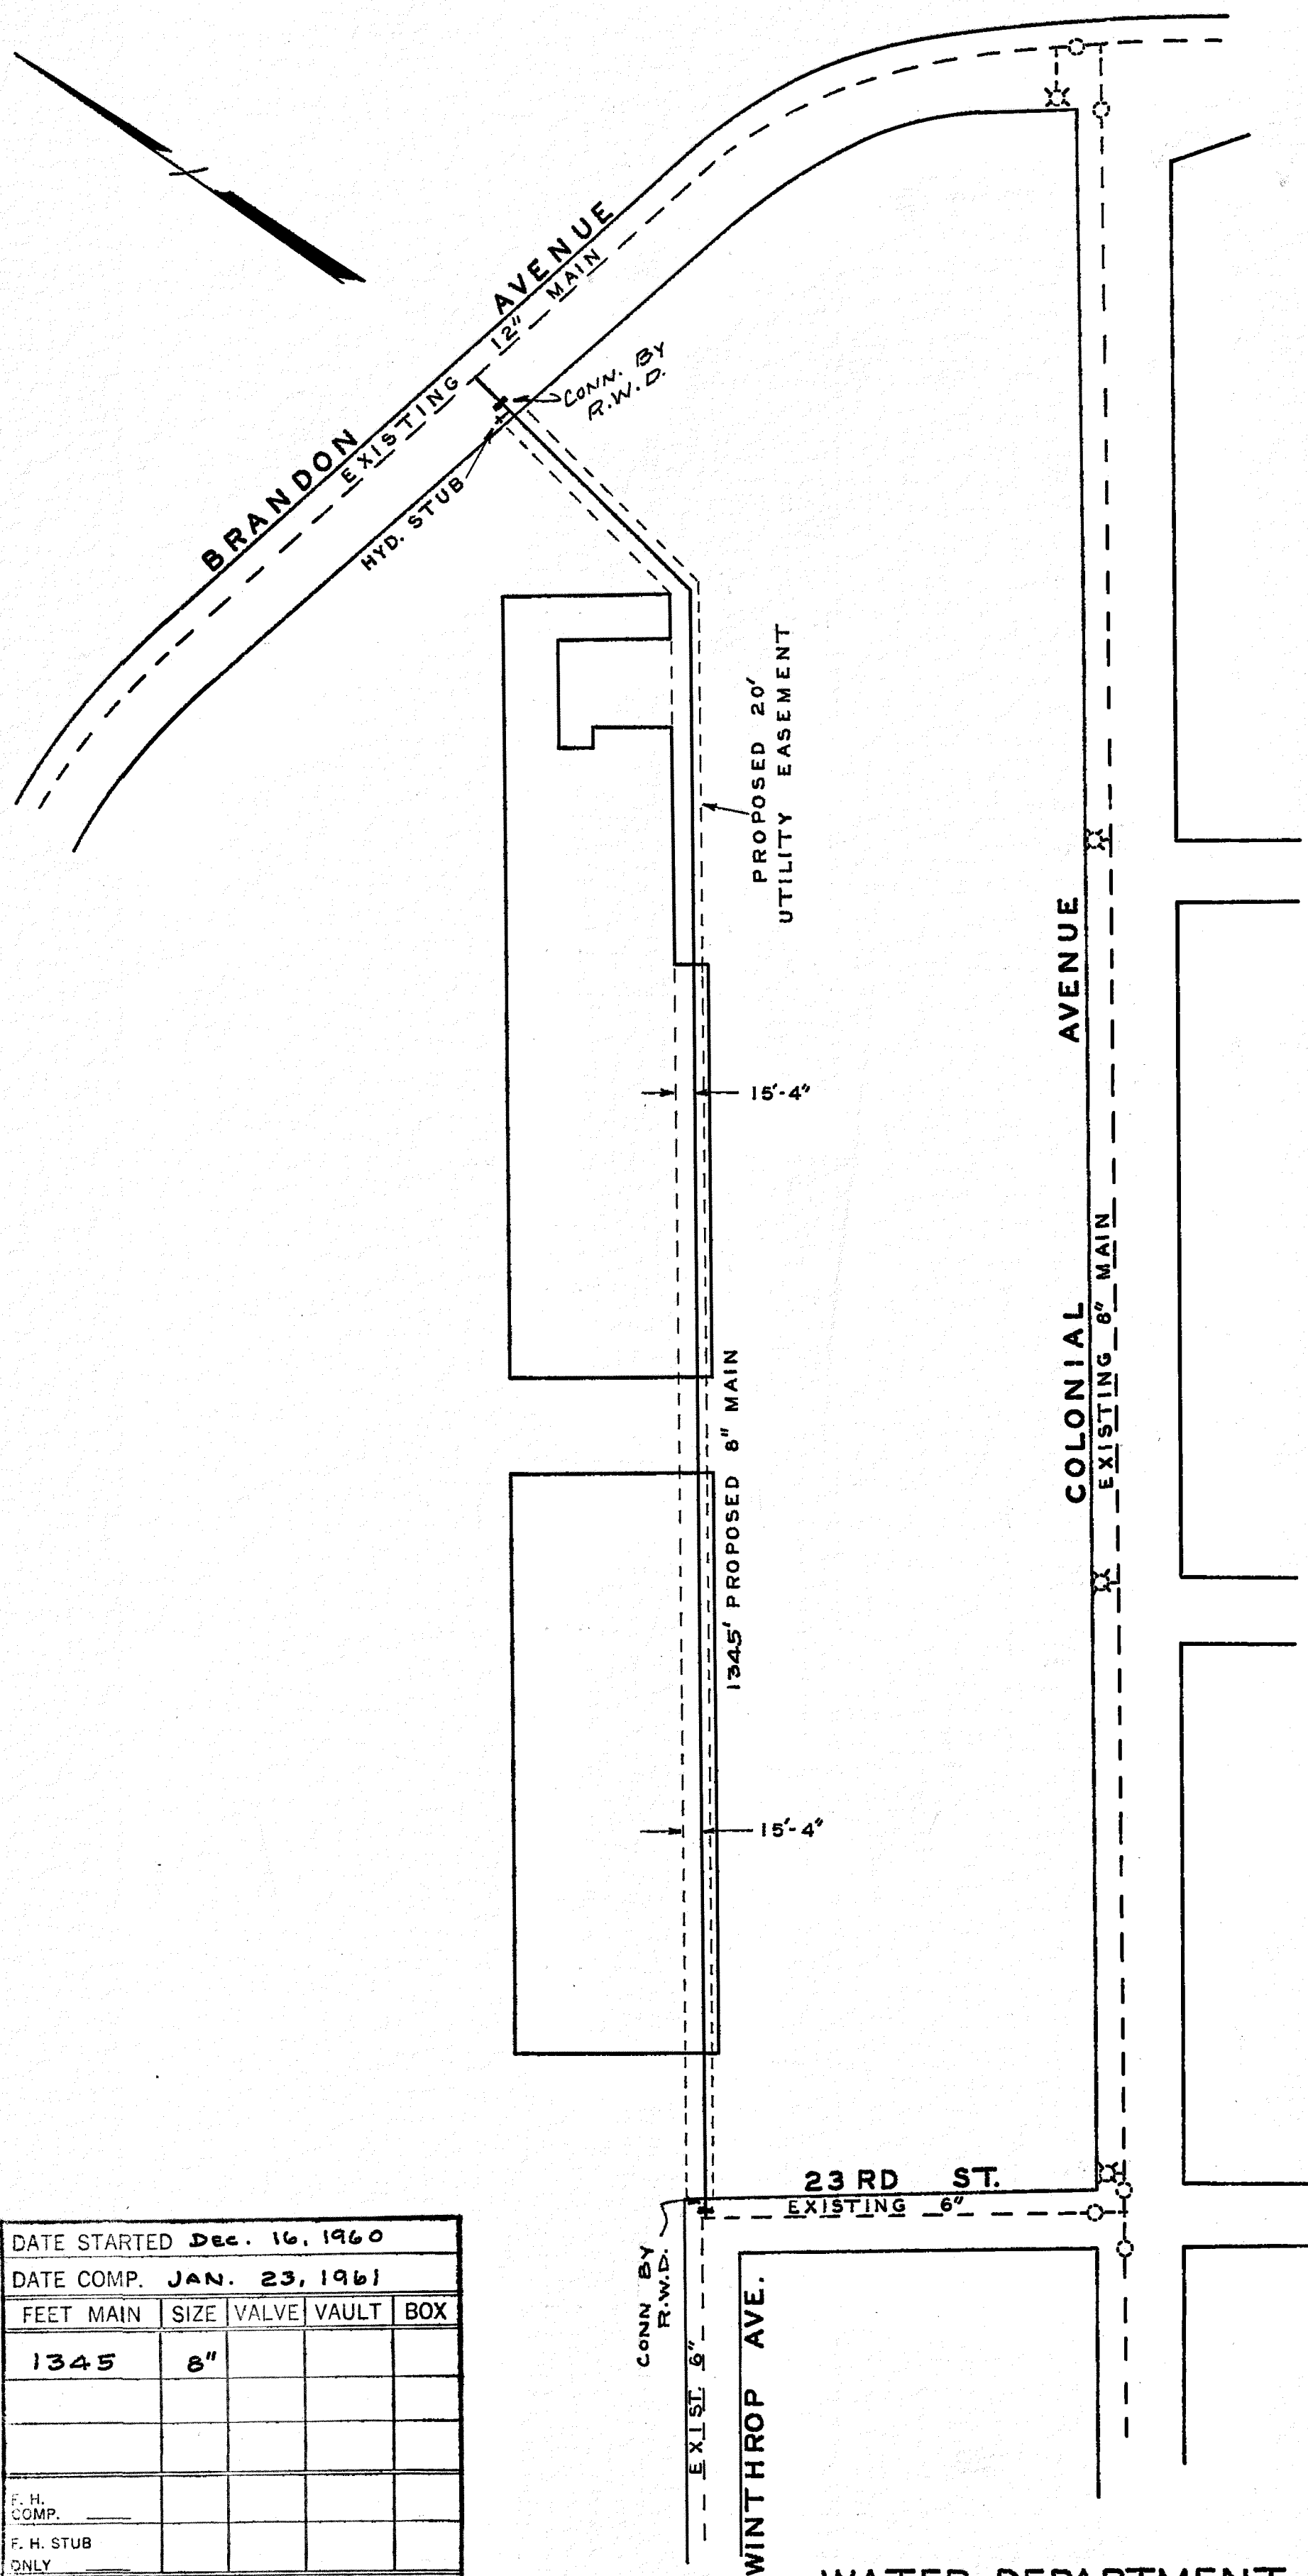

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 TOWERS SHOPPING CENTER
 SCALE - 1" = 100'
 DRAWN BY N.H.C. OCT. 25, 1960