


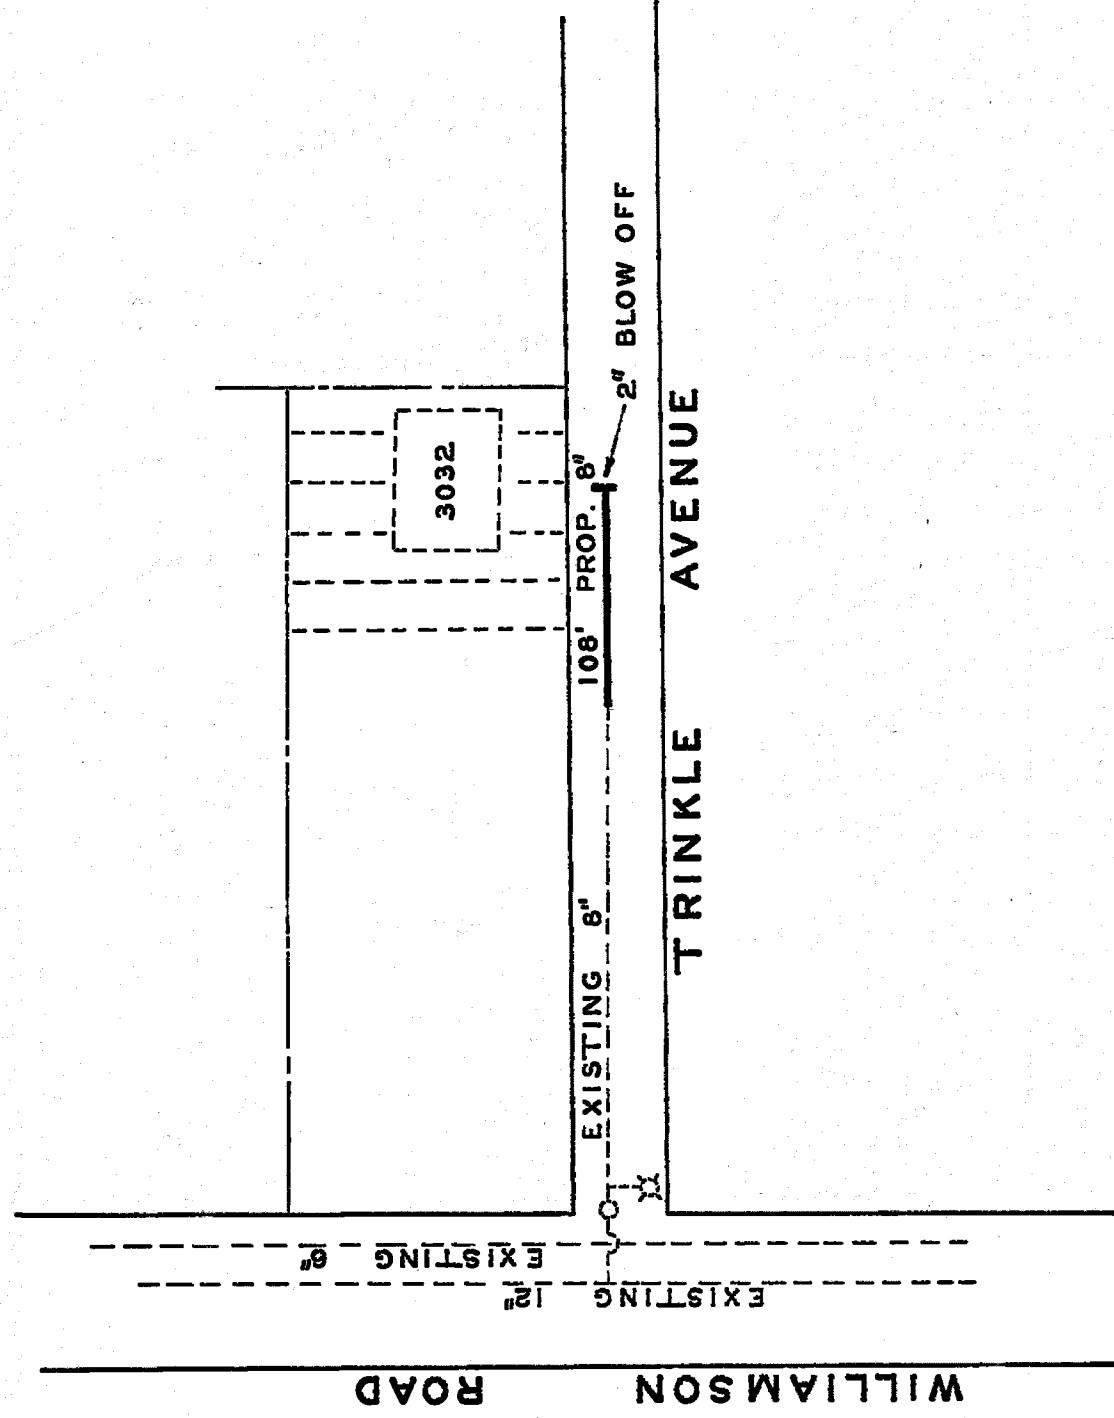

DATE STARTED Nov. 1, 1961			
DATE COMP. Nov. 2, 1961			
FEET MAIN	SIZE	VALVE	VAULT BOX
108	8"	2" BLOW OFF	1
F. H. COMP.			
F. H. STUB ONLY			
SERV. INS. BY:		R.W.D.	
MAINS INS. BY:		R.W.D.	
NO. 3/4" SERV. INS.		1	
CITY OR CO.		CITY	
DEPT. INSP.		J.W.M.	

WATER DEPARTMENT
CITY OF ROANOKE, VA.
TRINKLE AVE. N.W.

SCALE - 1" = 100'
DRAWN BY N.H.C. OCT. 27, 1961