
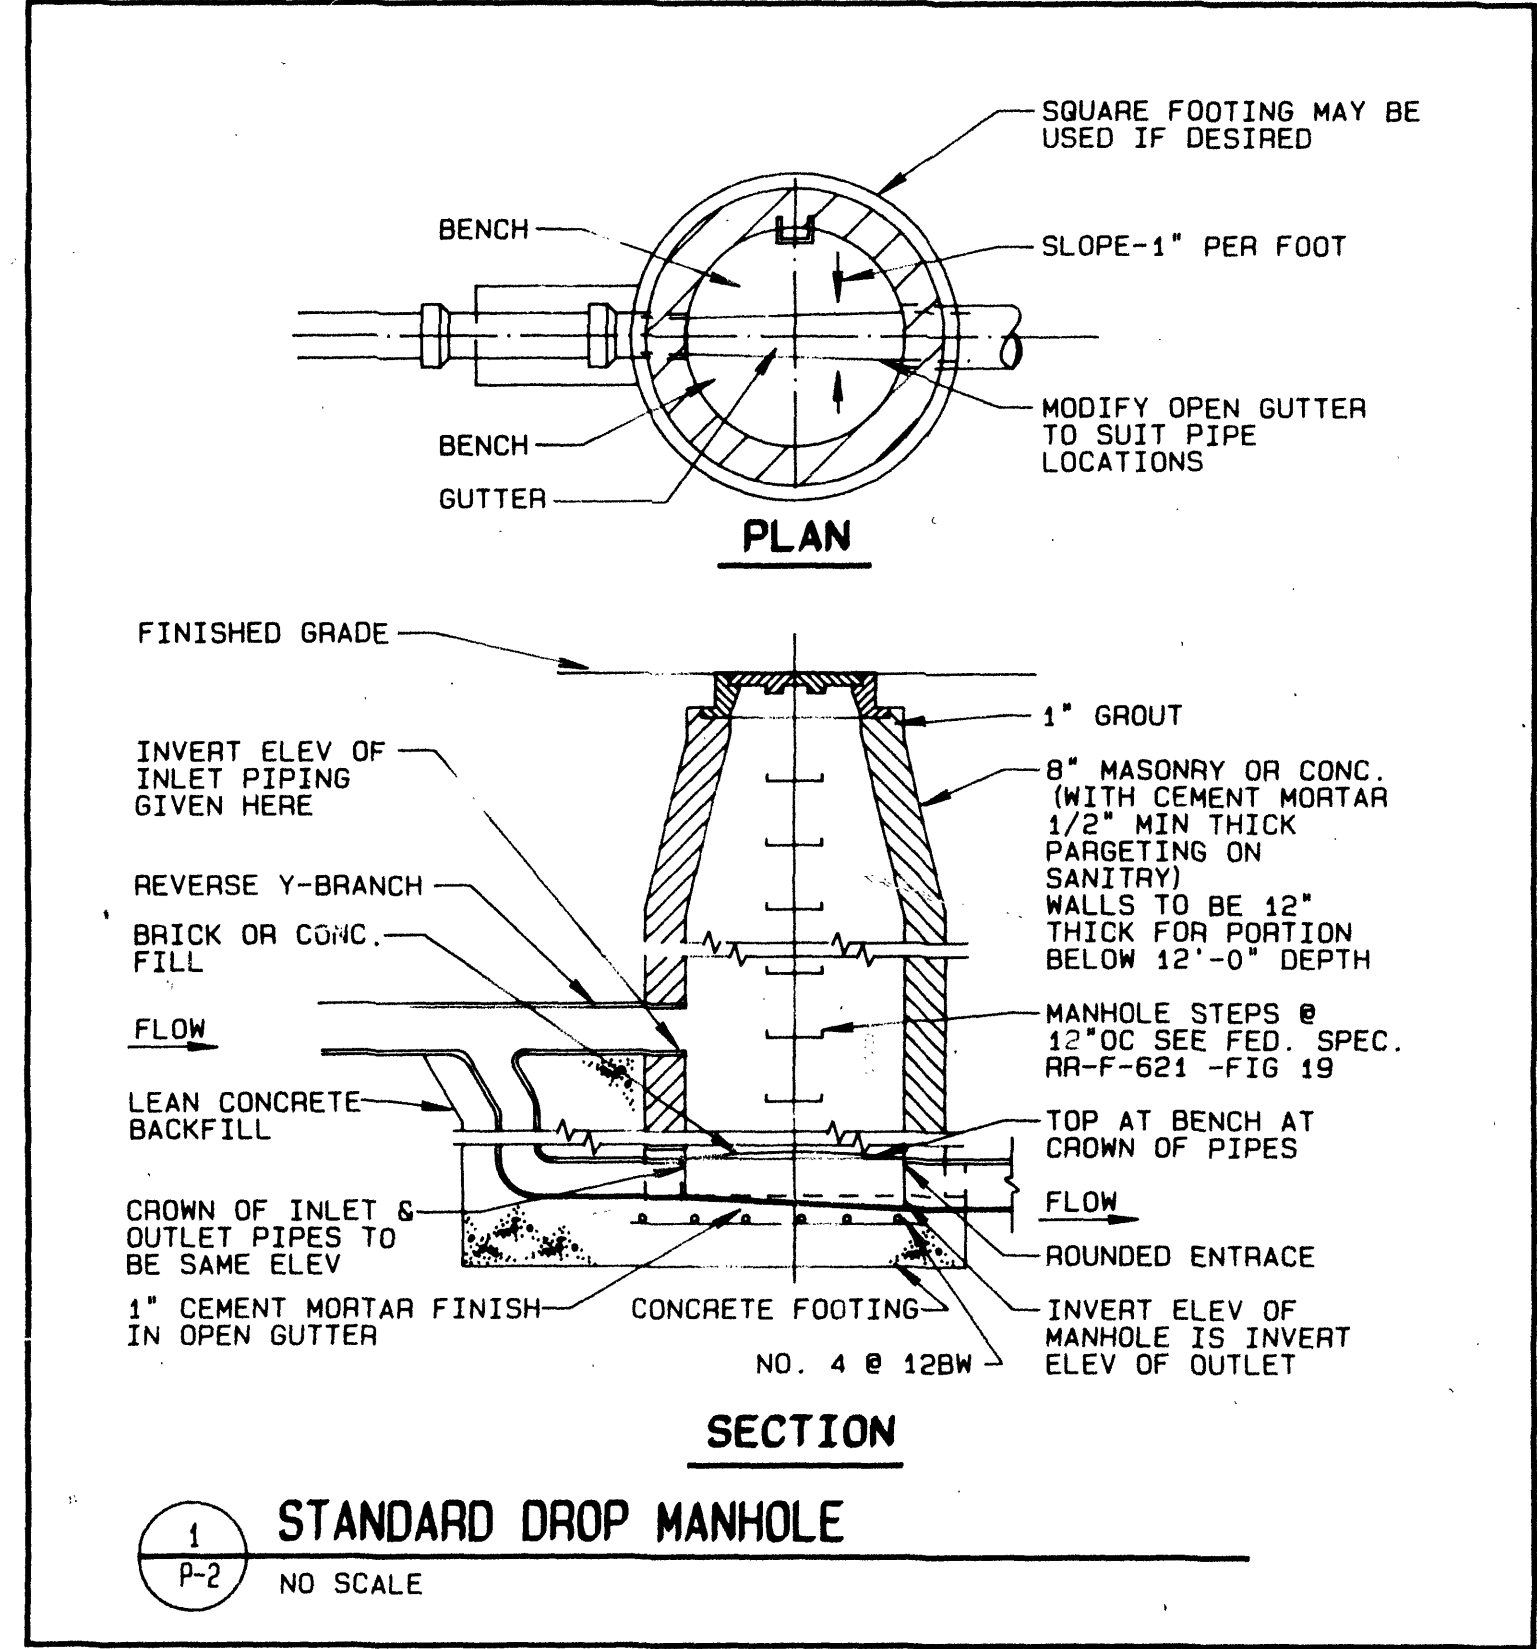


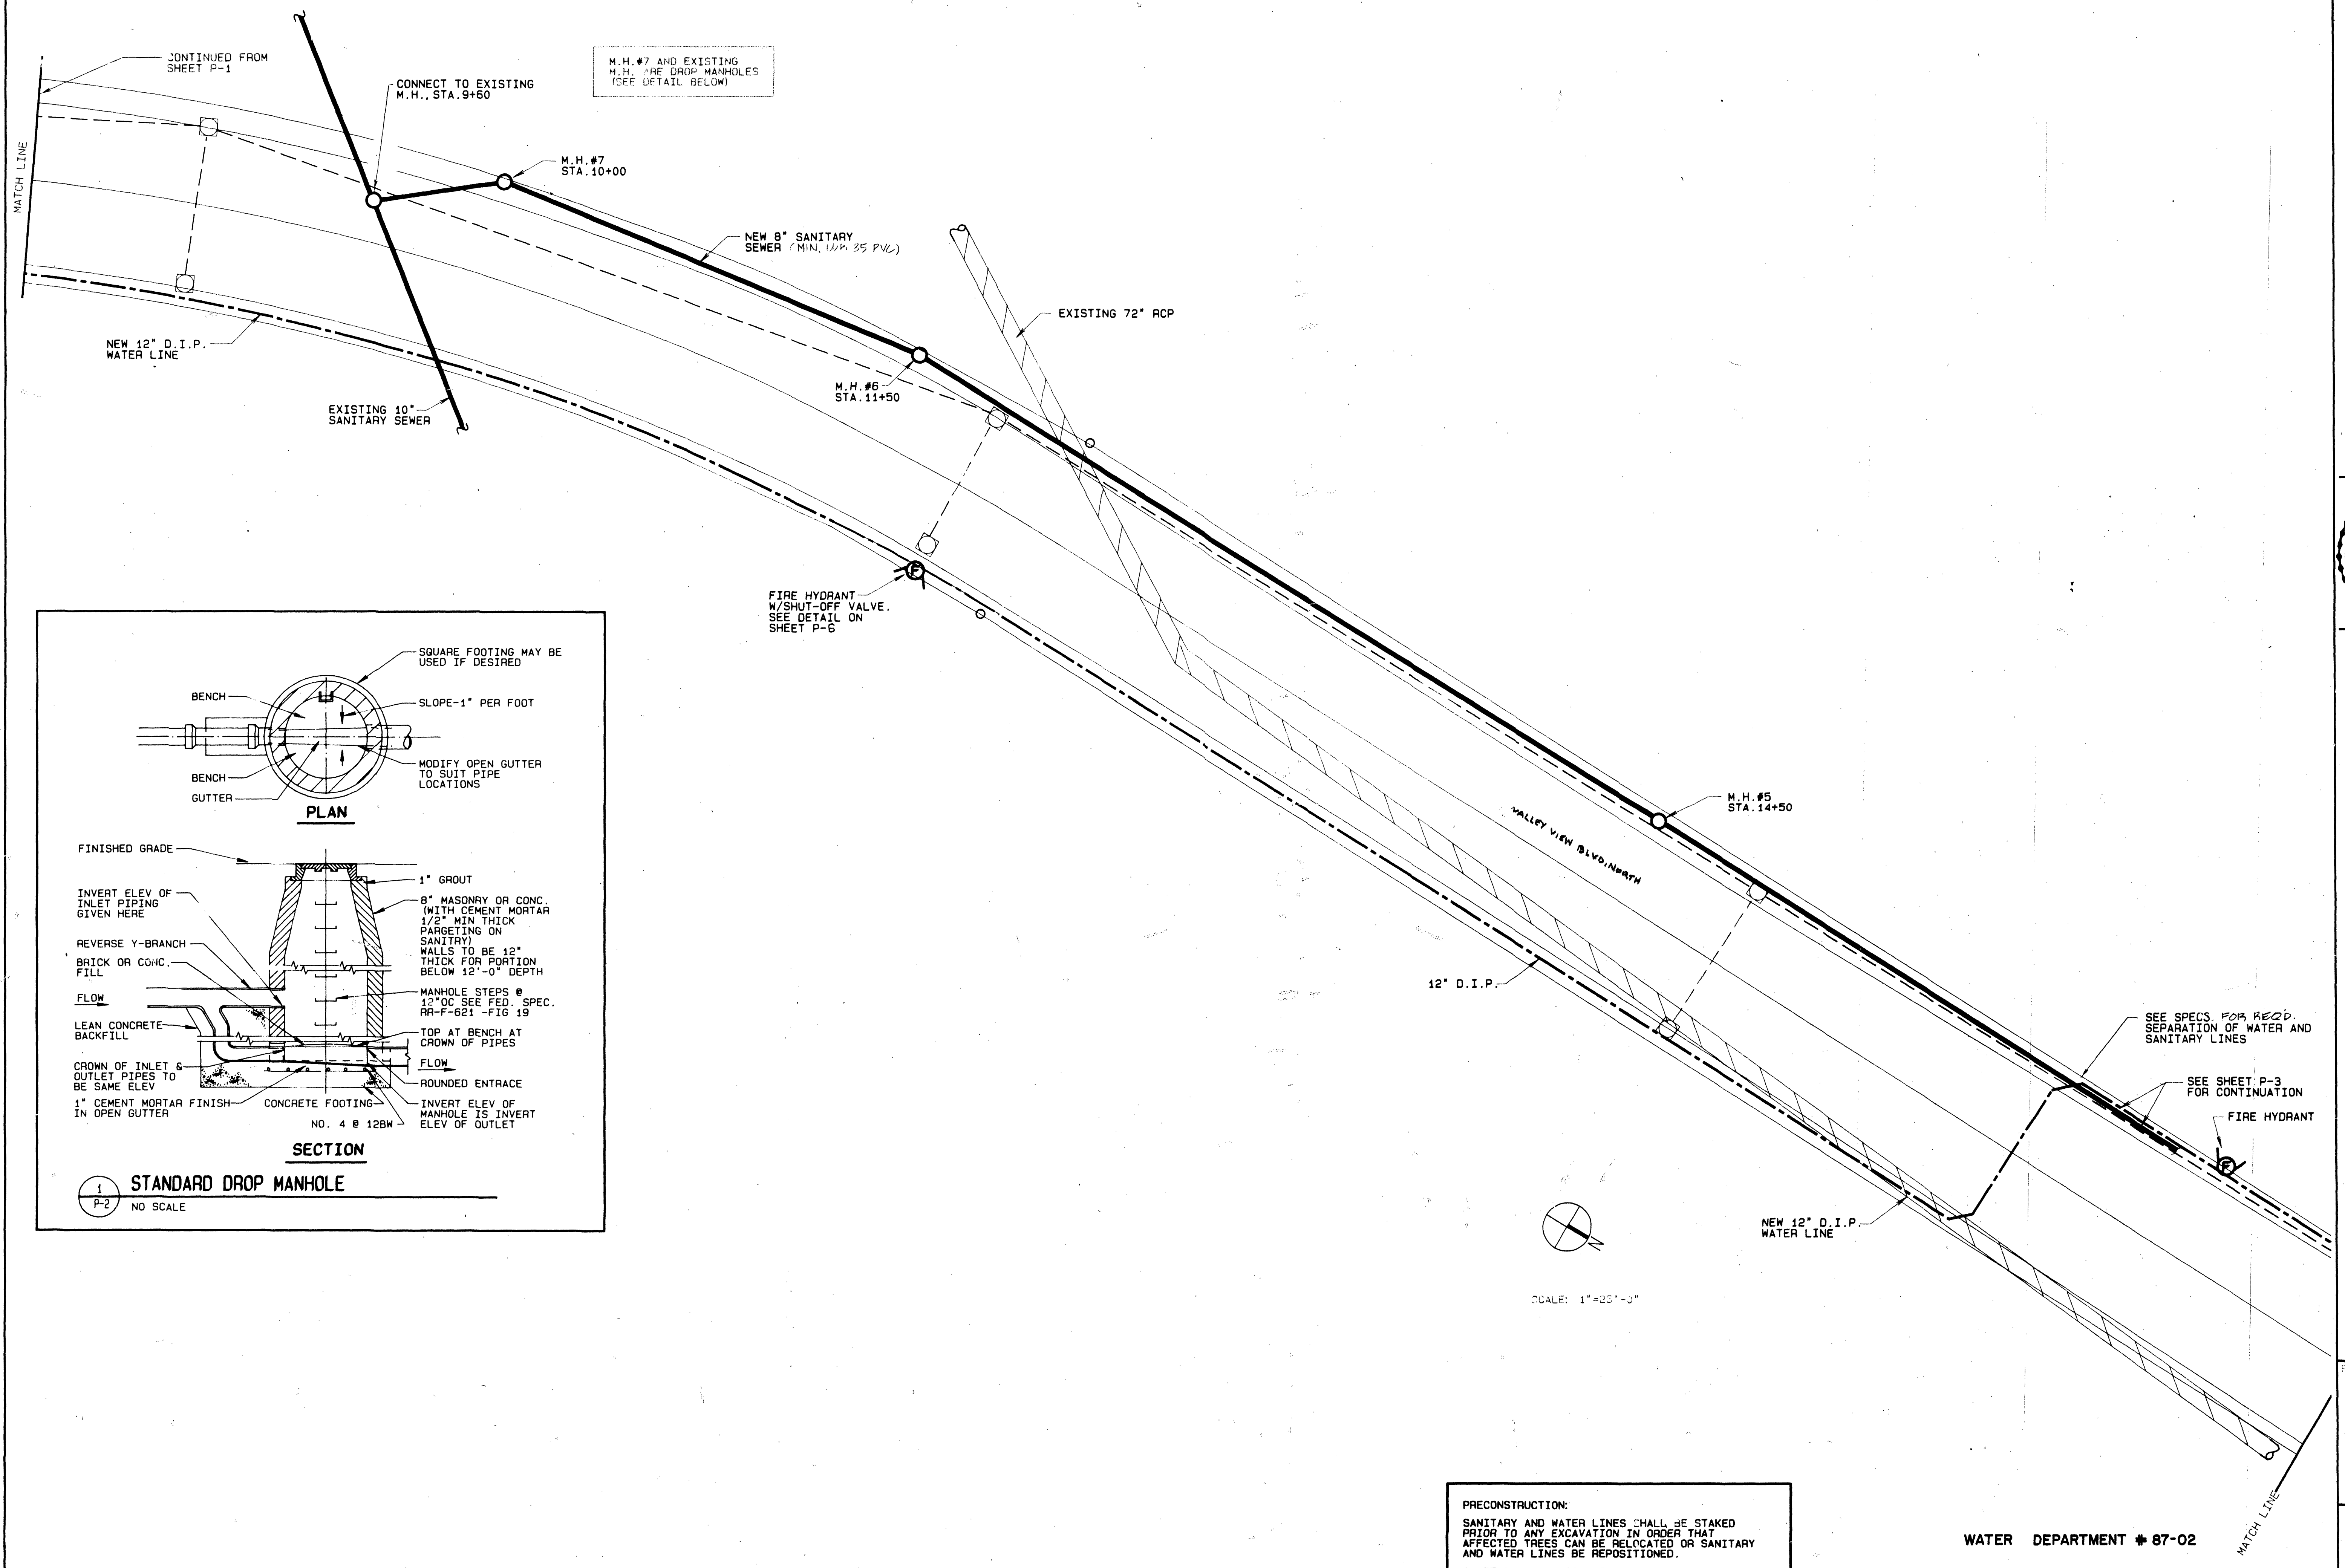

PRECONSTRUCTION:
SANITARY AND WATER LINES SHALL BE STAKED PRIOR TO ANY EXCAVATION IN ORDER THAT AFFECTED TREES CAN BE RELOCATED OR SANITARY AND WATER LINES BE REPOSITIONED.
SANITARY AND WATER LINES SHOULD BE LOCATED AT LEAST 7'-6\"/>

WATER DEPARTMENT # 87-02

ENGINEERING CONSULTANTS
P.O. BOX 2685
8000 Corporate Center Drive
Charlotte, N.C. 28211
(704) 542-5513

M E P S
ASSOCIATES, INC.

COMMONWEALTH OF VIRGINIA
JAMES C. JONES
LICENSE NO. 005558
PROFESSIONAL ENGINEER

**SANITARY SEWER AND WATER MAIN
EXTENSIONS PLAN
VALLEY VIEW SUB-DIVISION**

Project Number	348.01
Date	09/03/86
Drawn By	CAD
Checked By	ECJ
Approved By	ECJ

P 2

Sheet Number 2 of 6