

DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CLEARING & GRUBBING	LS		\$	\$
EXCAVATION	CY			
EMBANKMENT	CY			
FENCING	LF			
STRUCTURES				
ACCESS ROAD				
AS-BUILTS				
SUB-TOTAL				\$
10% CONTINGENCY				\$
TOTAL PROJECT COST				\$

Diagram illustrating a structure for sediment storage and management, showing a cross-section of a dry/wet storage facility. The structure includes a riser crest and a devaterer device. Key components and labels include:

- DESIGN HIGH WATER (DHW) - STORM FLOOD
- MIN. 10'
- CREST OF EMERGENCY SPILLWAY
- 67 C.Y./AC 'DRY' STORAGE
- 67 C.Y./AC 'WET' STORAGE
- RISER CREST
- DEVATERER DEVICE
- SEDIMENT CLEANTOUT POINT ('WET' STORAGE REDUCED TO 34 C.Y./AC)

A cross-sectional diagram of a levee. The top surface is labeled "DESIGN HIGH WATER (25-YR. STORM ELEV.)". A horizontal line across the top is labeled "0.5'". The right slope is labeled "MIN. 2:1" and "MIN. 3:1". A vertical structure on the right is labeled "RISER CREST" and "DEWATERING DEVICE". The area between the water level and the crest is labeled "67 C.Y./AC. 'DRY' STORAGE". The area below the crest is labeled "67 C.Y./AC. 'WET' STORAGE". The bottom of the structure is labeled "SEDIMENT CLEANOUT POINT".

(IP) GRAVEL AND WIRE MESH DROP INLET SEDIMENT FILTER

1. DESIGN OF DETENTION BASINS SHALL CONFORM TO THE REQUIREMENTS OF THE COUNTY OF ROANOKE DRAINAGE STANDARDS (REF. SECTIONS 50302, 50303, AND 50502). THE DESIGN OF THE FACILITY AND PREPARATION OF AS-BUILT PLANS SHALL BE BY A CERTIFIED PROFESSIONAL ENGINEER LICENSED TO PRACTICE IN THE COMMONWEALTH OF VIRGINIA.
2. ACCESS TO THE FACILITY MUST BE PROVIDED IN ACCORDANCE WITH THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
3. IF THE FACILITY IS OVER FOUR (4) FEET DEEP, TAKES OVER TWO (2) HOURS TO DRAIN OR THE INTERIOR SLOPE EXCEEDS 3 (3) TO 1 (1V), PERMANENT FENCING MAY BE REQUIRED, ADDITIONALLY, IF THE FACILITY IS IN A CONGESTED AREA OR WILL IN ANY WAY POSE A HAZARD TO THE GENERAL PUBLIC, FENCING MAY BE REQUIRED. FENCING SHALL BE A MINIMUM OF SIX (6) FEET HIGH, A MINIMUM OF STANDARD NINE GAUGE LINK FENCE, AND MUST HAVE ONE OR MORE LOCKING DOUBLE GATES (MINIMUM TEN FEET WIDE) FOR ACCESS.
4. DETENTION PONDS SHALL BE BONDED IN ACCORDANCE WITH THE ROANOKE COUNTY BONDING POLICY FOR SUBDIVISION AND SITE DEVELOPMENT. A SEPARATE BOND FOR THE DETENTION FACILITY WILL BE REQUIRED AND ADMINISTERED APART FROM THE SUBDIVISION DEVELOPMENT BOND. REFERENCE ESTIMATE - THIS SHEET.
5. REFERENCE THE COUNTY OF ROANOKE DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION, FOR ACCEPTANCE AND MAINTENANCE OF THE FACILITY. CERTIFIED AS-BUILTS ARE REQUIRED AND MUST INCLUDE:
 - A. DIMENSIONS OF THE FACILITY
 - B. VOLUME @ MAXIMUM DEPTH
 - C. ELEVATIONS OF STRUCTURES, SPILLWAYS, AND TOP
 - D. MATERIALS VERIFICATION INCLUDING RESULTS OF DENSITY TESTS CONDUCTED BY AN INDEPENDENT SOIL TESTING LABORATORY
 - E. LOCATION AND ELEVATION OF BENCHMARK.
6. ONE FOOT MINIMUM FREEBOARD REQUIRED FOR THE 100 YR WATER SURFACE ELEVATION.

1. SITE PREPARATION SHALL BE IN ACCORDANCE WITH THE COUNTY OF RICHMOND DESIGN AND CONSTRUCTION STANDARDS FOR DETENTION PONDS, LATEST EDITION.
2. SLOPES STEEPER THAN 3 TO 1 (HORIZONTAL TO VERTICAL) SHALL BE BENCHED OR STEPPED PRIOR TO PLACING FILL ON THEM.
3. ON-SITE FILL MATERIAL OR BORROW FILL MATERIAL MAY BE UTILIZED. FILL MATERIAL SOILS, IN GENERAL:
 - A. SHALL BE COMPACTABLE
 - B. SHALL BE WITHIN AN ACCEPTABLE RANGE OF MOISTURE CONTENT
 - C. WHICH IS READILY CONTROLLED
 - D. SHALL NOT BE HIGHLY SUSCEPTIBLE TO VOLUME CHANGE (SHRINKAGE OR SWELL) OR SETTLEMENT

4. FILL MATERIALS CONTAINING ROCKS LARGER THAN SIX (6) INCHES (15.2 CM) SHALL NOT BE USED. THE UPPERMOST TWO (2) FEET (61 CM) SHALL NOT HAVE ANY ROCK LARGER THAN TWO (2) INCHES (5.1 CM) IN DIAMETER.
5. THE APPROVED FILL SHALL BE PLACED IN EIGHT (8) INCH (20 CM) LOOSE LIFTS. EACH LIFT SHALL BE SPREAD IN UNIFORM LAYERS. FILL SOIL SHALL BE UTILIZED ONLY WITHIN A MOISTURE RANGE OF SIX (6) TO THE OPTIMUM MOISTURE CONTENT. COMPACTION OF THE FILL SHALL BE PERFORMED WITH APPROVED EQUIPMENT. COMPACTION OF THE LAYERS SHALL BE CONTINUOUS AND UNIFORM.

6. EMBANKMENT MATERIAL IN FILL AREAS SHALL BE PLACED IN LIFTS NOT EXCEEDING EIGHT (8) INCHES AND SHALL BE COMPACTED TO A MINIMUM 95% DENSITY IN ACCORDANCE WITH SECTION 303 OF THE VIRGINIA DEPARTMENT OF TRANSPORTATION ROAD AND BRIDGE SPECIFICATIONS.

- FIELD DENSITY TESTS ARE TO BE CONDUCTED BY AN INDEPENDENT SOILS TESTING LABORATORY UNDER THE DIRECTION OF A QUALIFIED GEOTECHNICAL ENGINEER. THE RESULTS OF THESE TESTS SHALL BE SUBMITTED TO THE COUNTY OF ROCKLAND WITH THE BUILDING PLANS AS A CONDITION OF ACCEPTANCE OF THE FACILITY BY THE COUNTY. FIELD DENSITY TESTS AS DIRECTED BY THE ENGINEER SHALL BE PERFORMED PERIODICALLY TO DETERMINE THE DEGREE OF COMPACTION. ANY AREAS FAILING TO MEET THE ABOVE REQUIREMENTS SHALL BE REWORKED AND/OR RECOMPACTED UNTIL THE REQUIRED DEGREE OF COMPACTION IS ACHIEVED.

8. ANTI-SEEP COLLARS SHALL BE INSTALLED IN ACCORDANCE WITH THE REQUIREMENTS OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.











- 9 ALL DISTURBED AREAS SHALL BE COVERED WITH FOUR (4) INCHES OF TOPSOIL AND SEEDED.

10. THE MINIMUM SLOPE OF THE BASIN FLOOR SHALL BE ONE (1) PERCENT GRADED TO DRAIN TO THE PRINCIPAL SPILLWAY.



- 2' MIN. DEPTH

This method of Inlet protection is applicable where heavy flows are expected and where an overflow capability and ease of maintenance are desirable.

NO.	TITLE	KEY	SYMBOL	NO.	TITLE	KEY	SYMBOL
3.01	SAFETY FENCE	(SAF)		3.20	ROCK CHECK DAMS	(CD)	
3.02	TEMPORARY GRAVEL CONSTRUCTION ENTRANCE	(CE)		3.21	LEVEL SPREADER	(LS)	
3.03	CONSTRUCTION ROAD STABILIZATION	(CRS)		3.22	VEGETATIVE STREAMBANK STABILIZATION	(VSS)	
3.04	STRAW BALE BARRIER	(STB)		3.23	STRUCTURAL STREAMBANK STABILIZATION	(SSS)	
3.05	SILT FENCE	(SF)		3.24	TEMPORARY VEHICULAR STREAM CROSSING	(VSC)	
3.06	BRUSH BARRIER	(BB)		3.25	UTILITY STREAM CROSSING	(USC)	
3.07	STORM DRAIN INLET PROTECTION	(IP)		3.26	DEWATERING STRUCTURE	(DS)	
3.08	CULVERT INLET PROTECTION	(CIP)		3.27	TURBIDITY CURTAIN	(TC)	
3.09	TEMPORARY DIVERSION DIKE	(DD)		3.28	SUBSURFACE DRAIN	(SD)	
3.10	TEMPORARY FILL DIVERSION	(FD)		3.29	SURFACE ROUGHENING	(SR)	
3.11	TEMPORARY RIGHT-OF-WAY DIVERSION	(RWD)		3.30	TOPSOILING	(TO)	
3.12	DIVERSION	(DV)		3.31	TEMPORARY SEEDING	(TS)	
3.13	TEMPORARY SEDIMENT TRAP	(ST)		3.32	PERMANENT SEEDING	(PS)	
3.14	TEMPORARY SEDIMENT BASIN	(SB)		3.33	SODDING	(SD)	
3.15	TEMPORARY SLOPE DRAIN	(TSD)		3.34	BERMUDA GRASS AND ZOYSIA GRASS ESTABLISHMENT	(B/H)	
3.16	PAVED FLUME	(PF)		3.35	MULCHING	(MU)	
3.17	STORMWATER CONVEYANCE CHANNEL	(SCC)		3.36	SOIL STABILIZATION BLANKETS AND MATTING	(BL/ZE)	
3.18	OUTLET PROTECTION	(OP)		3.37	TREES, SHRUBS, VINES AND GROUND COVERS	(VEG)	
3.19	RIPRAP	(RR)		3.38	TREE PRESERVATION AND PROTECTION	(TP)	
				3.39	DUST CONTROL	(DC)	

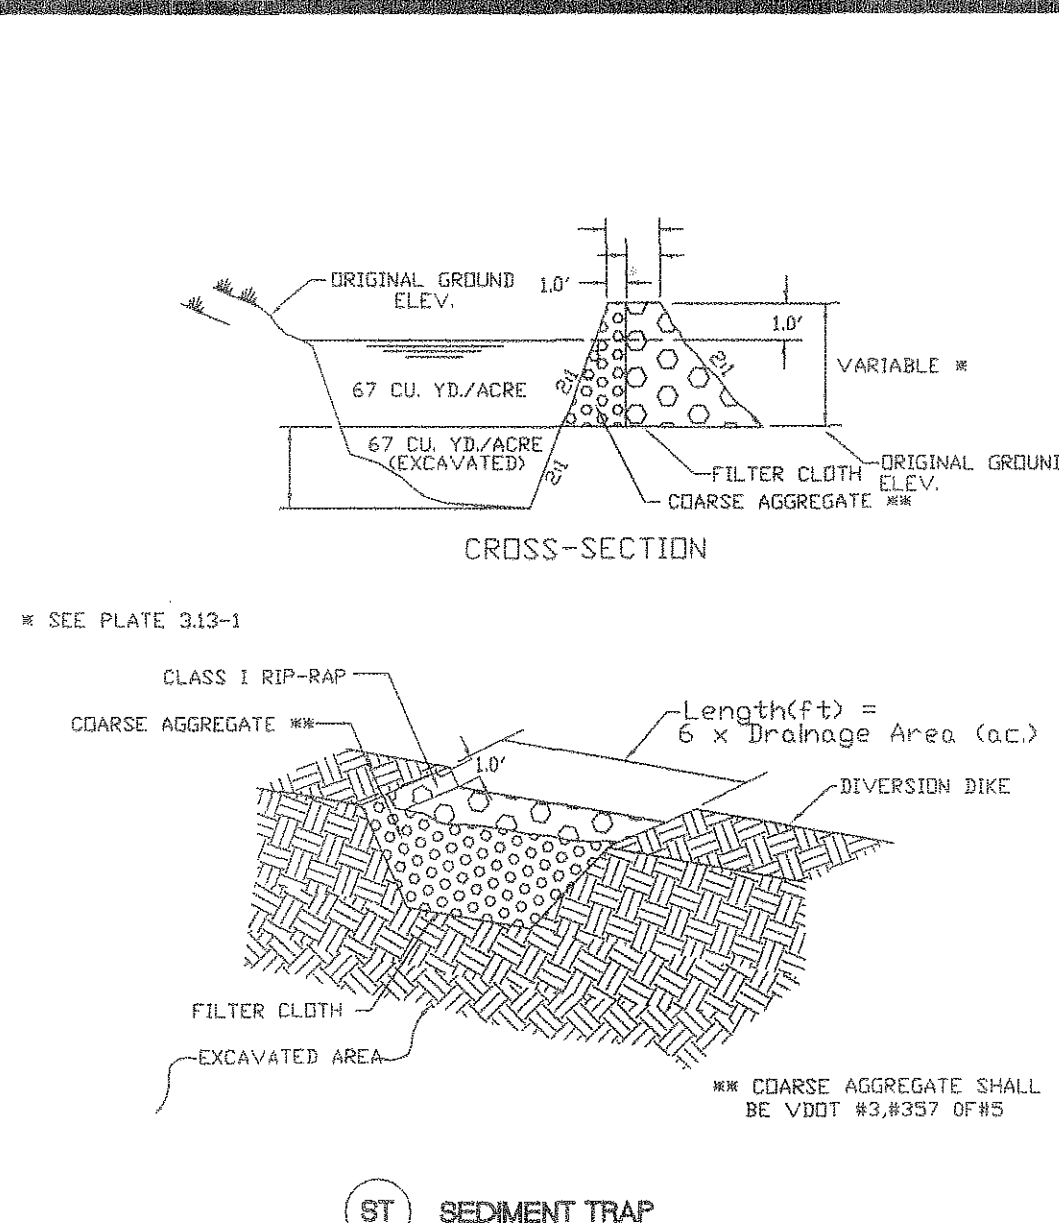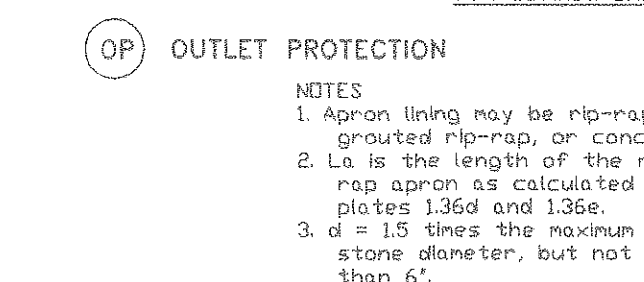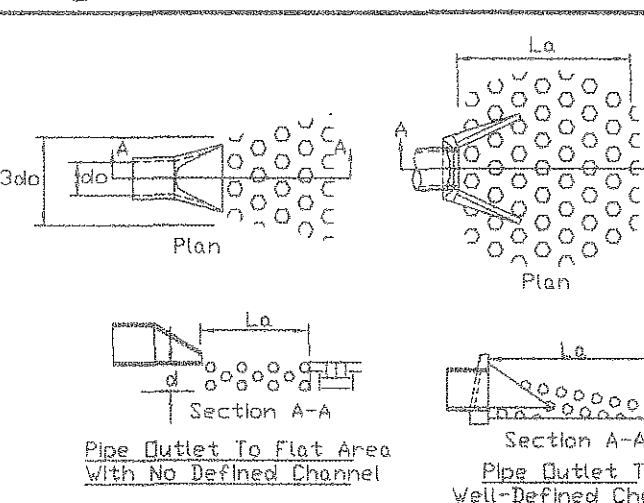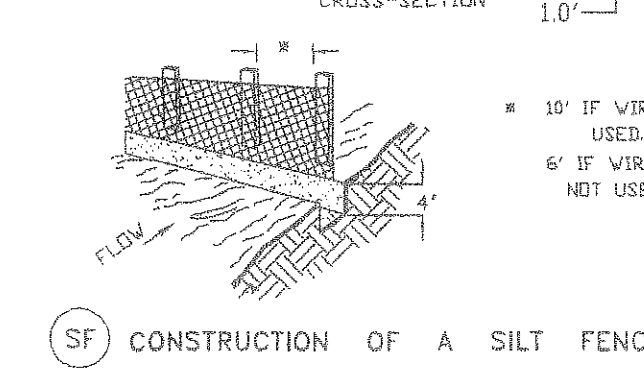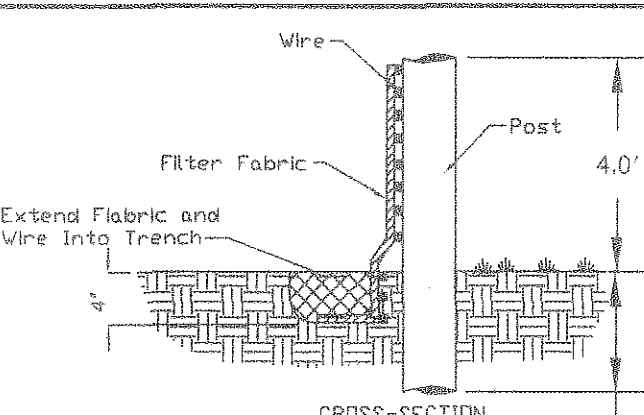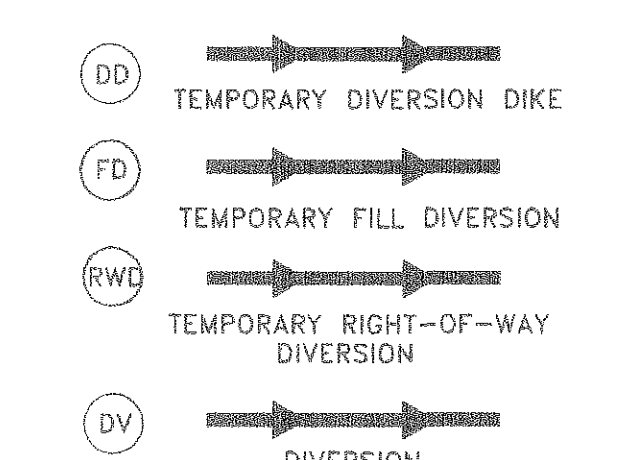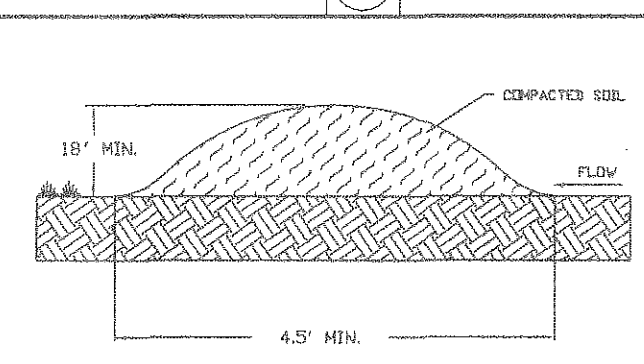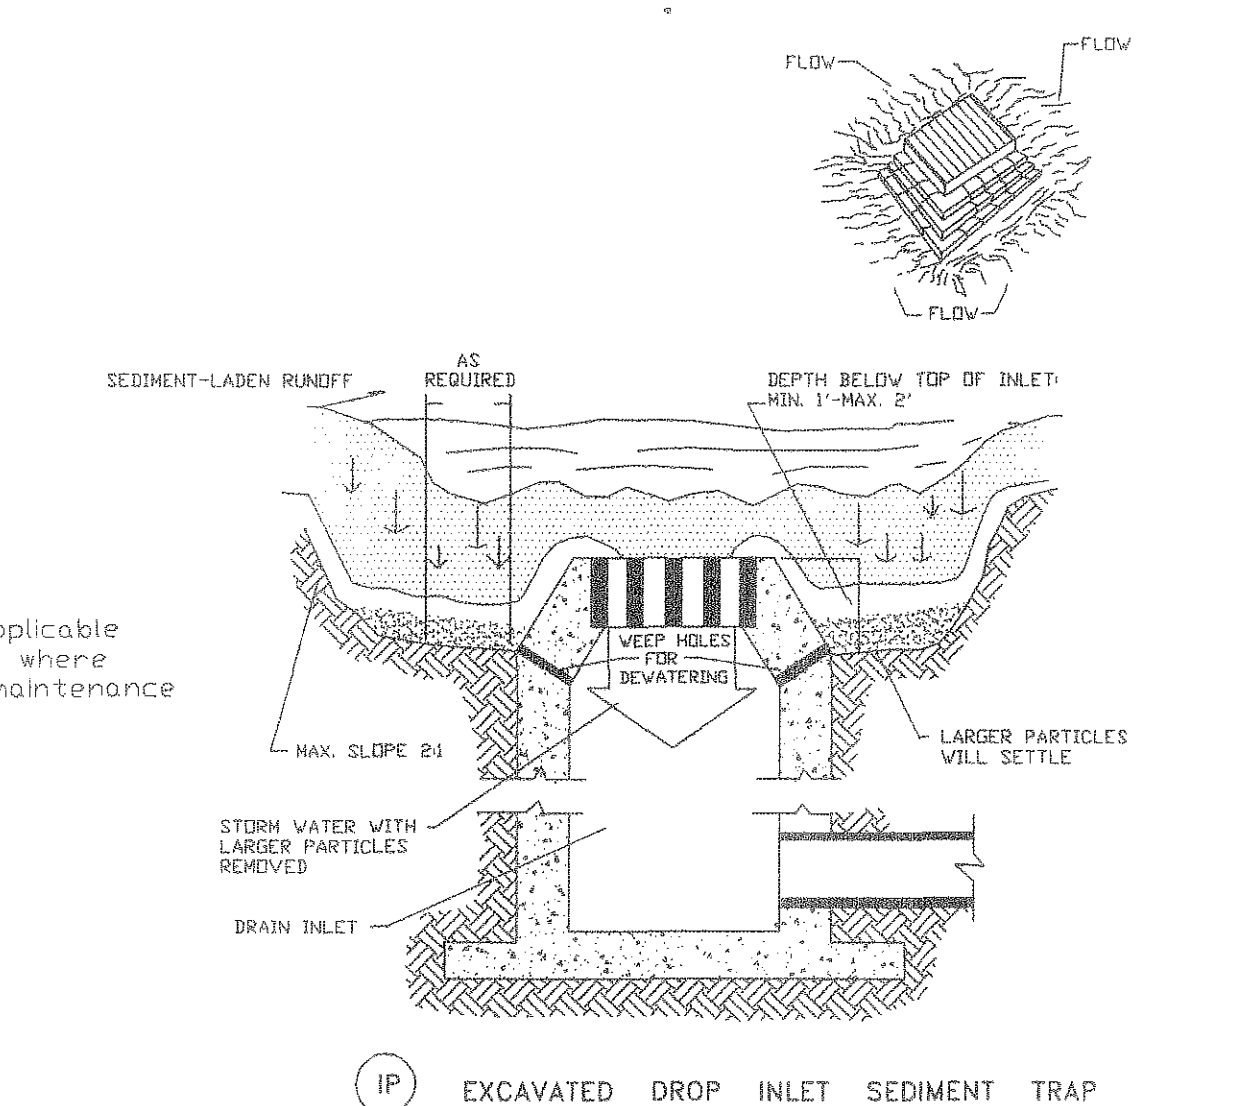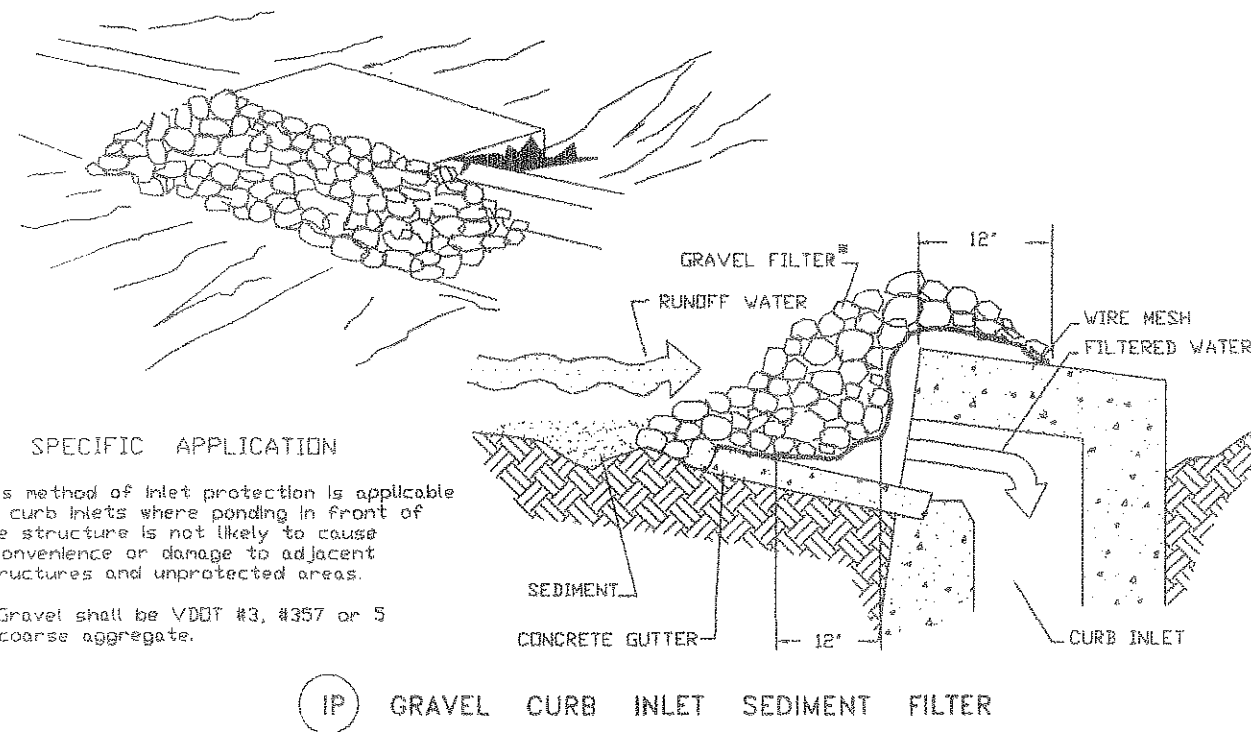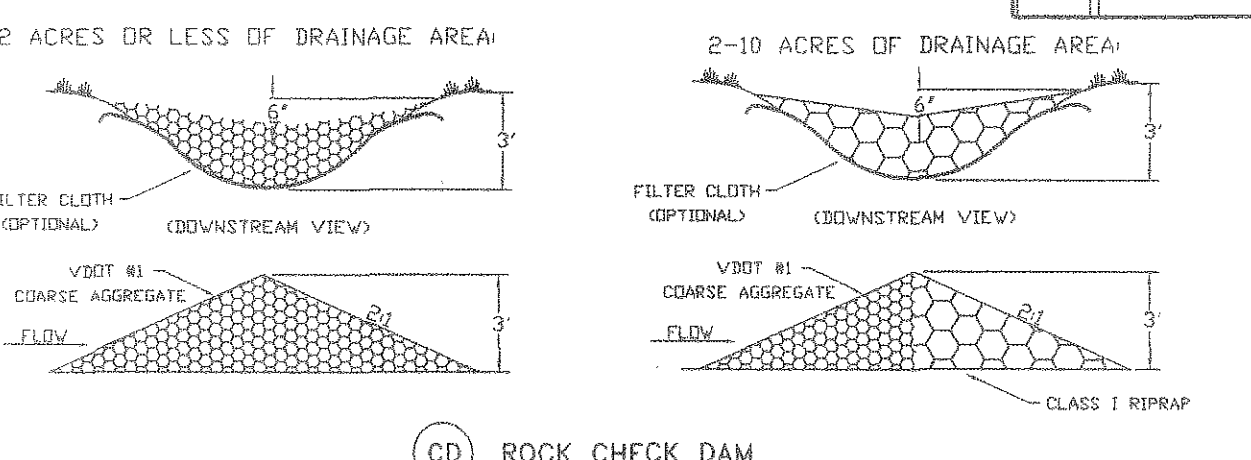

NOTE;
FOR AREAS LESS THAN 3.0 ACRES. FOR AREAS
LARGER THAN 3.0 ACRES A SEDIMENT BASIN
IS REQUIRED. SEE DETAIL THIS SHEET.

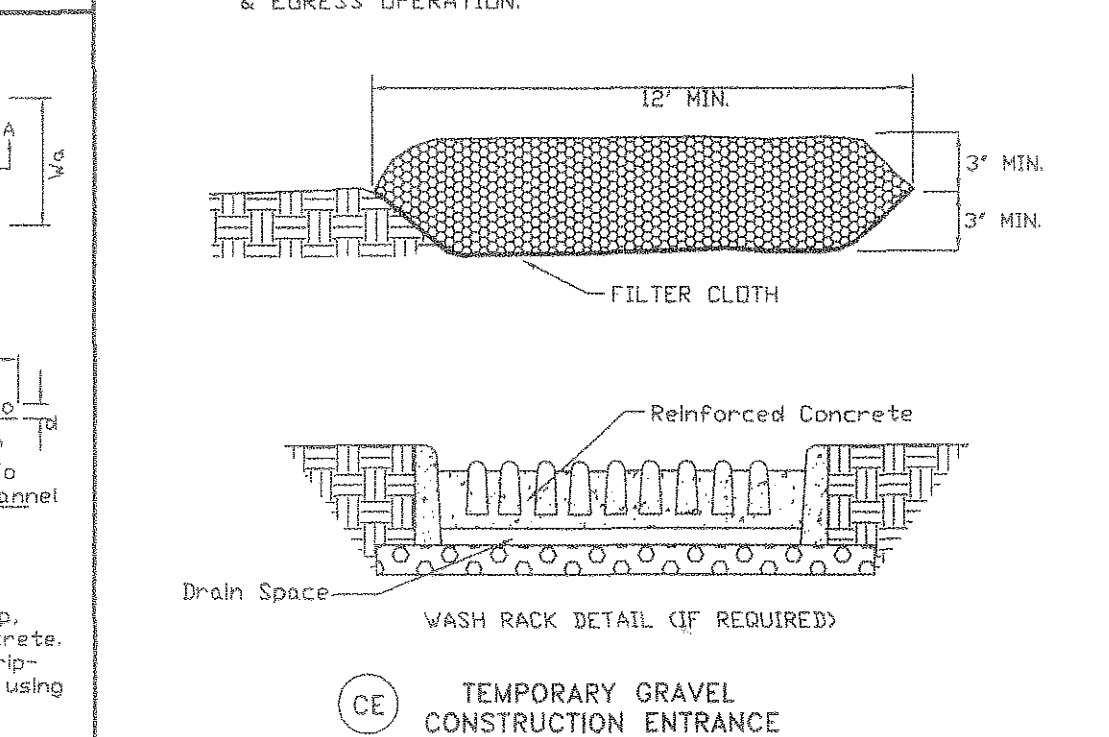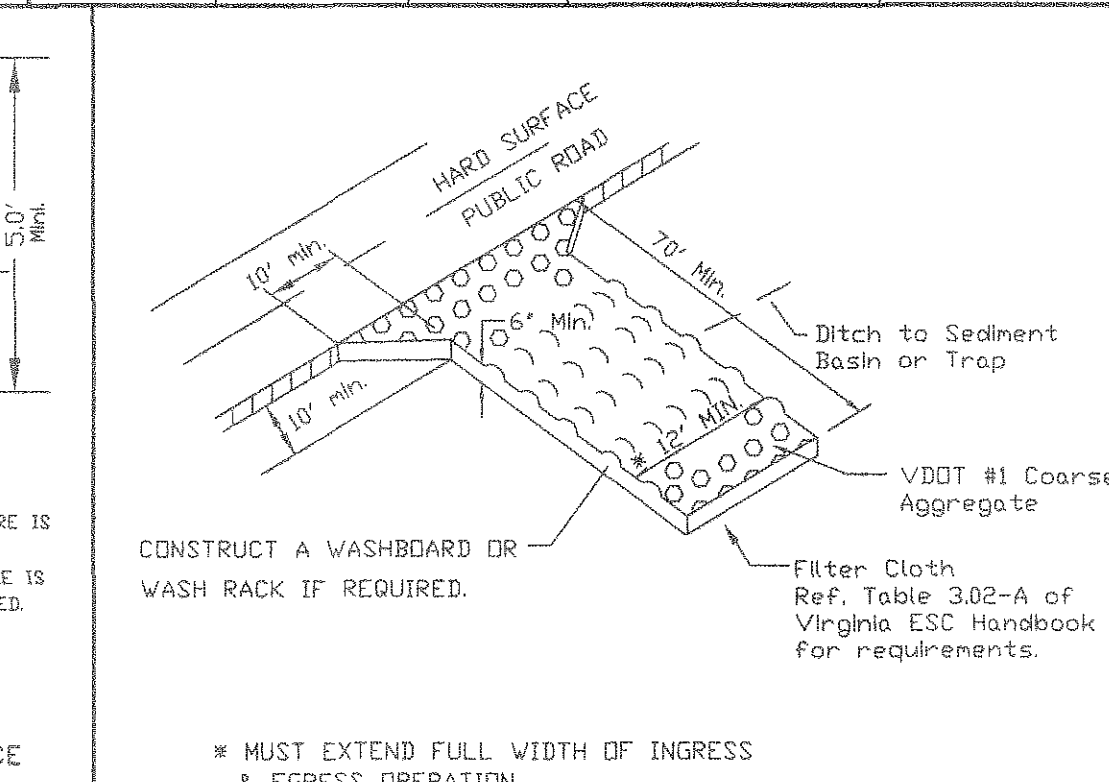[illegible]

DESCRIPTION	UNIT	QUANTITY	UNIT COST	TOTAL COST
CONSTRUCTION ENTRANCE	EA	1	700.00	\$ 700.00
SILT FENCE	LF	1,250	3.00	3,750.00
INLET PROTECTION	EA	13	50.00	650.00
TEMPORARY DIVERSION DIKE	LF	4,050	2.00	8,100.00
TEMPORARY FILL DIVERSION	LF			
SEDIMENT TRAP	EA	2	750.00	1,500.00
CHECK DAM	EA			
PERMANENT SEEDING	ACRE	6.3	1,200.00	7,560.00
OUTLET PROTECTION	EA	3	100.00	300.00
SEDIMENT BASIN	EA	1	1,200.00	1,200.00
SUB-TOTAL				\$ 23,460.00
10% CONTINGENCY				\$ 2,340.00
TOTAL PROJECT COST				\$ 25,800.00

1. ALL SOIL EROSION & SEDIMENT CONTROL MEASURES SHALL BE ACCOMPLISHED IN STRICT ACCORDANCE WITH THE STANDARDS AND SPECIFICATIONS CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.
2. THE APPROVING AUTHORITY MAY ADD TO, DELETE, RELOCATE, CHANGE, OR OTHERWISE MODIFY CERTAIN EROSION AND SEDIMENT CONTROL MEASURES WHERE FIELD CONDITIONS ARE ENCOUNTERED THAT WARRANT SUCH MODIFICATIONS.
3. ALL SOIL EROSION AND SEDIMENT CONTROL MEASURES AS SHOWN ON THE PLAN SHALL BE PLACED IN ADVANCE OF THE WORK BEING PERFORMED, AS FAR AS PRACTICAL.
4. IN NO CASE DURING CONSTRUCTION SHALL WATER RUNOFF BE DIVERTED OR ALLOWED TO FLOW TO LOCATIONS WHERE ADEQUATE PROTECTION HAS NOT BEEN PROVIDED.
5. IT SHALL BE THE CONTRACTOR'S RESPONSIBILITY TO LEAVE THE SITE ADEQUATELY PROTECTED AGAINST EROSION, SEDIMENTATION, OR ANY DAMAGE TO ANY ADJACENT PROPERTY AT THE END OF EACH DAY'S WORK.
6. FOR THE EROSION CONTROL, KEY SYMBOLS SHOWN ON THE PLANS, REFER TO THE VIRGINIA UNIFORM CODING SYSTEM FOR EROSION AND SEDIMENT CONTROL PRACTICES CONTAINED IN THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. THESE SYMBOLS AND KEY SHALL BE UTILIZED ON ALL EROSION CONTROL PLANS SUBMITTED TO RANDOLPH COUNTY.

TYPE A	TYPE B (SLOPES 3:1 OR STEEPER)
MBER TO 1 FEBRUARY FESCUE @ 5 LB / 1000 SF RY WINTER RYE @ 1/2 LB / 1000 SF	15 MARCH TO 1 MAY CROWN VETCH @ 1/2 LB / 1000 SF PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
MBER TO 1 JUNE FESCUE @ 5 LB / 1000 SF AL RYE @ 1/2 LB / 1000 SF	RED TOP @ 1/8 LB / 1000 SF
MBER TO 1 SEPTEMBER FESCUE @ 5 LB / 1000 SF MAN MILLET @ 1/2 LB / 1000 SF	15 AUGUST TO 1 OCTOBER CROWN VETCH @ 1/2 LB / 1000 SF PERENNIAL RYEGRASS @ 1/2 LB / 1000 SF
MBER TO 15 OCTOBER FESCUE @ 5 LB / 1000 SF AL RYE @ 1/2 LB / 1000 SF	RED TOP @ 1/8 LB / 1000 SF

LIME: 140 LB / 1000 SF PULVERIZED AGRICULTURAL LIMESTONE
FERTILIZER: 5-20-10 @ 25 LB / 1000 SF
38-0-0 @ 7 LB / 1000 SF

MULCH: IF REQUIRED, SHALL BE USED OVER ALL SEEDING AREAS AND SHALL BE APPLIED IN ACCORDANCE WITH SECTION 1.75 OF THE VIRGINIA EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION.

INCORPORATION OF LIME AND FERTILIZER, SELECTION OF CERTIFIED SEED, MULCHING, MAINTENANCE OF NEW SEEDLINGS, AND RESEEDING SHALL BE IN ACCORDANCE WITH SPECIFICATIONS CONTAINED WITHIN THE VIRGINIA SOIL EROSION AND SEDIMENT CONTROL HANDBOOK, LATEST EDITION. ADDITIONAL SEEDING TO BE PERFORMED AS REQUIRED BY THE INSPECTOR.

SEED APPLICATION: APPLY SEED UNIFORMLY WITH A CYCLONE SEEDER, DRILL, CULTIPACKER SEEDER, OR HYDROSEEDER ON A FIRM, FRIABLE, SEEDBED. MAXIMUM SEEDING DEPTH SHALL BE 1/4 INCH.

TOTAL DISTURBED AREA = 10.2 AC.