



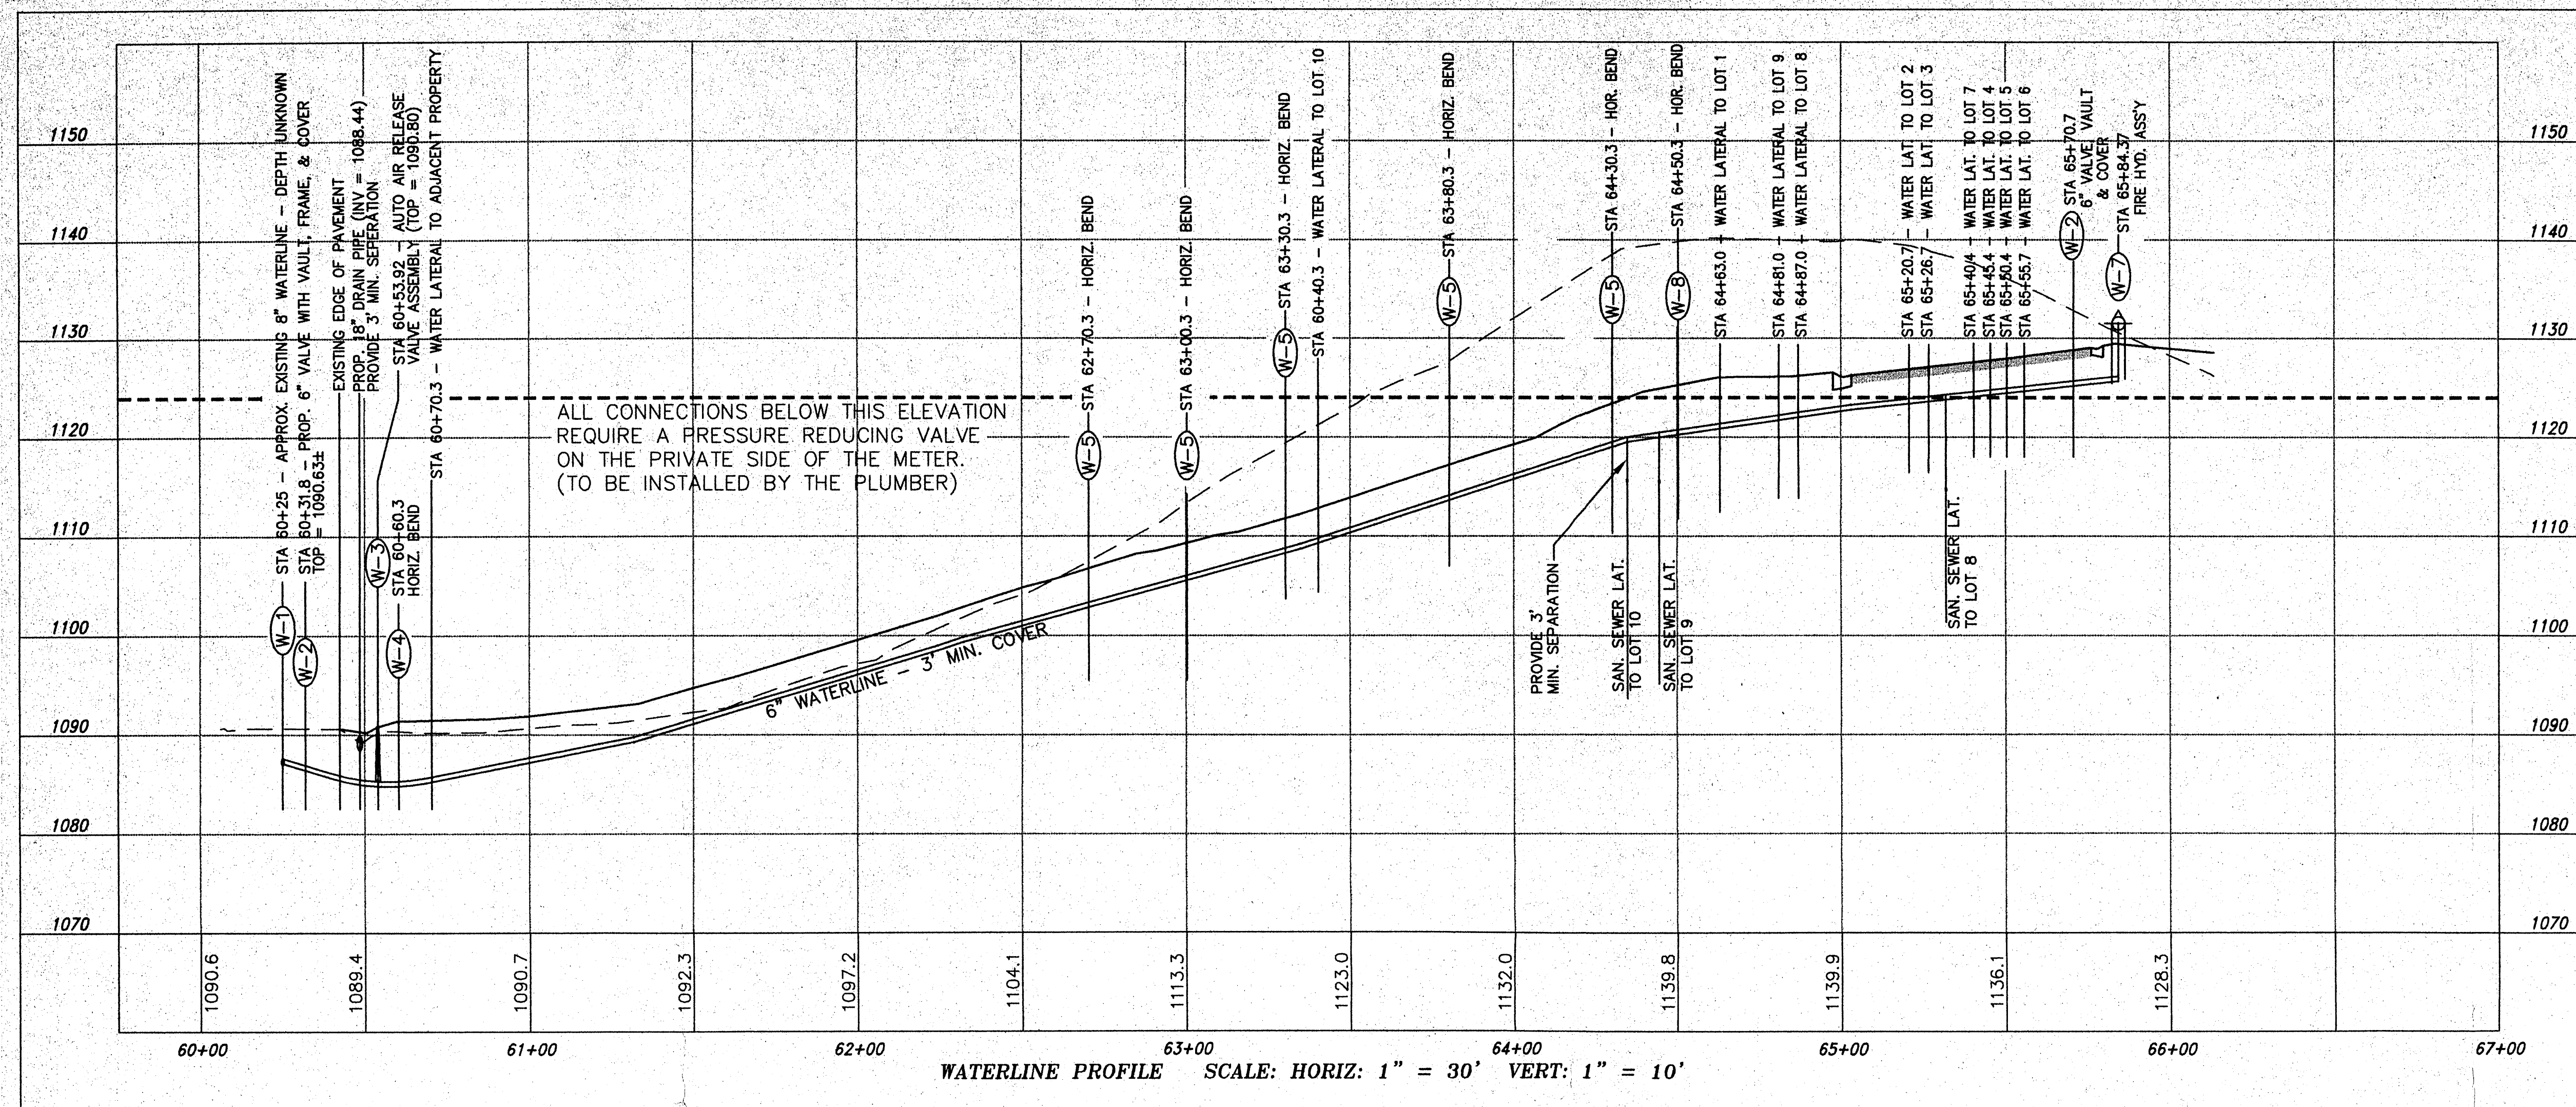

- NOTES:
1. SEE CITY OF ROANOKE WATER DETAILS FOR SPECIFIC INFORMATION REGARDING THE WATERLINE INSTALLATION AND TESTING.
 2. ALL LOTS WITH CONNETIONS BELOW THE ELEVATION OF 1124 WILL REQUIRE PRESSURE REDUCING VALVES ON THE PRIVATE SIDE OF THE WATER METER. (VALLEY BANK, LOT 10, LOT 1, LOT 8, AND LOT 9). THE PLUMBER SHALL INSTALL THE PRESSURE REDUCING VALVES.
 3. THE CONTRACTOR SHALL USE LARGE RADIUS VERTICAL BENDS TO AVOID THE PROPOSED 18-INCH STORM DRAIN PIPE AT KEAGY ROAD.
 4. THE CONTRACTOR SHALL COORDINATE ALL CONNECTIONS & TESTING WITH THE CITY OF ROANOKE UTILITY DEPARTMENT.

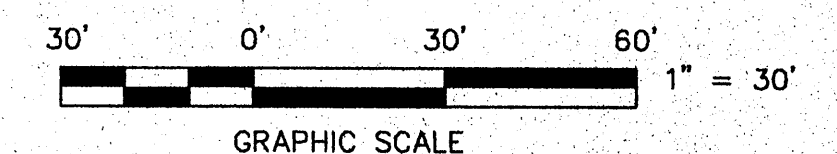

	WATERLINE PROFILE FOR "VILLAGE ON THE CREST" JAVA, L.L.C. 3844 KEAGY ROAD, S.W. SITUATE AT KEAGY ROAD AND ELECTRIC ROAD CITY OF ROANOKE, VIRGINIA REV'D: NOVEMBER 18, 2002 DATE: JUNE 26, 2002		SCALE: 1" = 30'
	T. P. PARKER & SON 816 Boulevard Post Office Box 39 Salem, Virginia 24153 Telephone: 540-387-1153 FAX: 540-388-5767		
	TPP&S ENGINEERS SURVEYORS PLANNERS		
	DESIGNED BY <u>P.J. BROWN</u> DRAWN BY <u>PJB</u> CHECKED BY <u>LRO</u> W.O. # <u>02-0085</u> N.B. <u>JR-203</u> TAX NO. <u>513-0119.0123</u>		