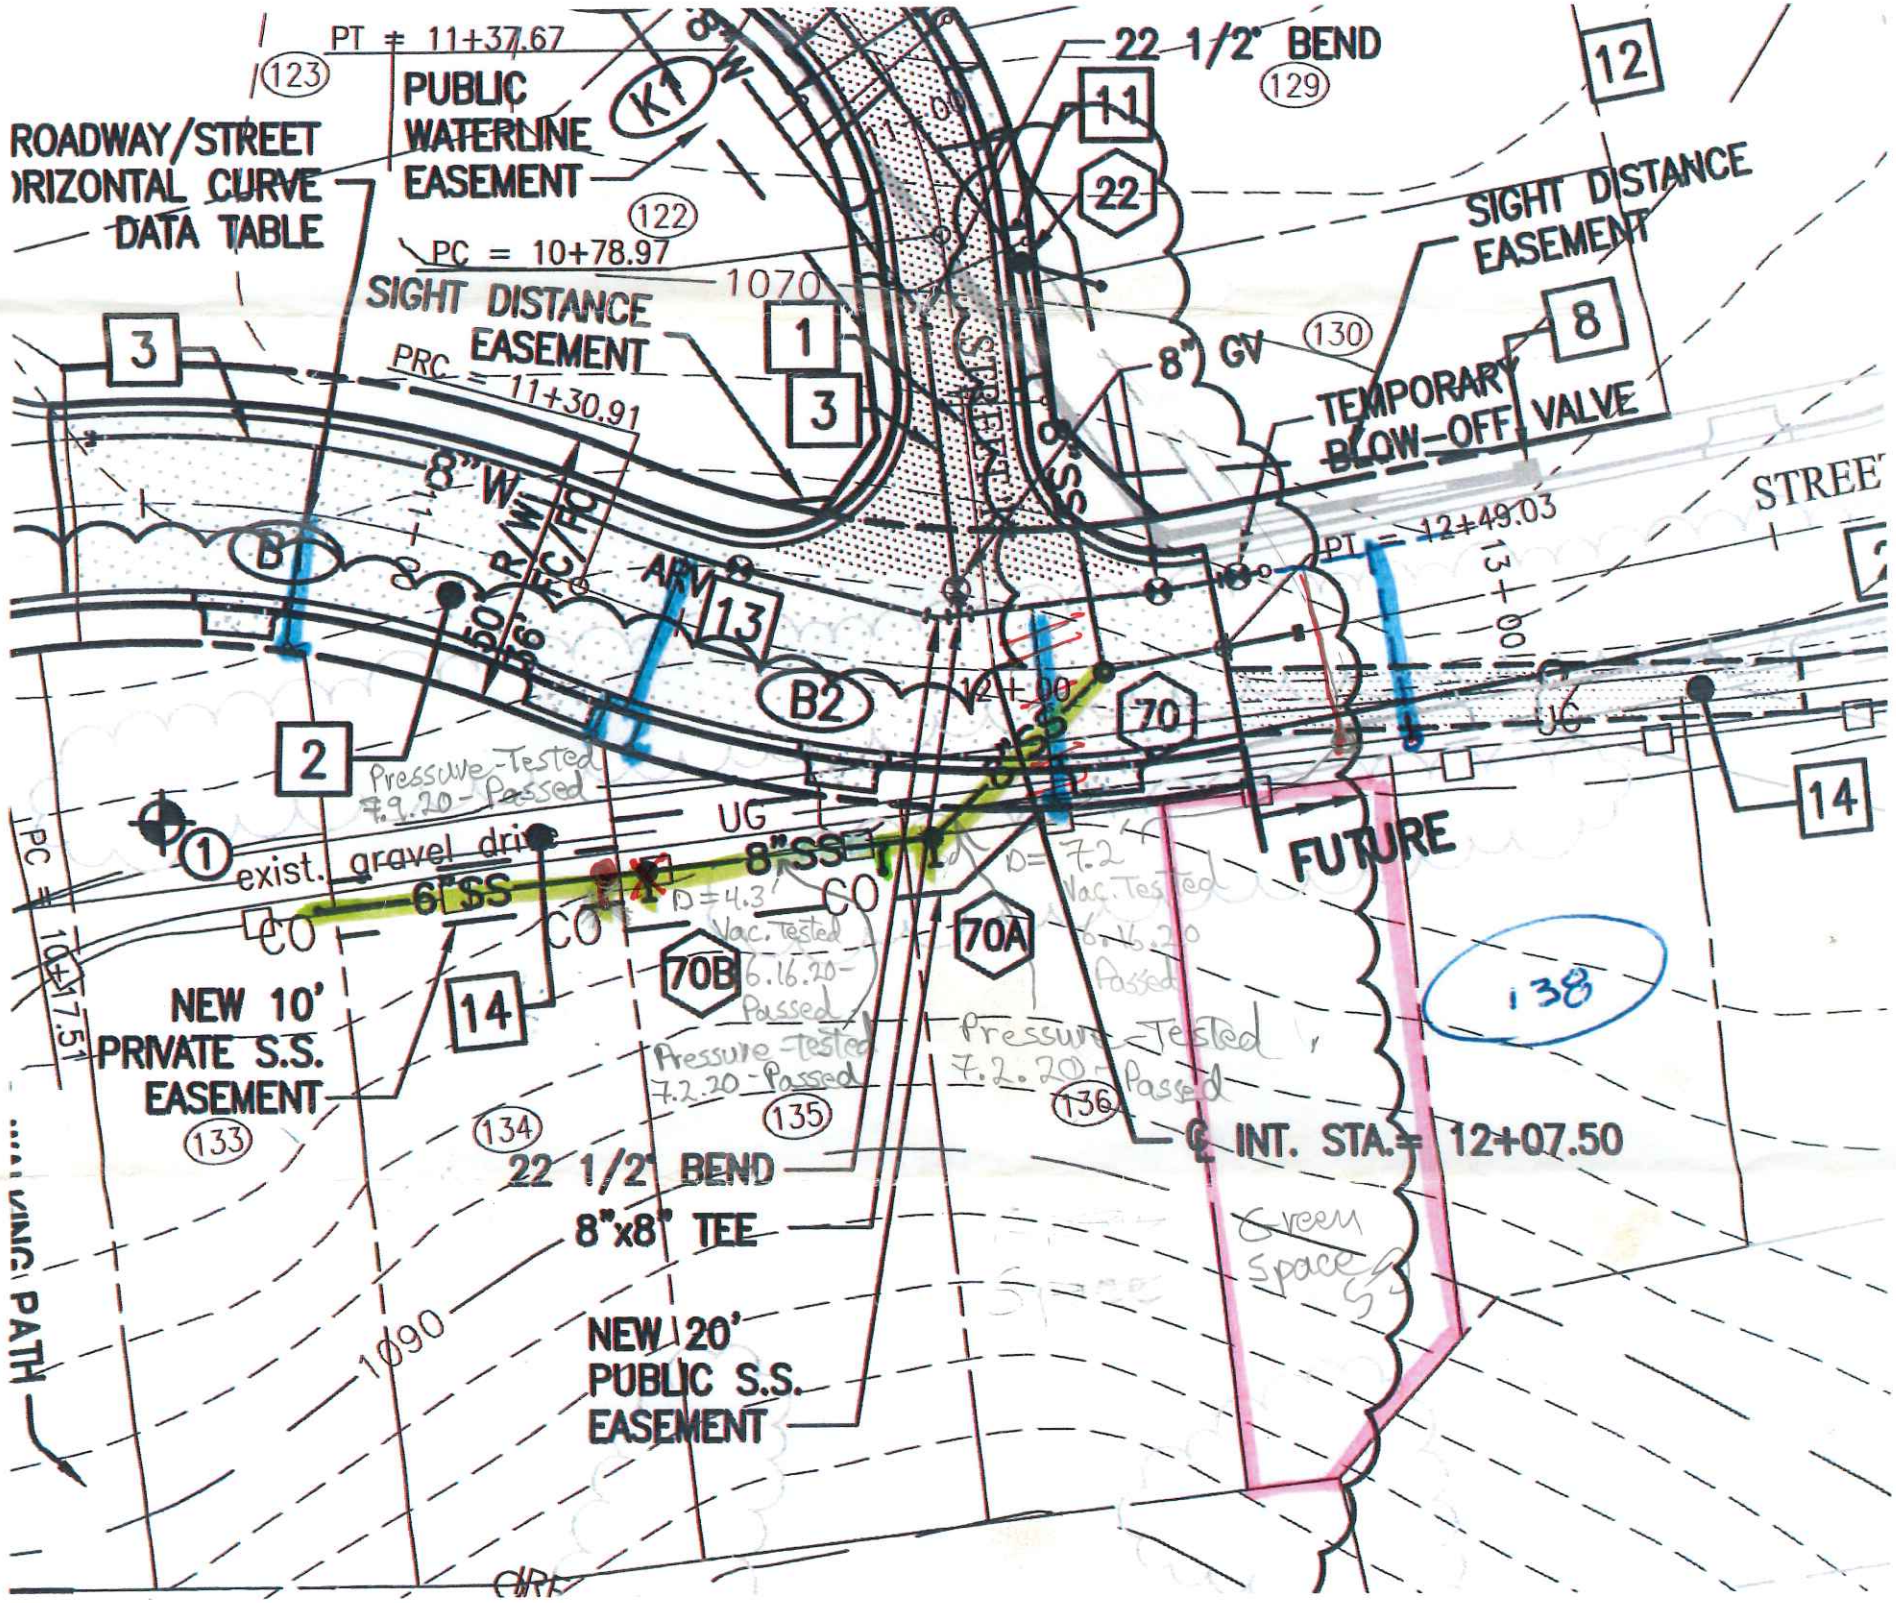
PT = 11+37.67
(123)
PUBLIC WATERLINE EASEMENT
ROADWAY/STREET HORIZONTAL CURVE DATA TABLE
K1
(122)
PC = 10+78.97
SIGHT DISTANCE EASEMENT
1070
PRC = 11+30.91
8" W
50' R/W
56' F/C/F
B
APV
13
B2
12+00
2
Pressure-Tested 7.9.20 - Passed
UG
exist. gravel drive
6" SS
8" SS
D=4.3' Vac. Tested 6.16.20 - Passed
CO
70B
Pressure-Tested 7.2.20 - Passed
70A
D=7.2 Vac. Tested 6.16.20 - Passed
Pressure-Tested 7.2.20 - Passed
NEW 10' PRIVATE S.S. EASEMENT
(133)
(134)
(135)
(136)
22 1/2° BEND
8"x8" TEE
NEW 20' PUBLIC S.S. EASEMENT
1090
PC = 10+77.51
22 1/2° BEND
(129)
11
22
12
SIGHT DISTANCE EASEMENT
8" GV
(130)
TEMPORARY BLOW-OFF VALVE
8
PT = 12+49.03
13+00
STREET
14
FUTURE
138
℄ INT. STA. = 12+07.50
Green Space
PATH