



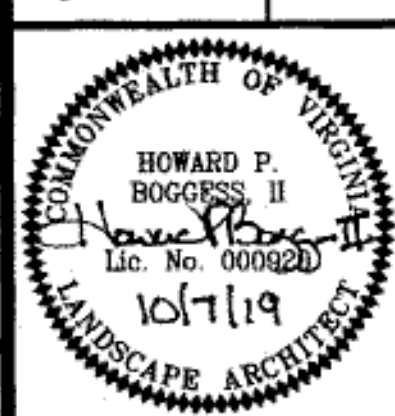

Site Development Plan for
VIRGINIA VARSITY STORAGE EXPANSION
Prepared for
VIRGINIA VARSITY STORAGE
CAVE SPRING MAGISTERIAL DISTRICT
ROANOKE COUNTY, VIRGINIA

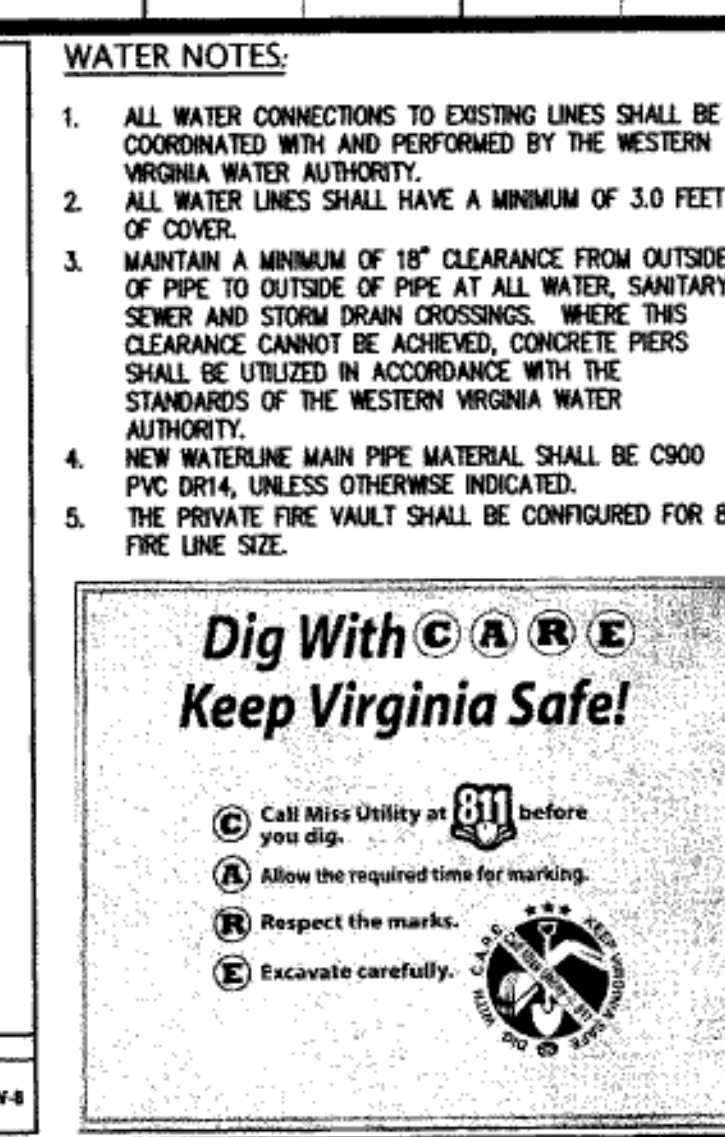

1. ALL WATER CONNECTIONS TO EXISTING LINES SHALL BE COORDINATED WITH AND PERFORMED BY THE WESTERN VIRGINIA WATER AUTHORITY.
2. ALL WATER LINES SHALL HAVE A MINIMUM OF 3.0 FEET OF COVER.
3. MAINTAIN A MINIMUM OF 18" CLEARANCE FROM OUTSIDE OF PIPE TO OUTSIDE OF PIPE AT ALL WATER, SANITARY, AND STORM DRAIN CROSSINGS. IF THIS CLEARANCE CANNOT BE ACHIEVED, CONCRETE PIERS SHALL BE UTILIZED IN ACCORDANCE WITH THE STANDARDS OF THE WESTERN VIRGINIA WATER AUTHORITY.
4. NEW WATERLINE MAIN PIPE MATERIAL SHALL BE C900 PIPE UNLESS OTHERWISE SPECIFIED.
5. THE PRIVATE FIRE VALVE SHALL BE CONFIGURED FOR FIRE LINE SIZE.

- C** Call Miss Utility at 811 before you dig.
- A** Allow the required time for marking.
- R** Respect the marks.
- E** Excavate carefully.

