

A

B

C

D

E

F


G

H


TEST HYDRANT (TAKEN AUGUST 2009)
3095 COLONIAL AVE. SW
STATIC PRESSURE: 108 PSI
PISTON PRESSURE: 78 PSI
RESIDUAL PRESSURE: 86 PSI
FLOW RATE: 1480 GPM

UTILITY DRAWING REFERENCE


REFER TO DRAWING C4.1 FOR WATERLINE UTILITY LAYOUT.
REFER TO DRAWING C4.2 FOR SANITARY SEWER UTILITY LAYOUT.
REFER TO DRAWING C4.3 FOR STORM SEWER UTILITY LAYOUT.
REFER TO DRAWING C4.4 FOR UTILITY PROFILES.

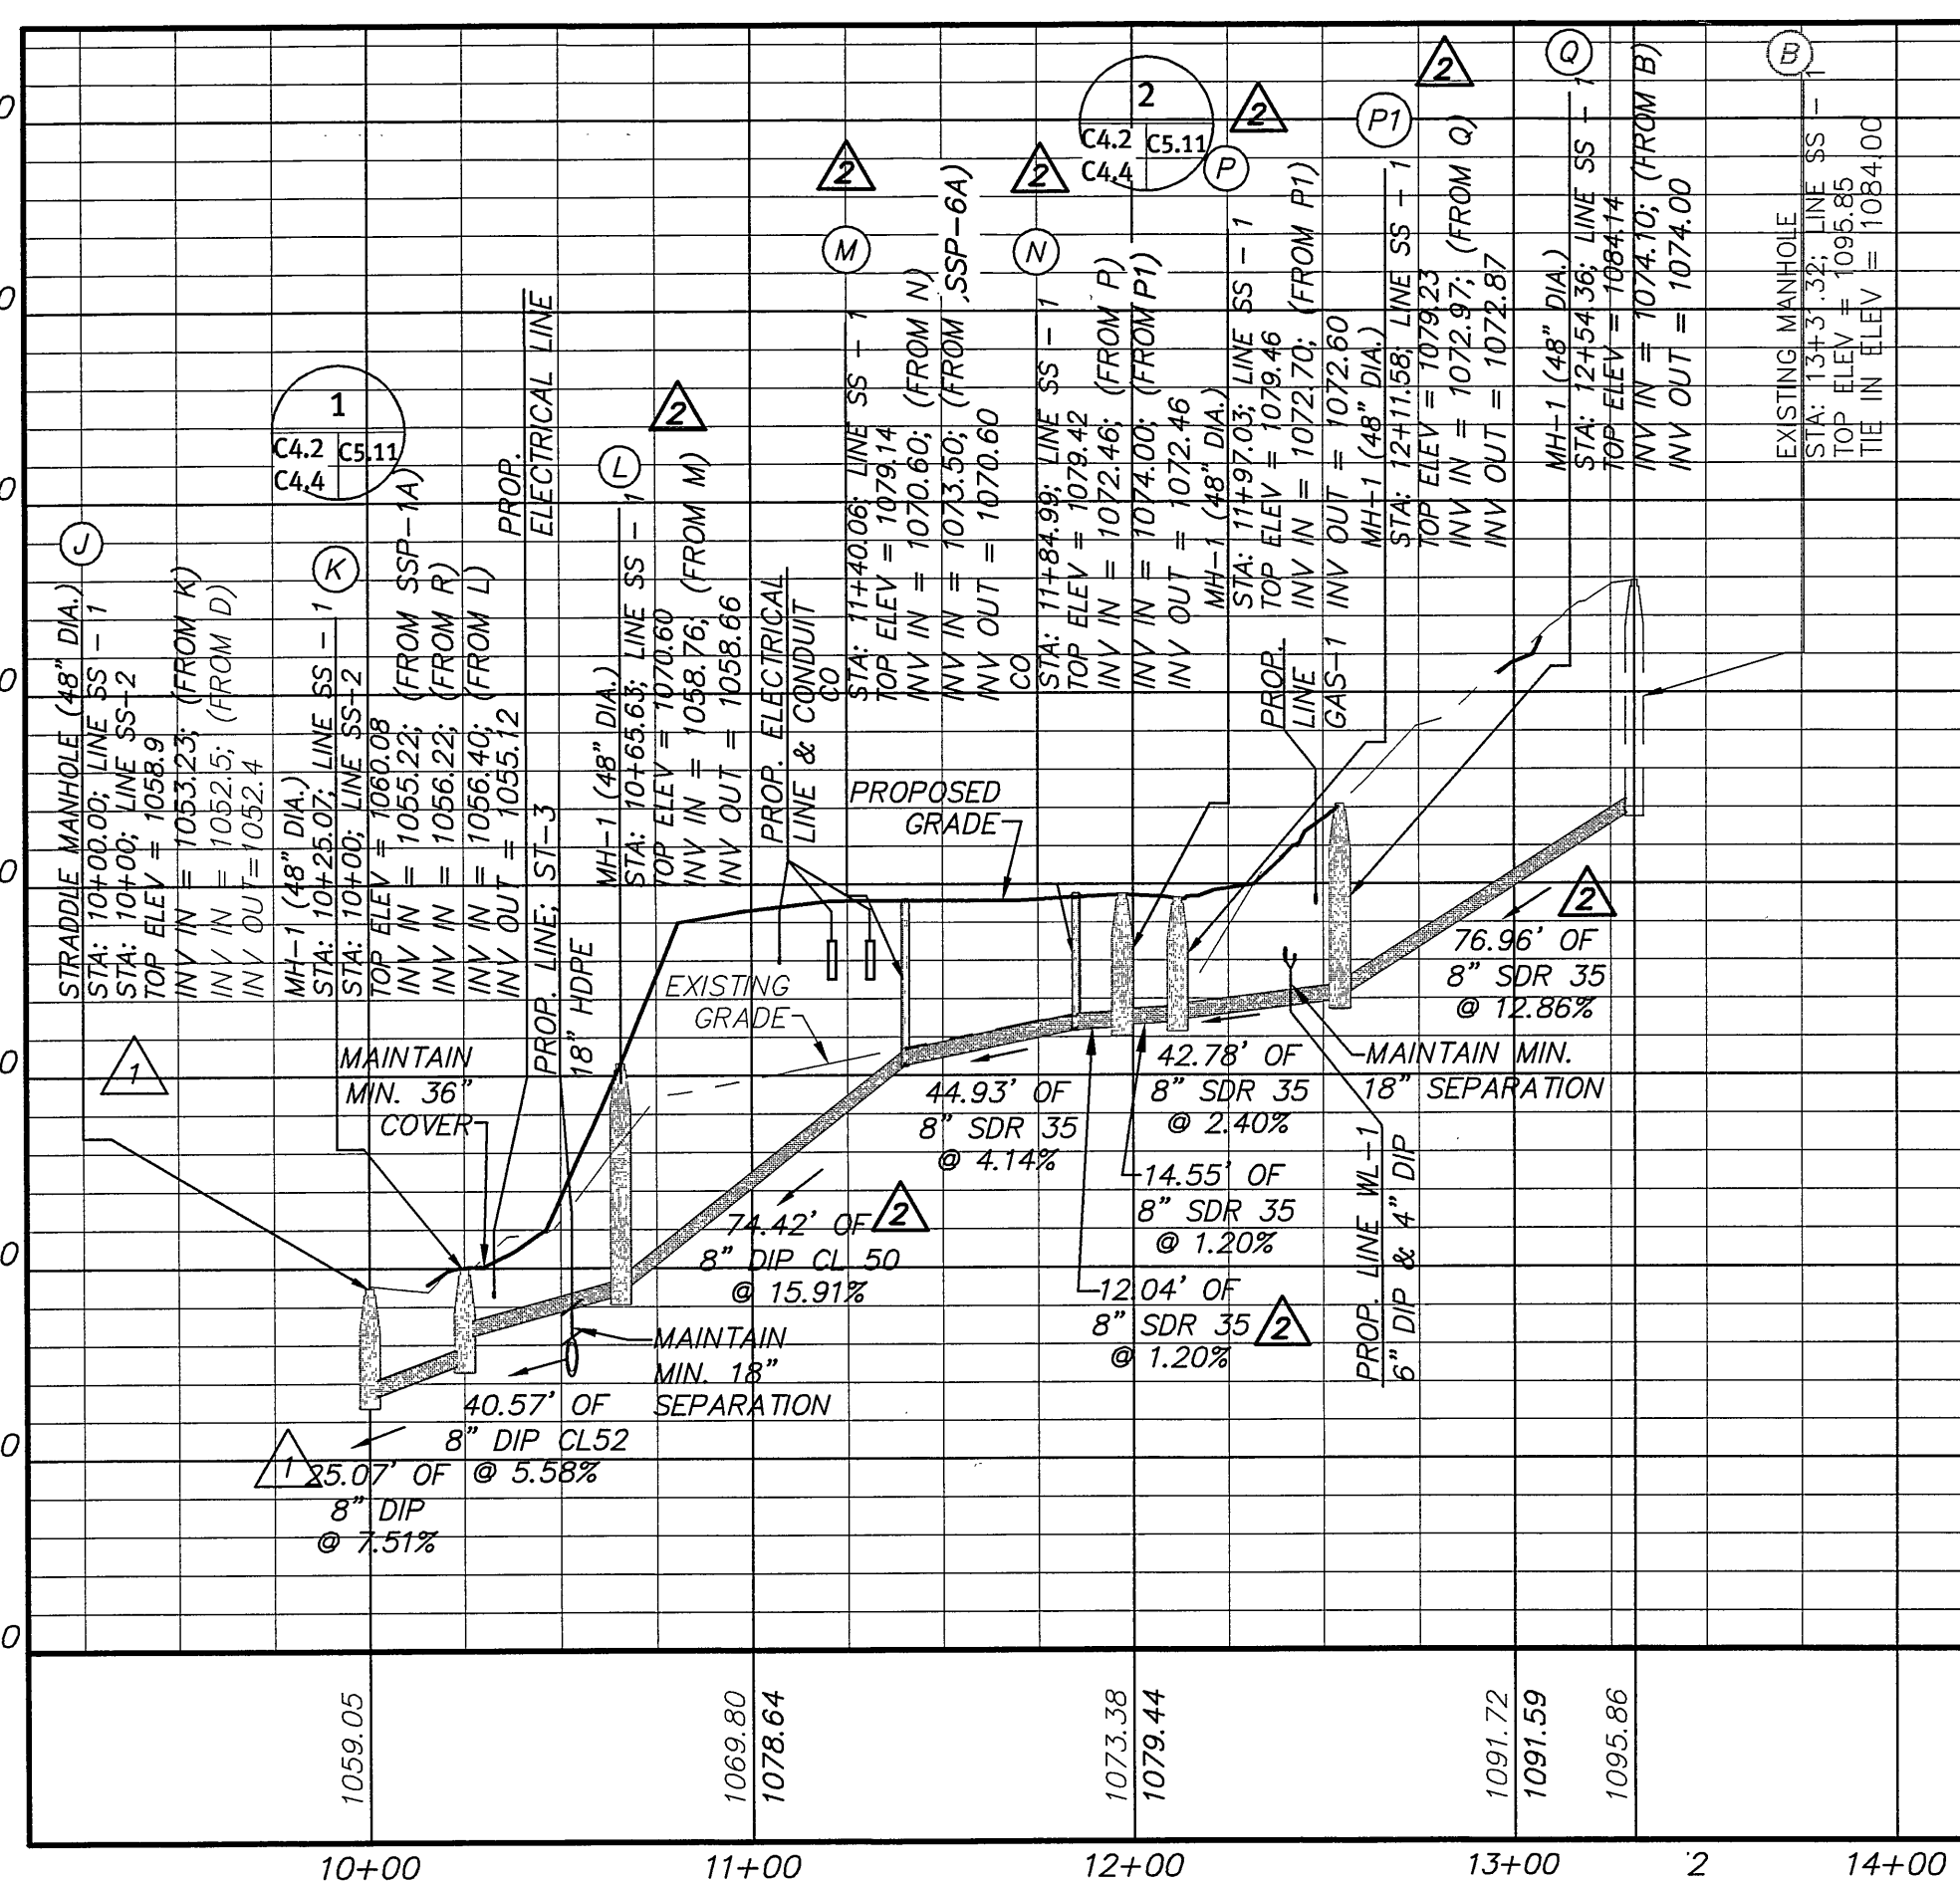


SS - 1

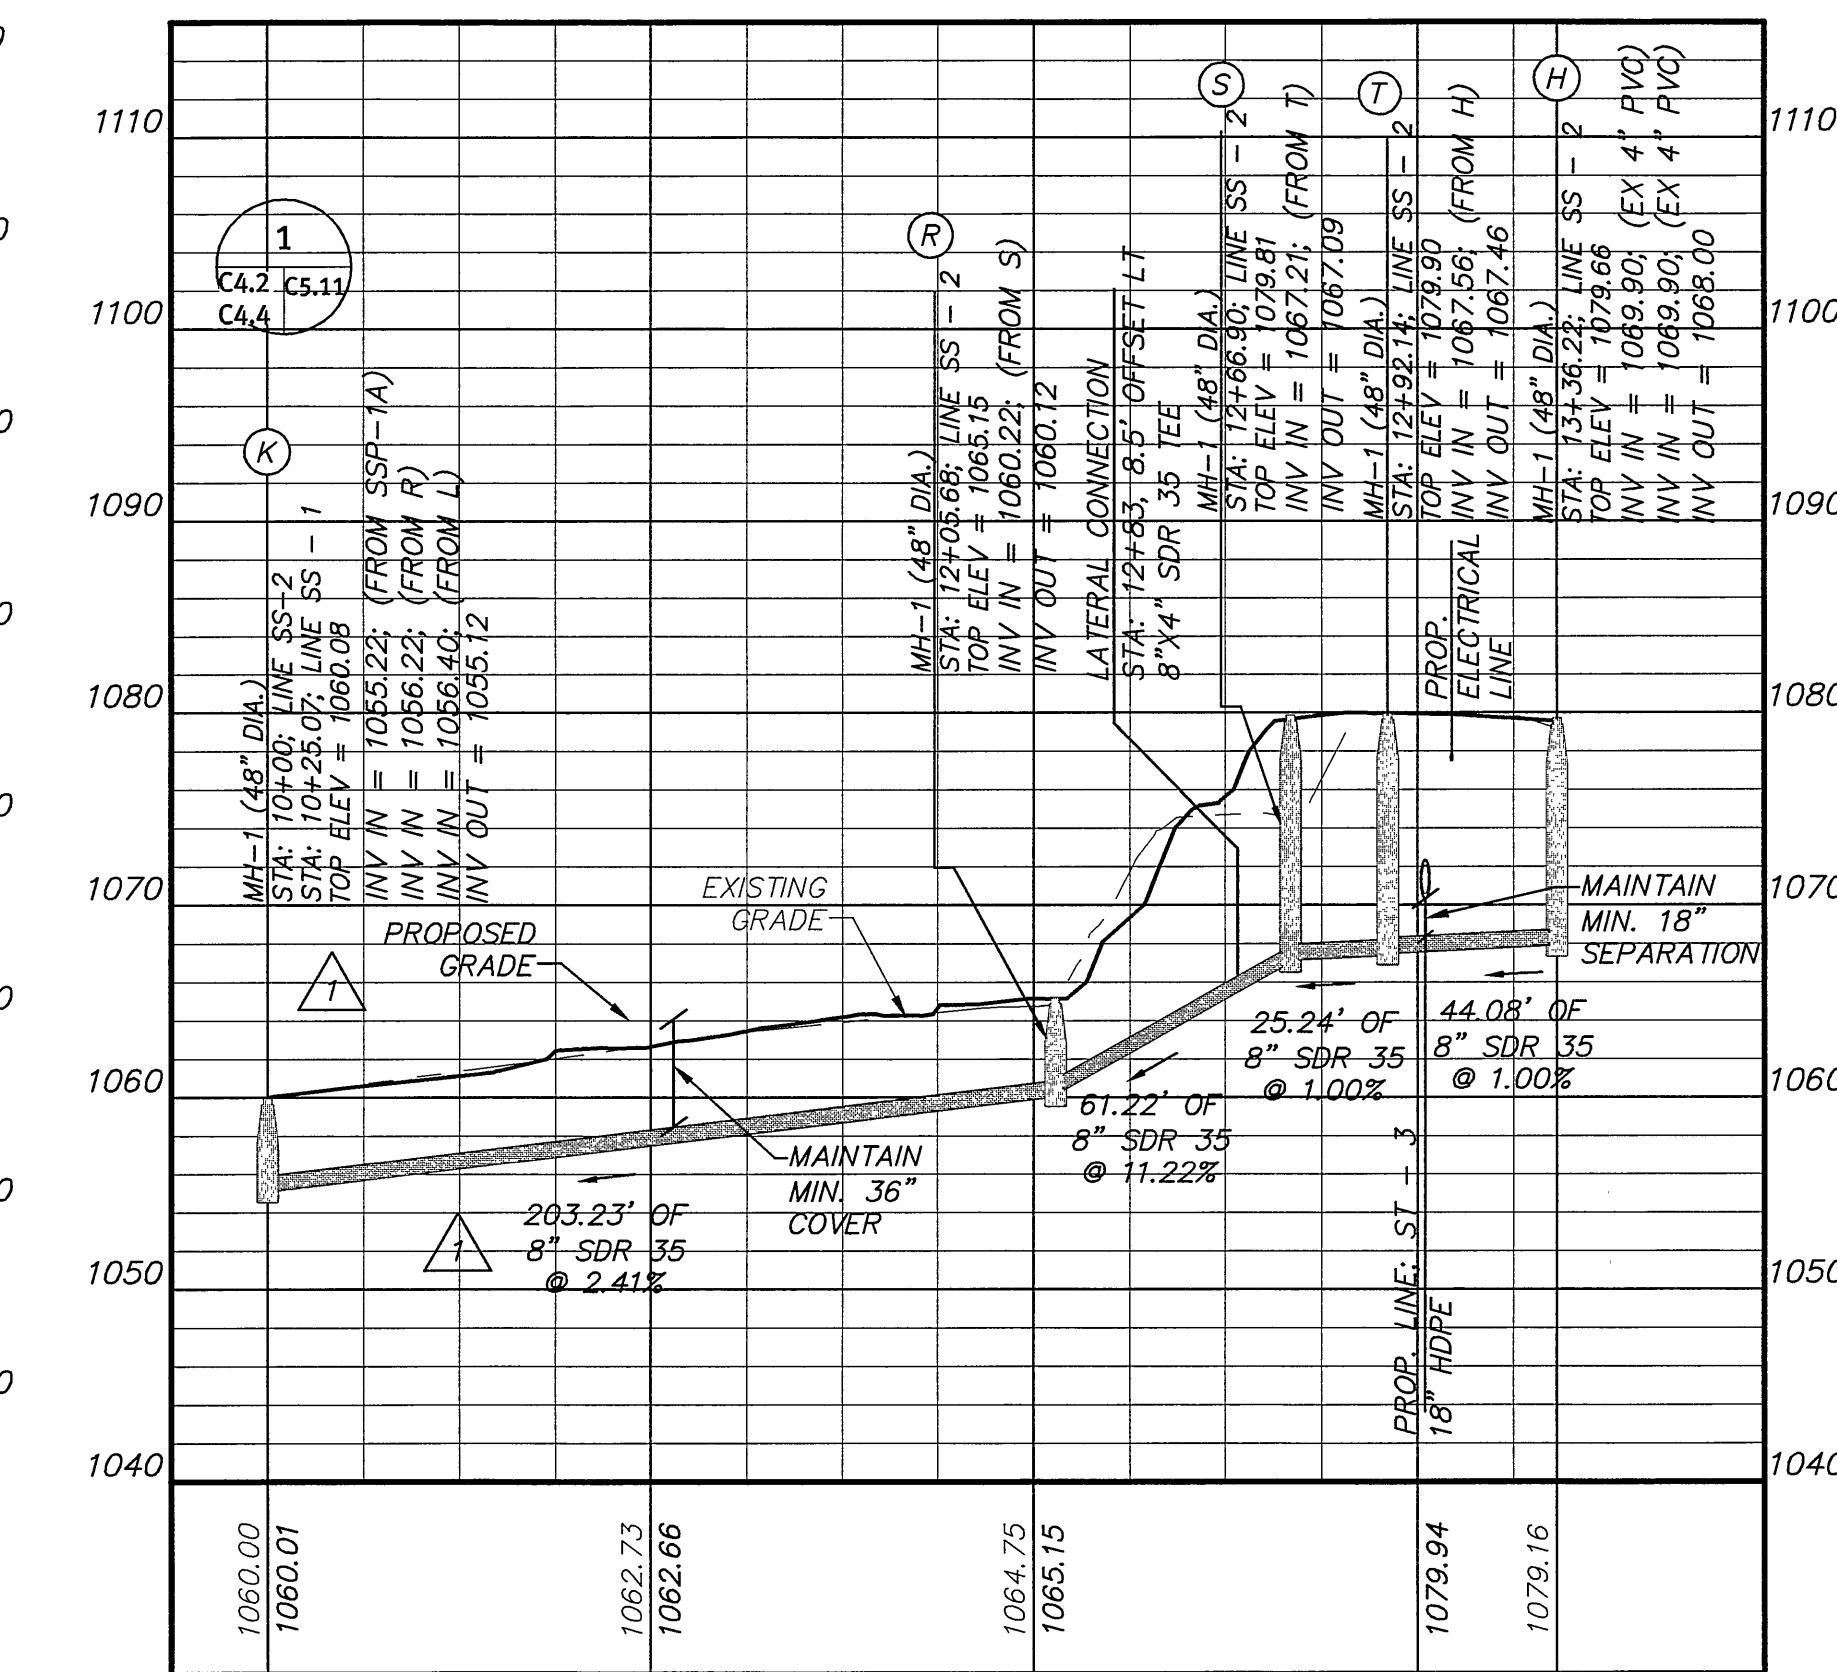


SS - 2

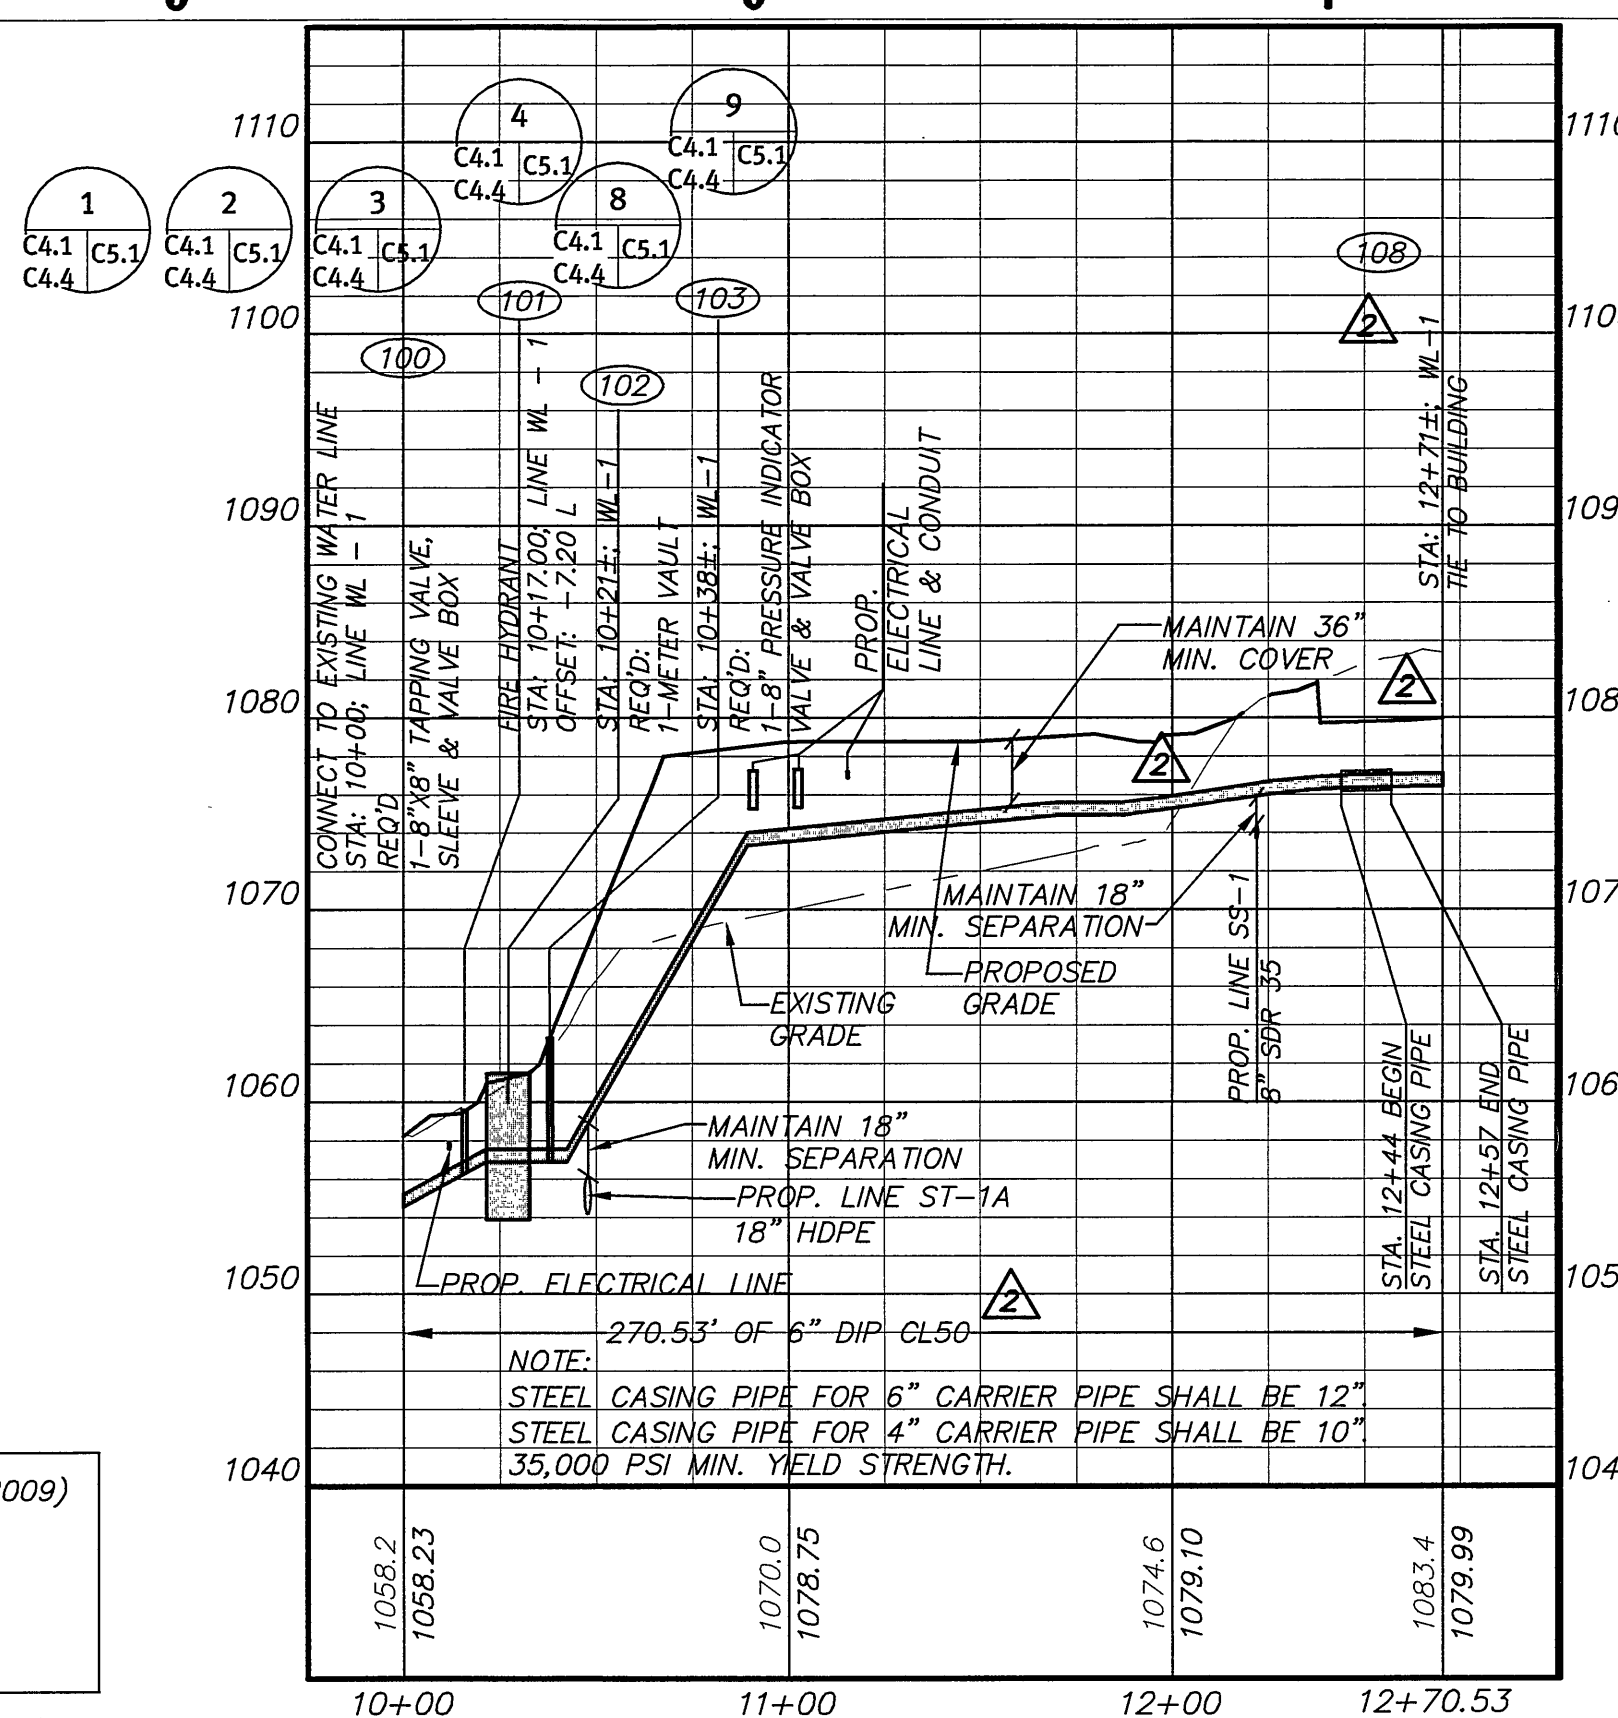


WL - 1

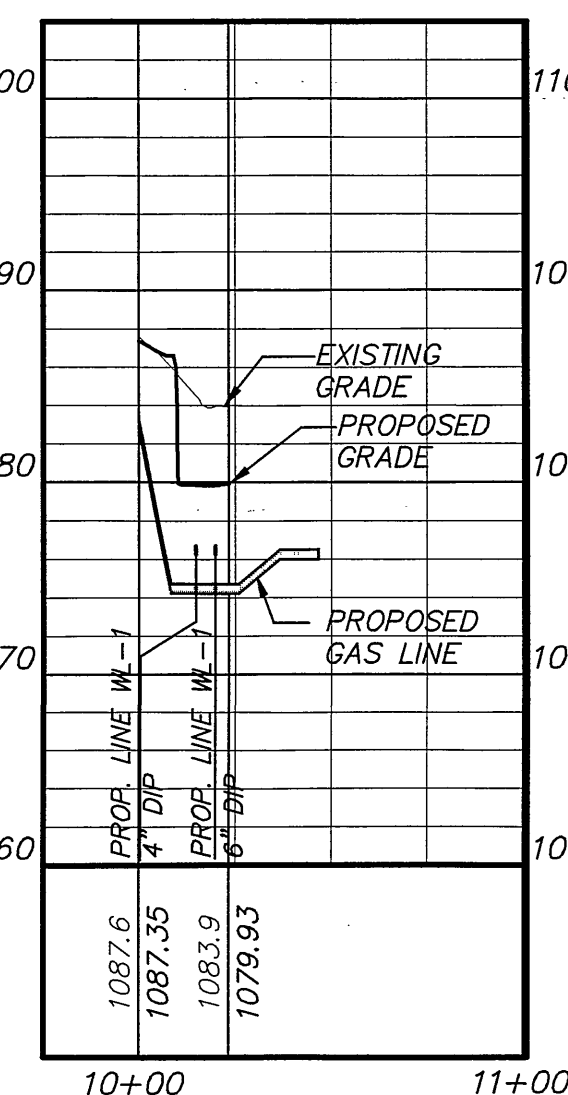


GAS-2

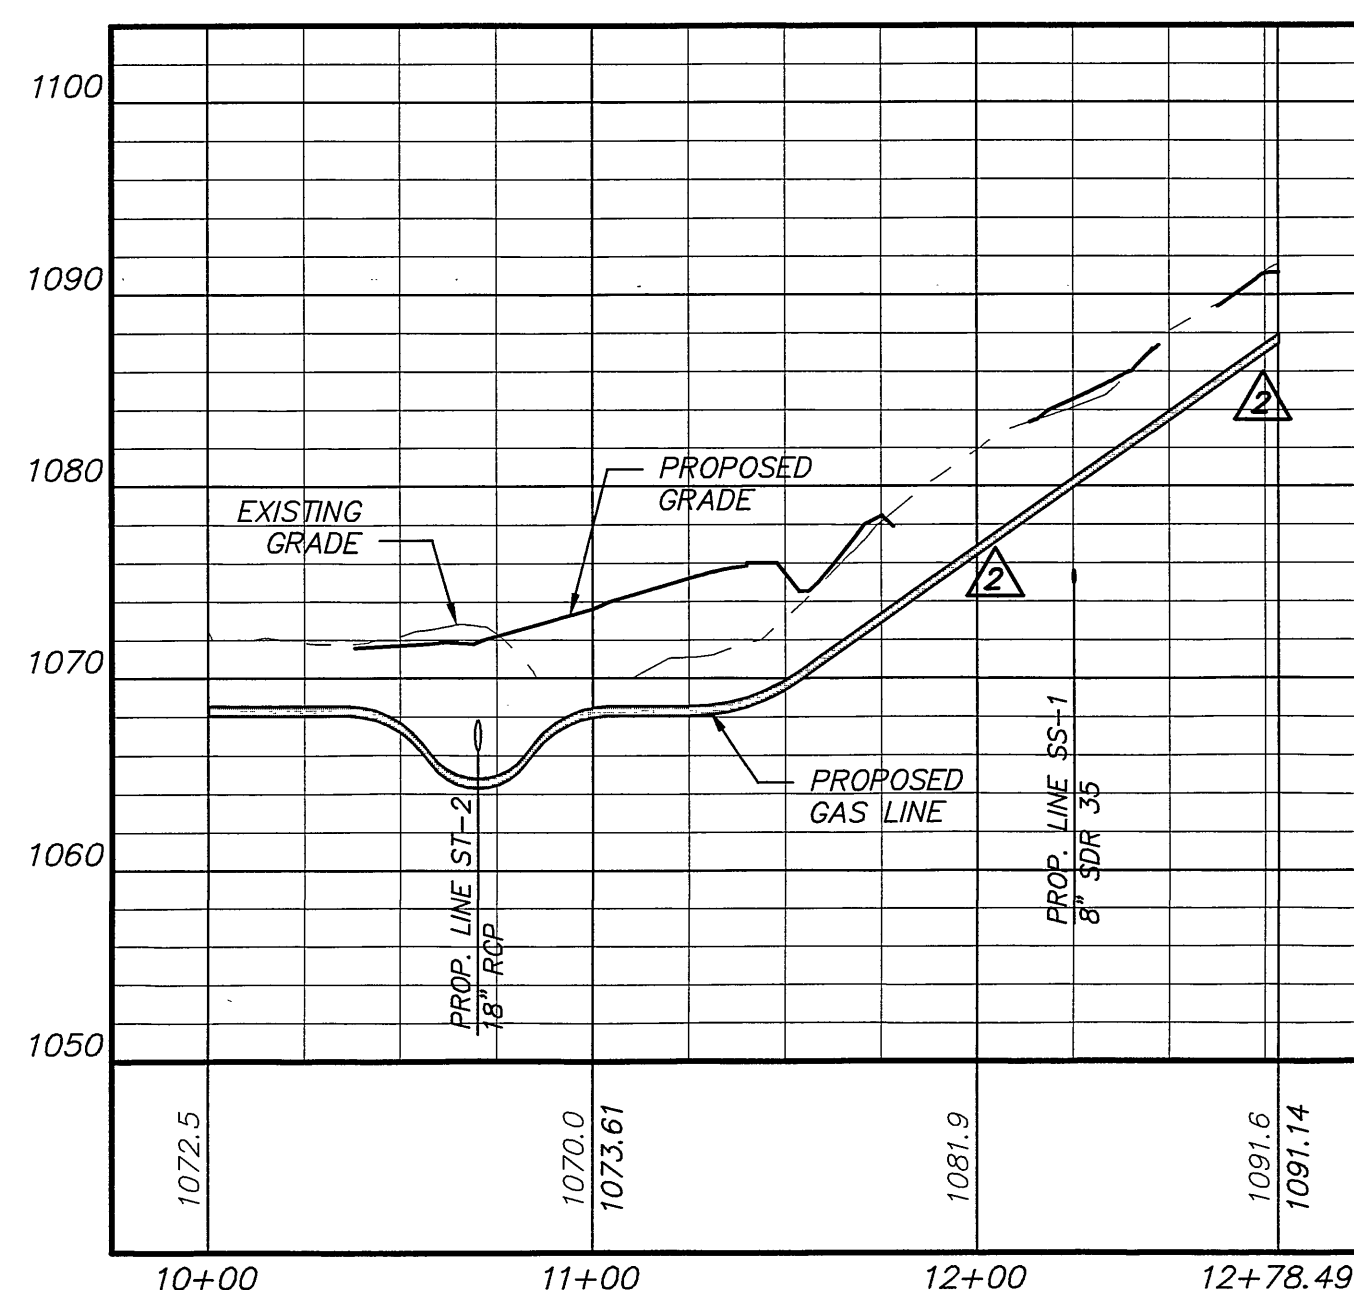


GAS-1

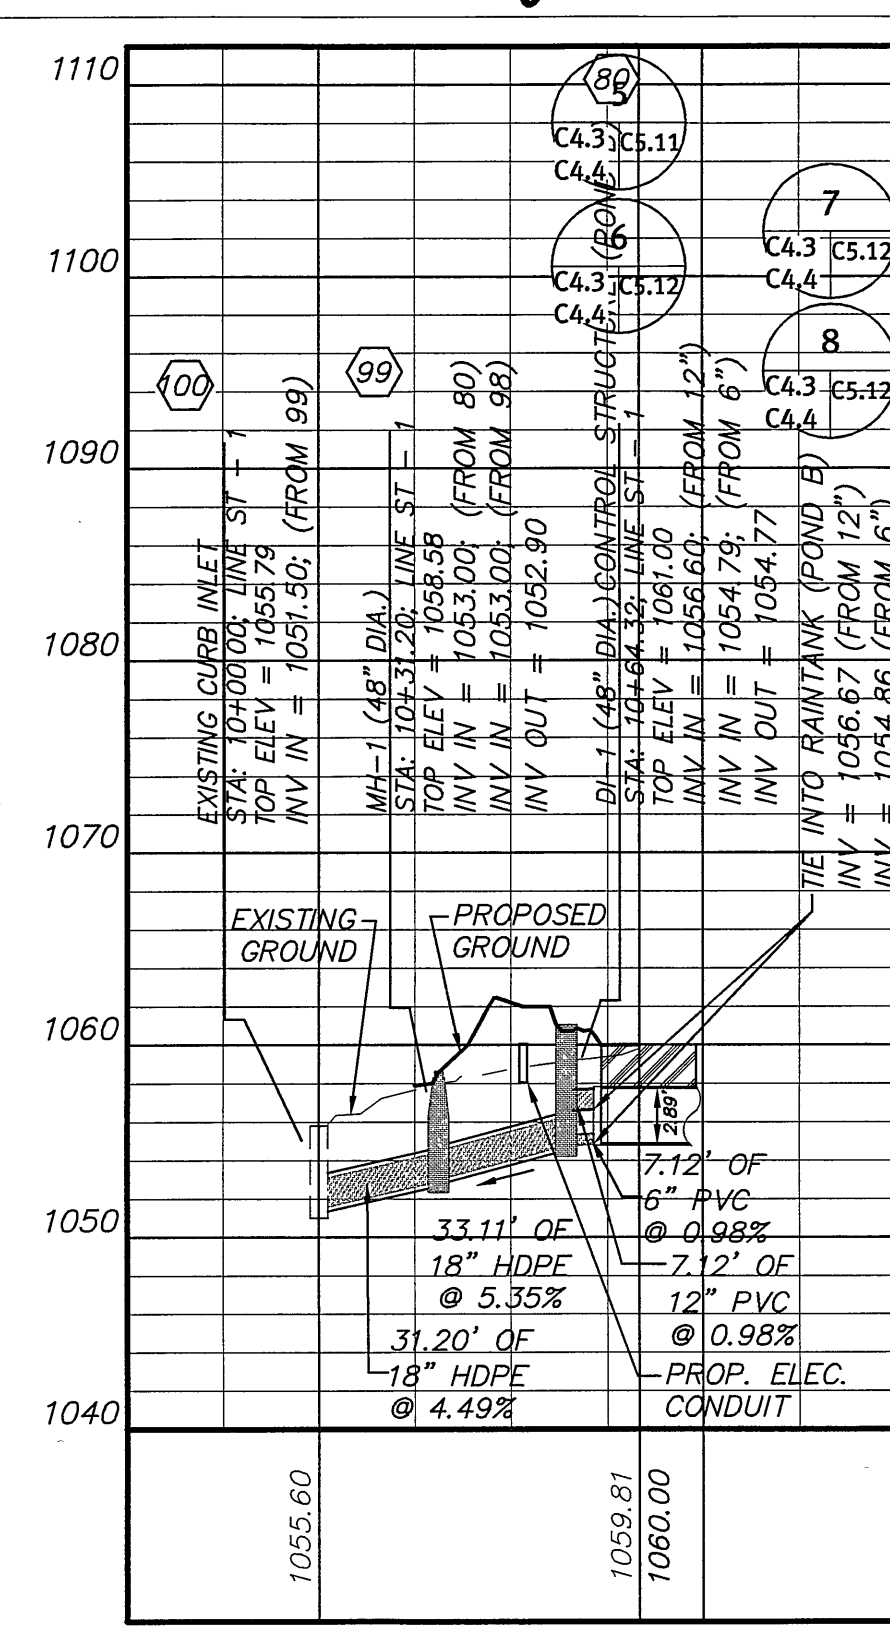


ST - 1

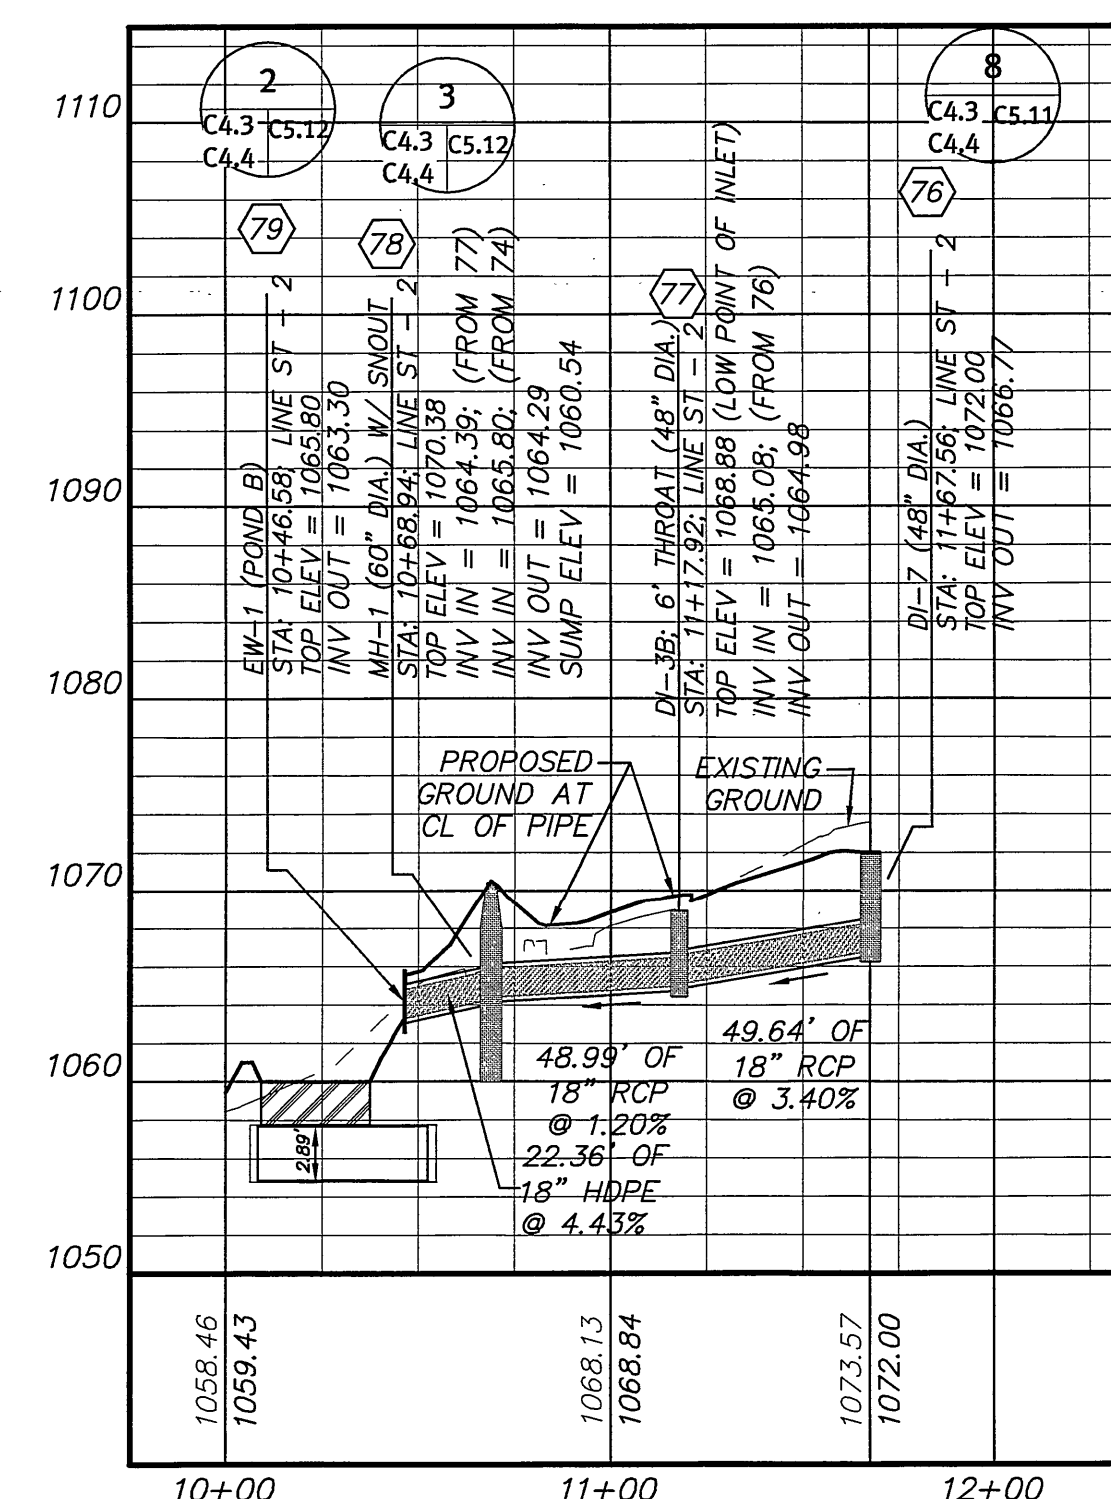


ST - 2

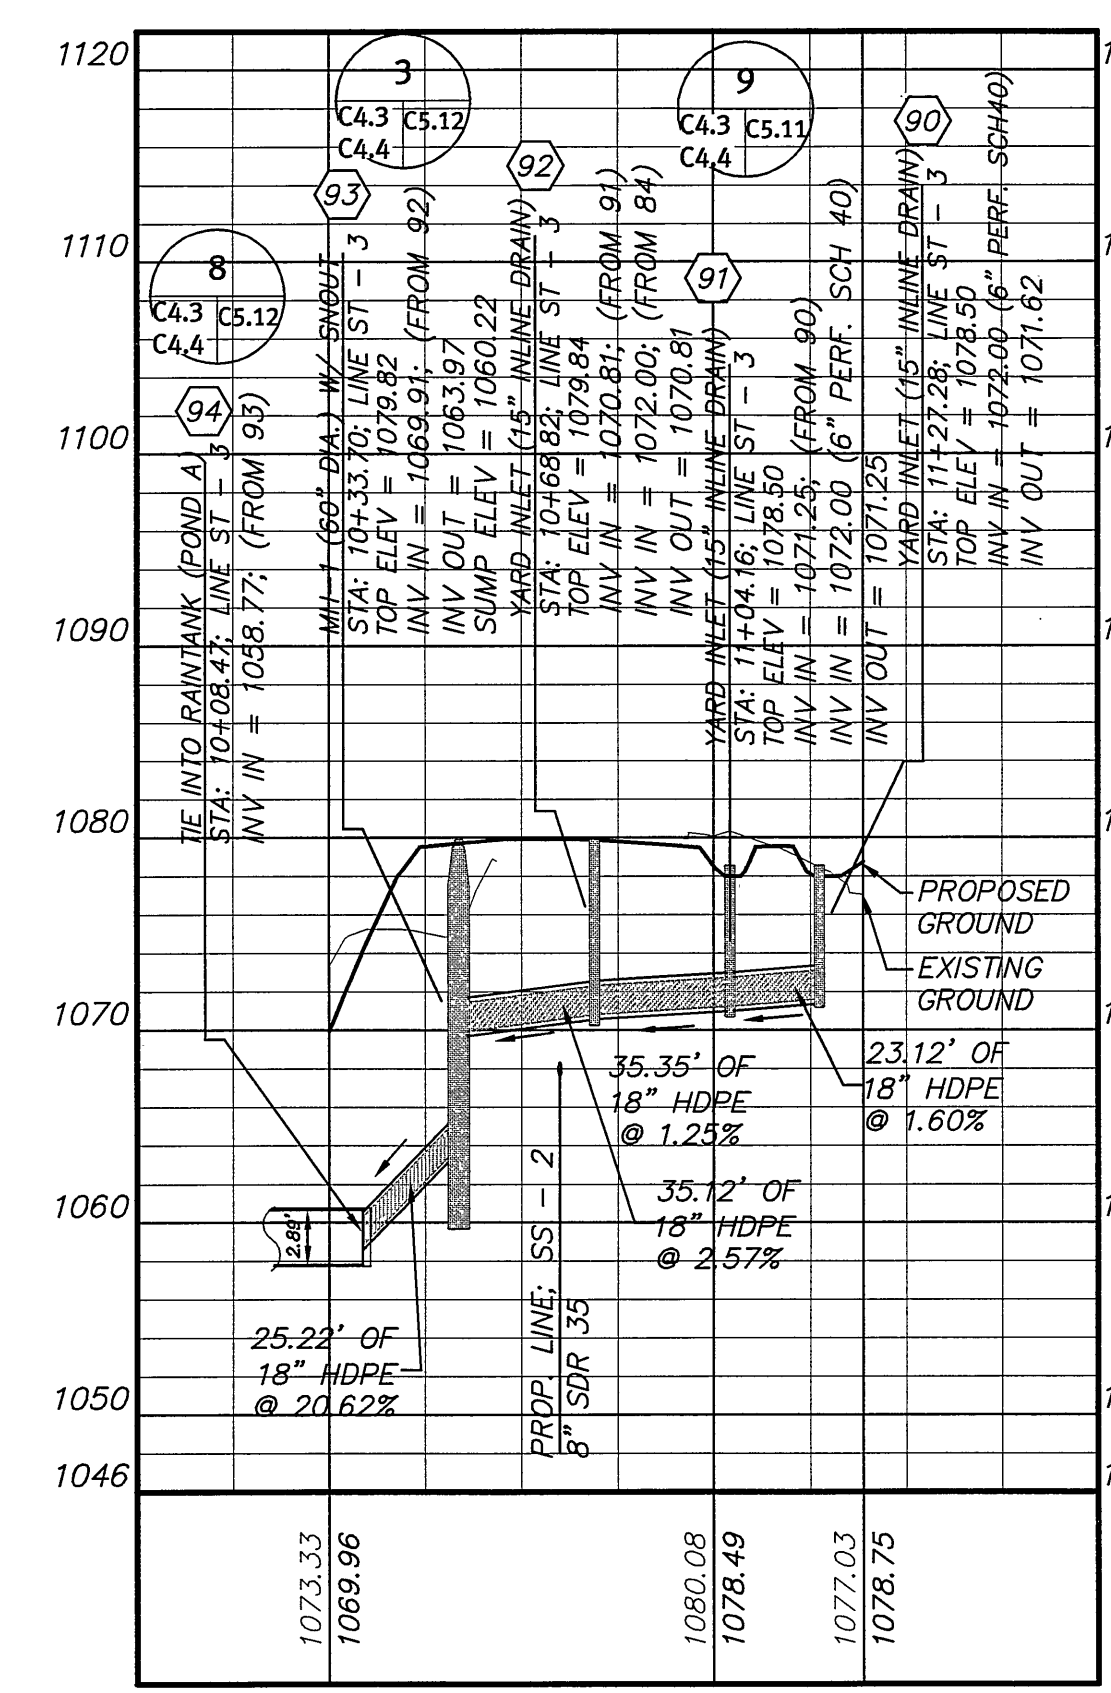


ST - 3

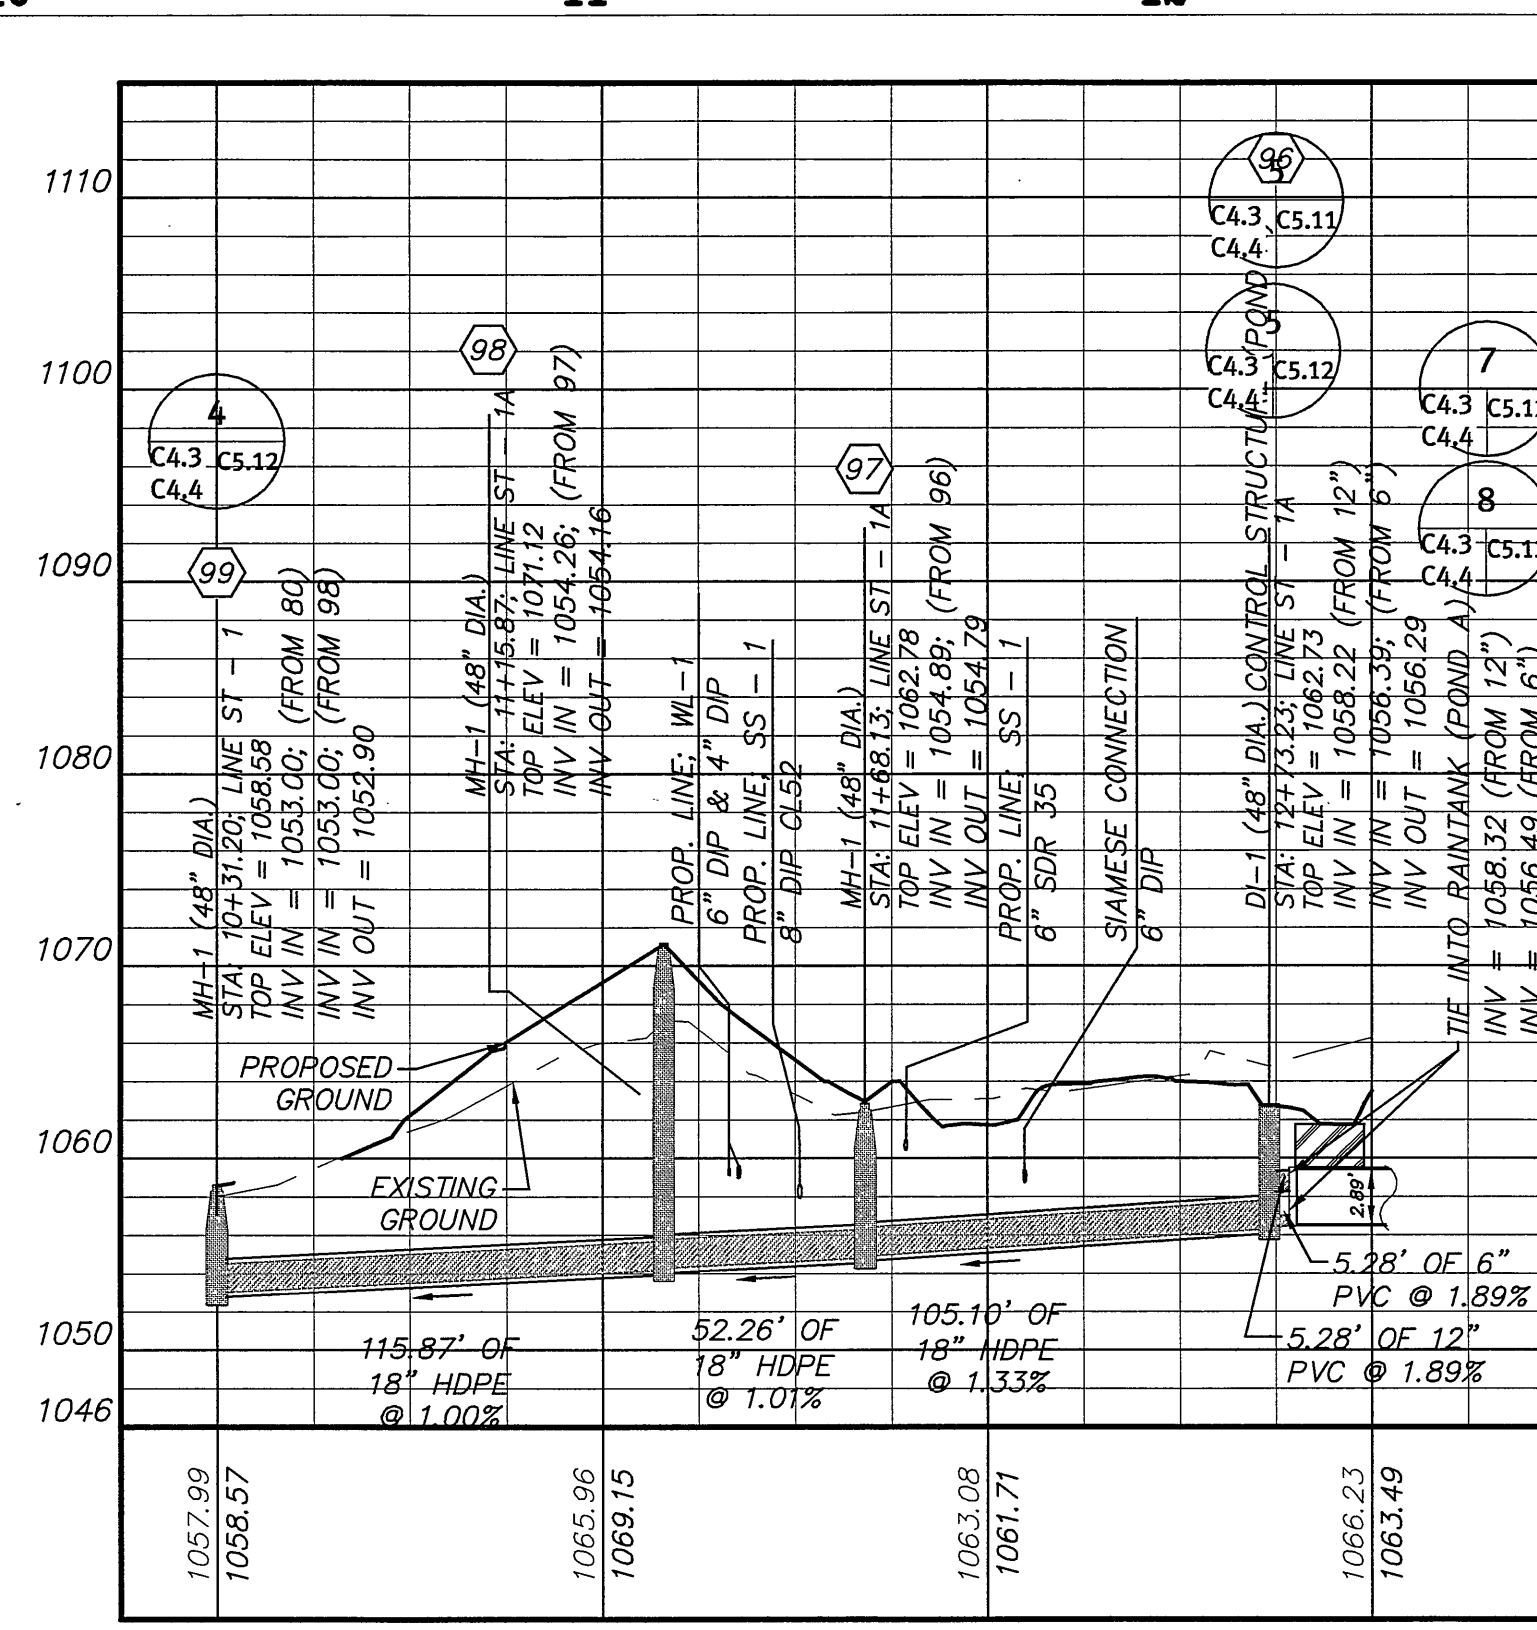

ST - 1A

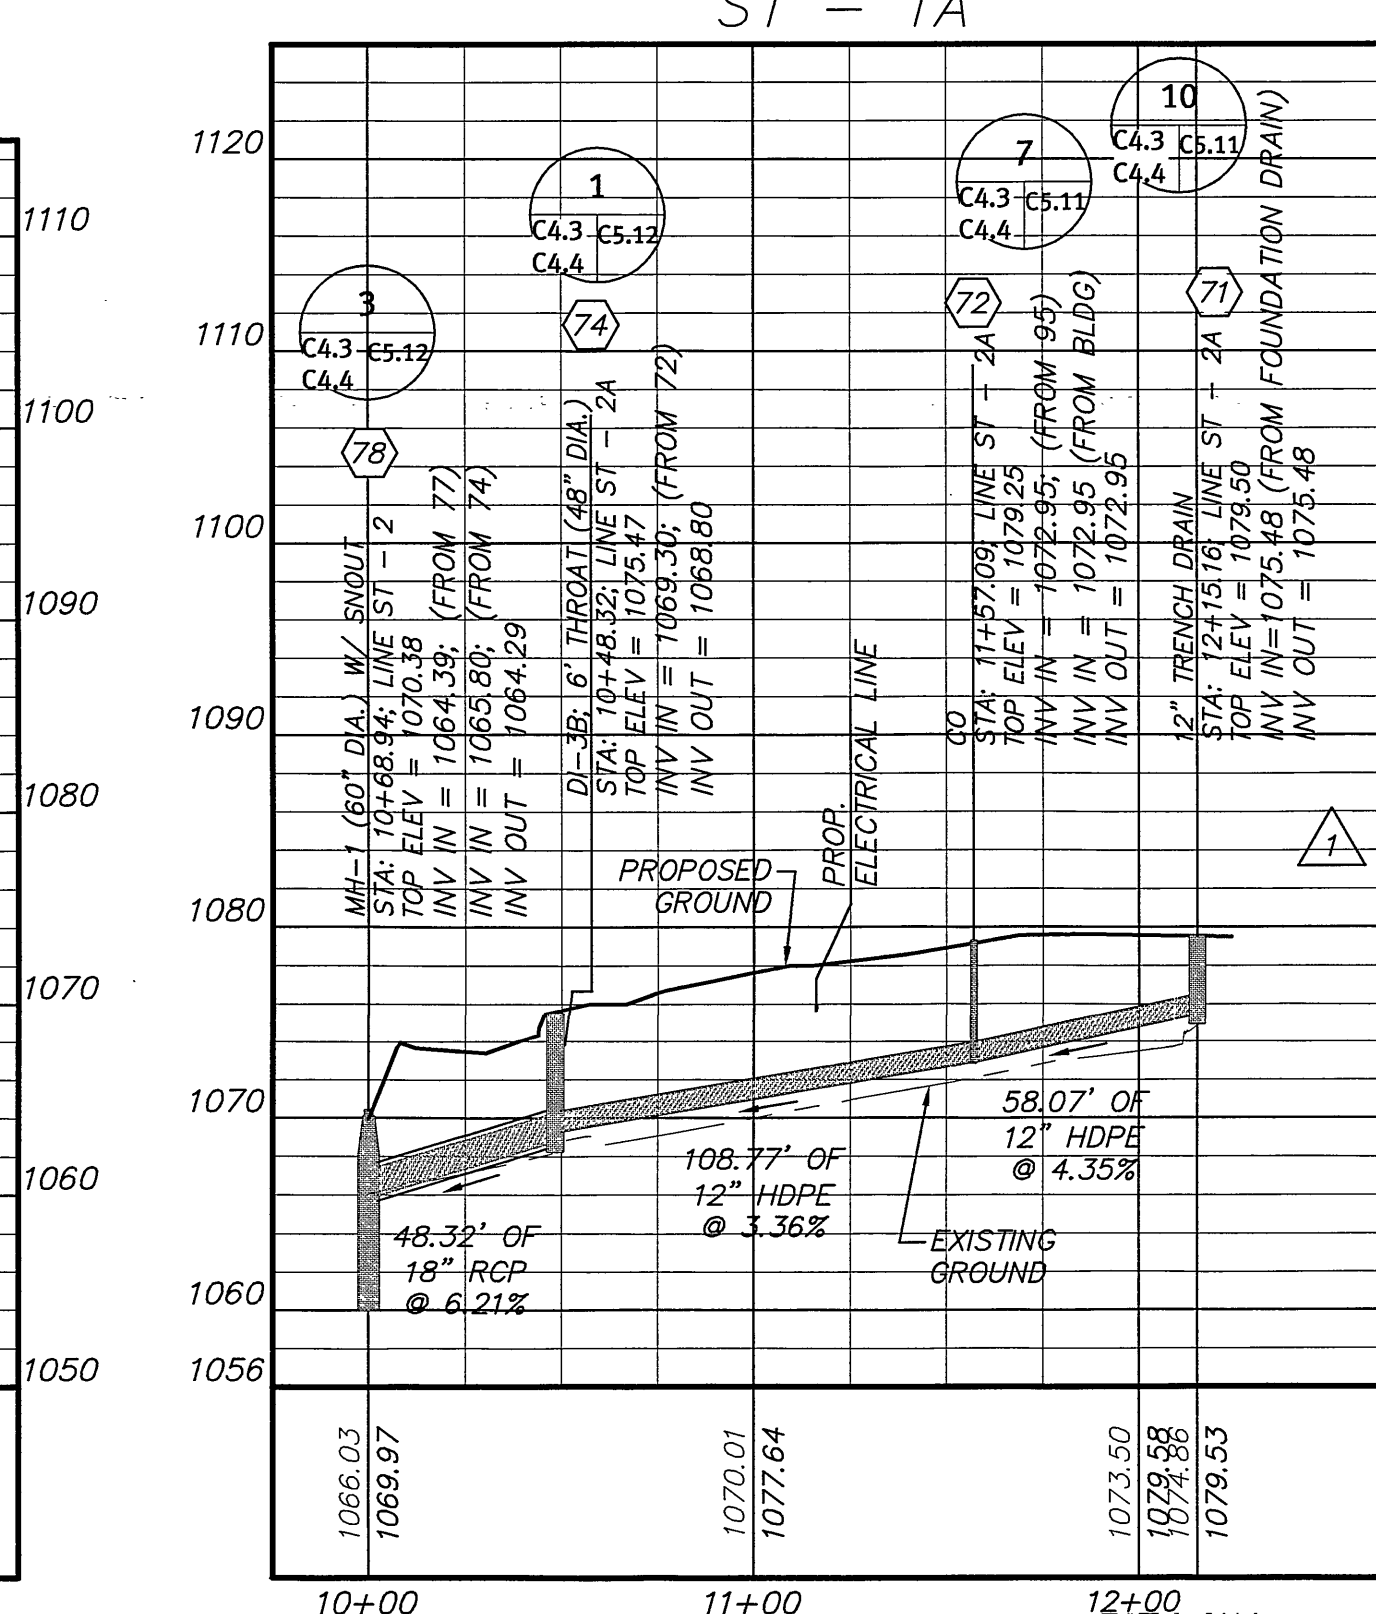

ST - 2A

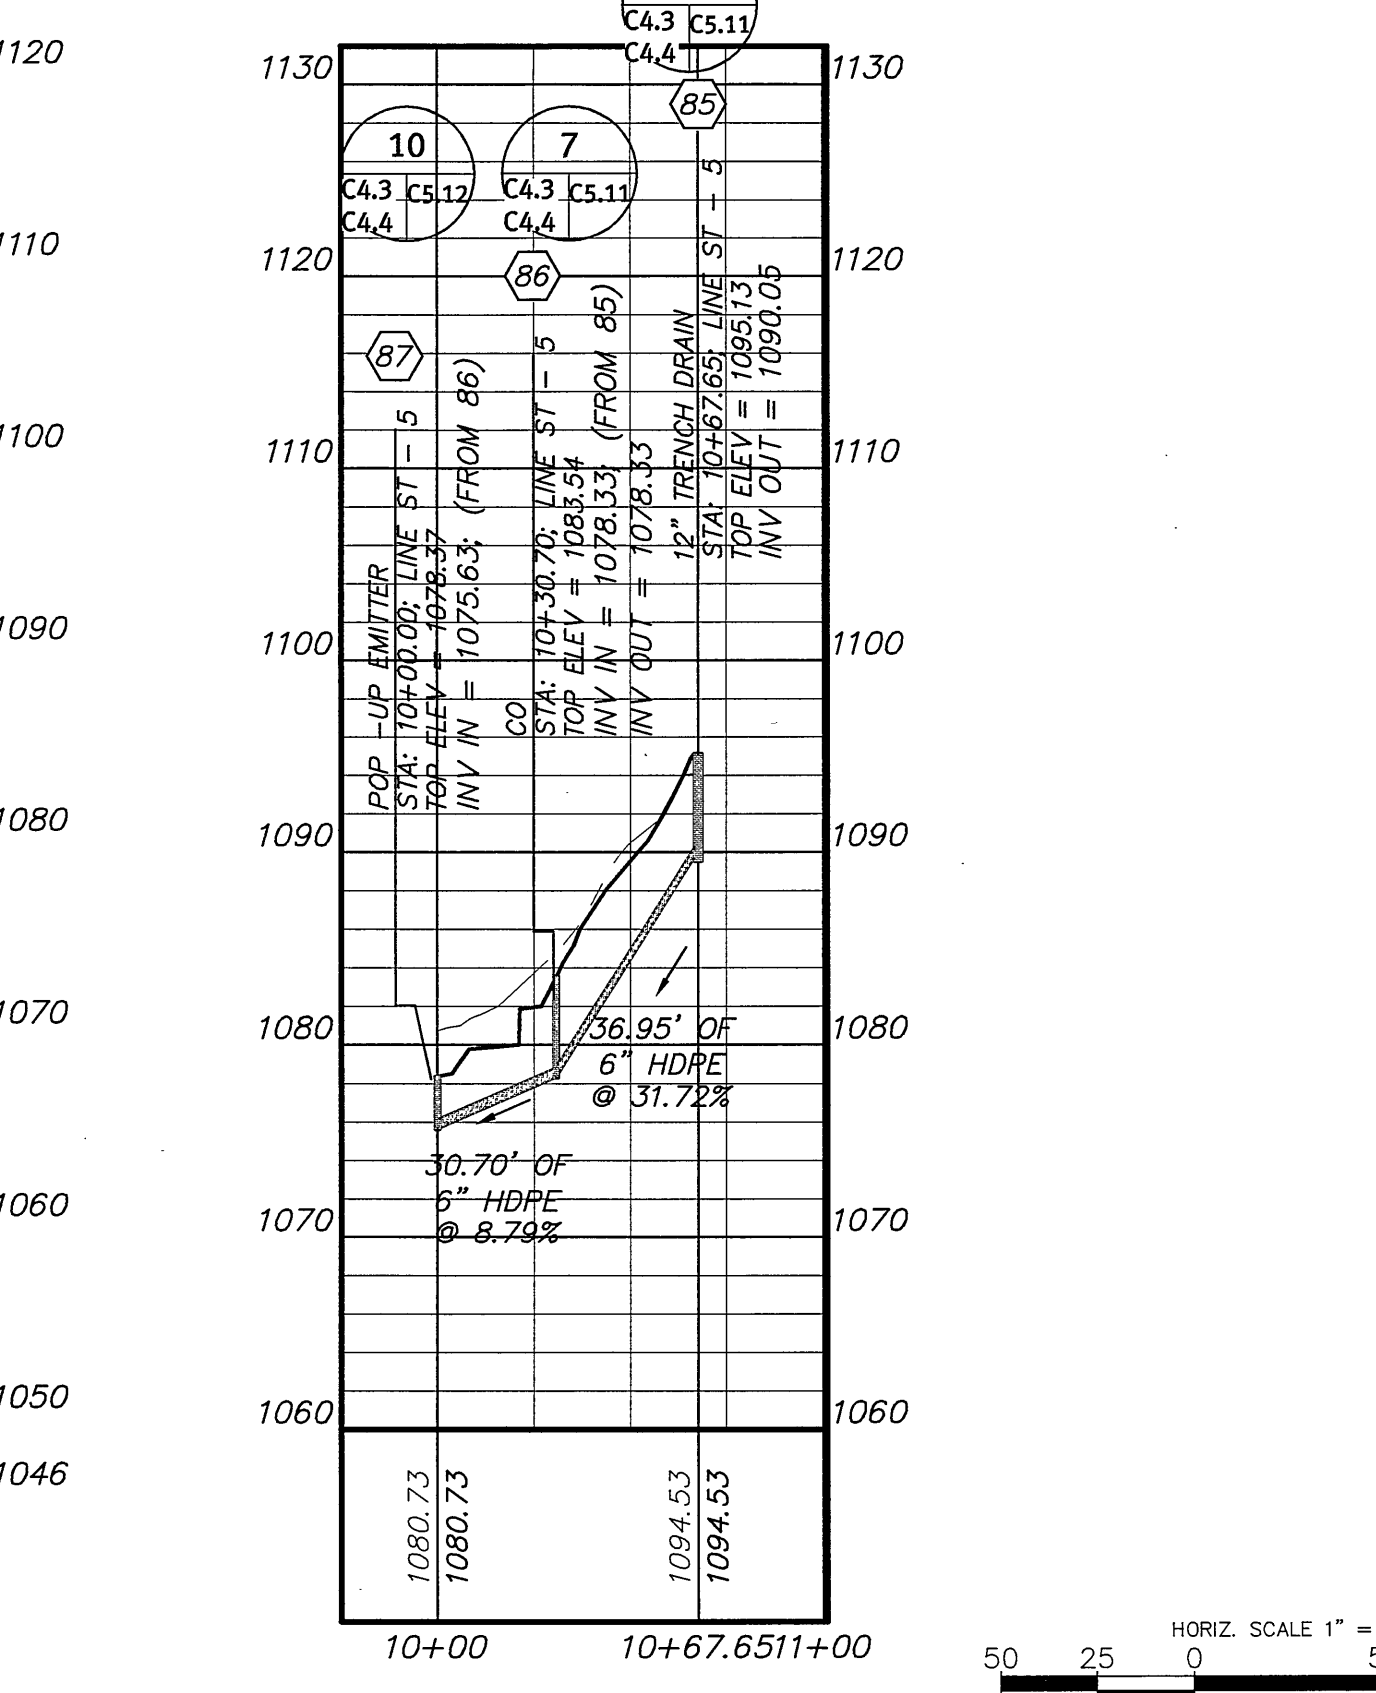

ST - 5

