



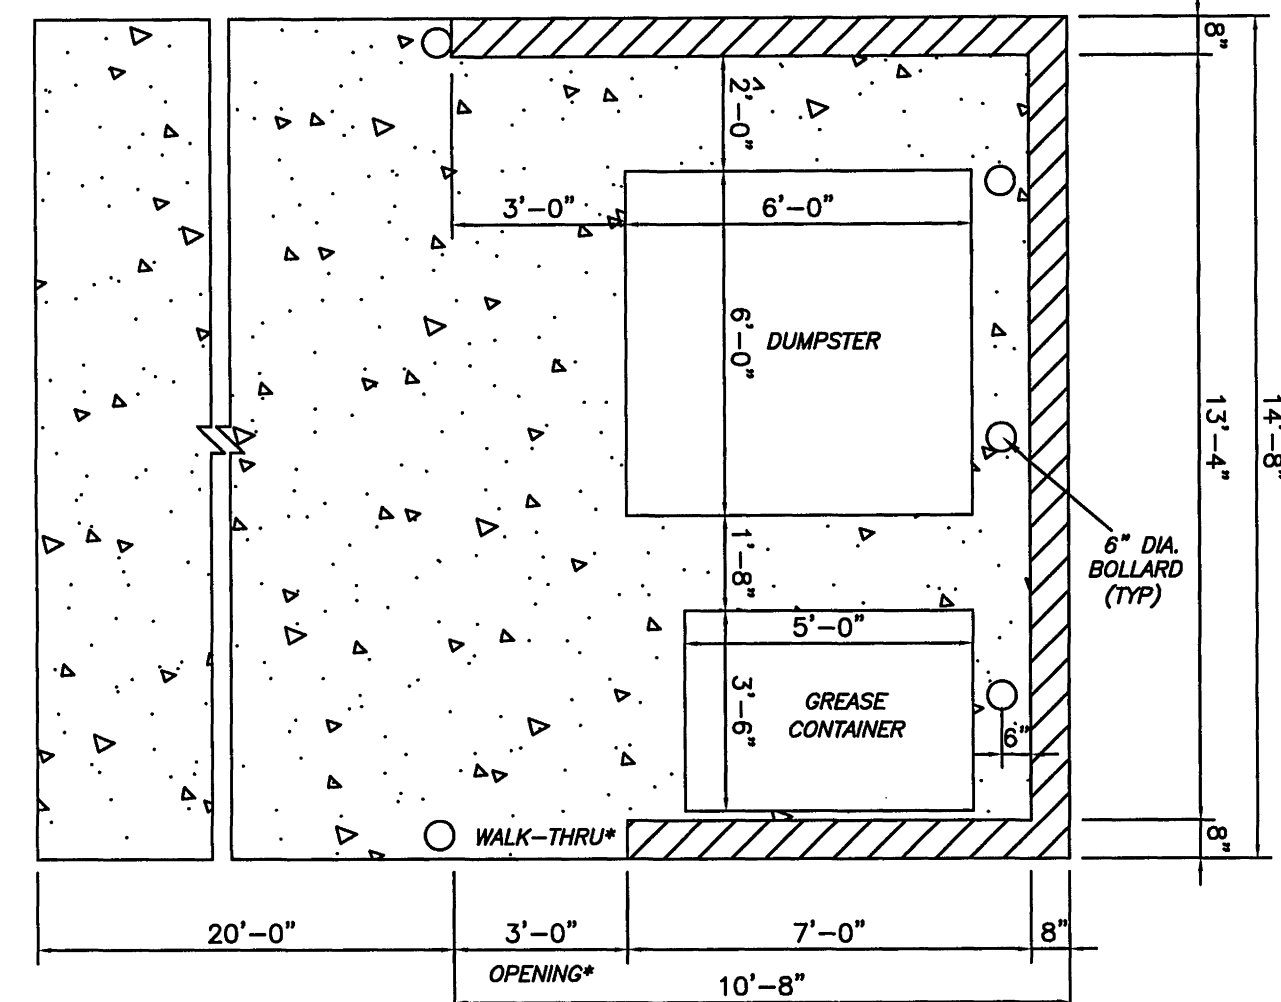

PLAN VIEW


*REFER TO SITE PLAN TO DETERMINE WHICH SIDE OF THE ENCLOSURE THE WALK-THRU IS ON

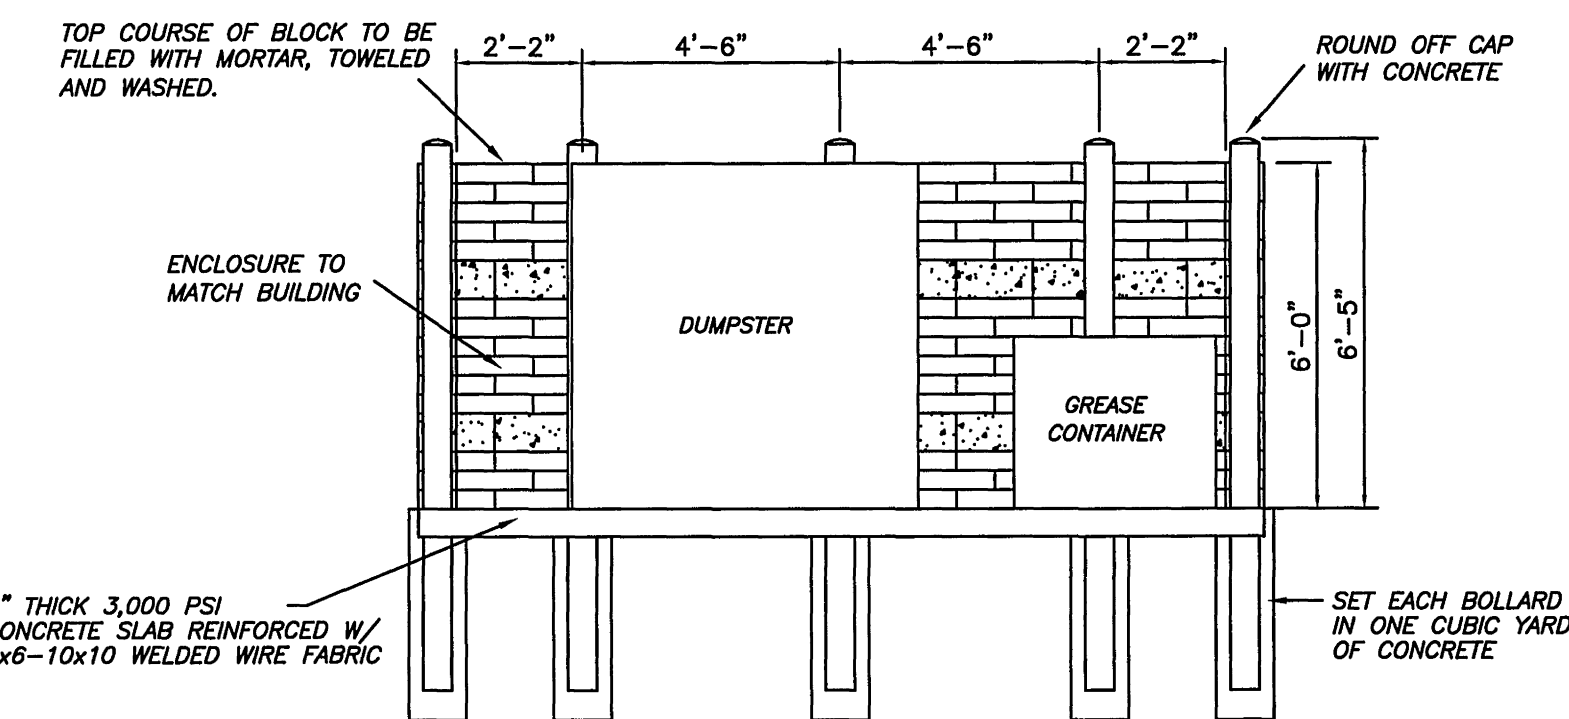

FRONT ELEVATION


STANDARD DUMPSTER ENCLOSURE

Revised - 7/7/09

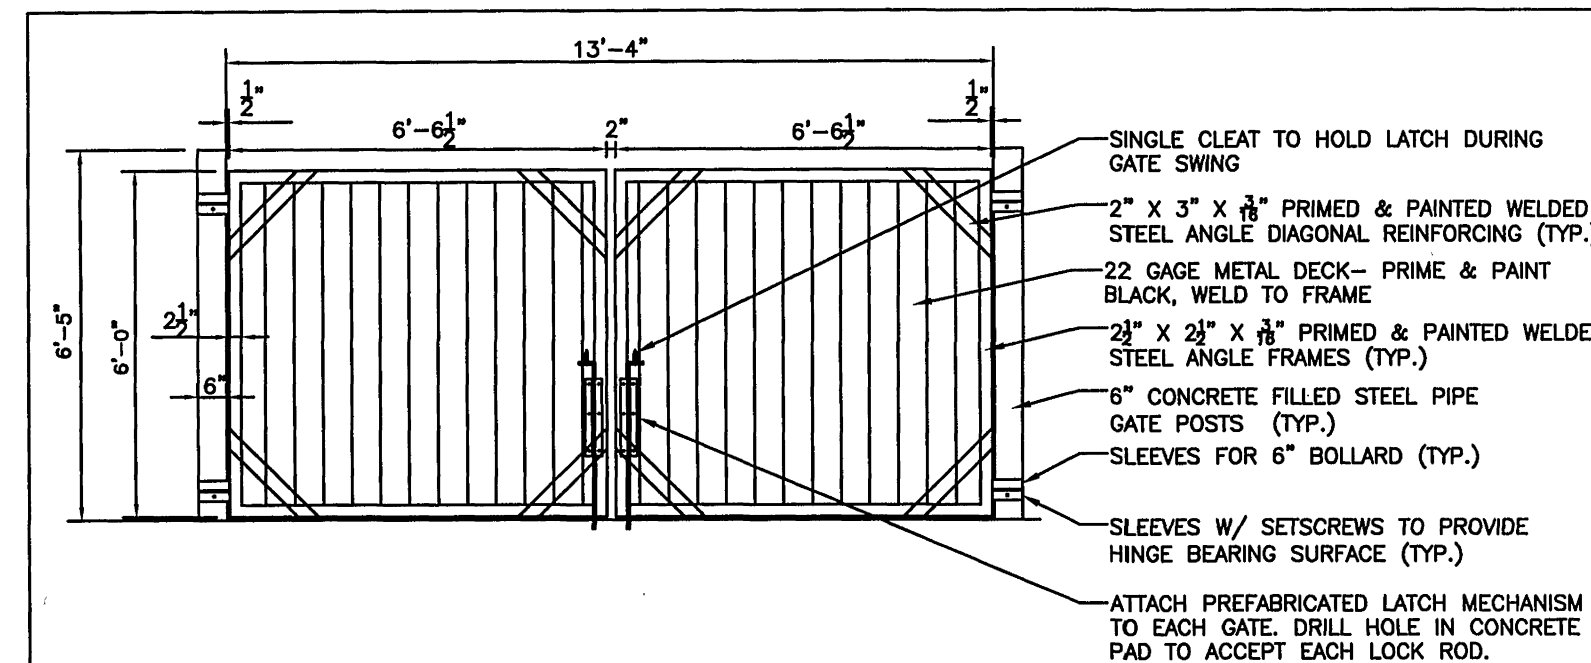

DUMPSTER GATE ELEVATION

REVISED 4/9/09

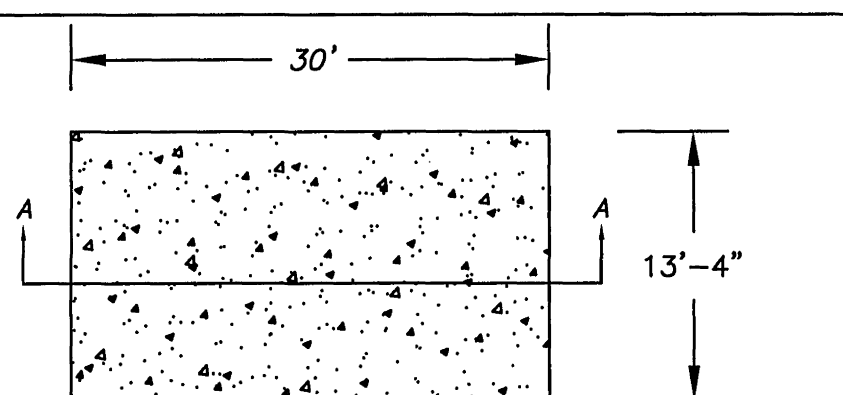


PLAN

4000 PSI CONCRETE W/
6x6-10x10 WELDED WIRE FABRIC

SECTION A-A


CONCRETE DUMPSTER PAD

WH06

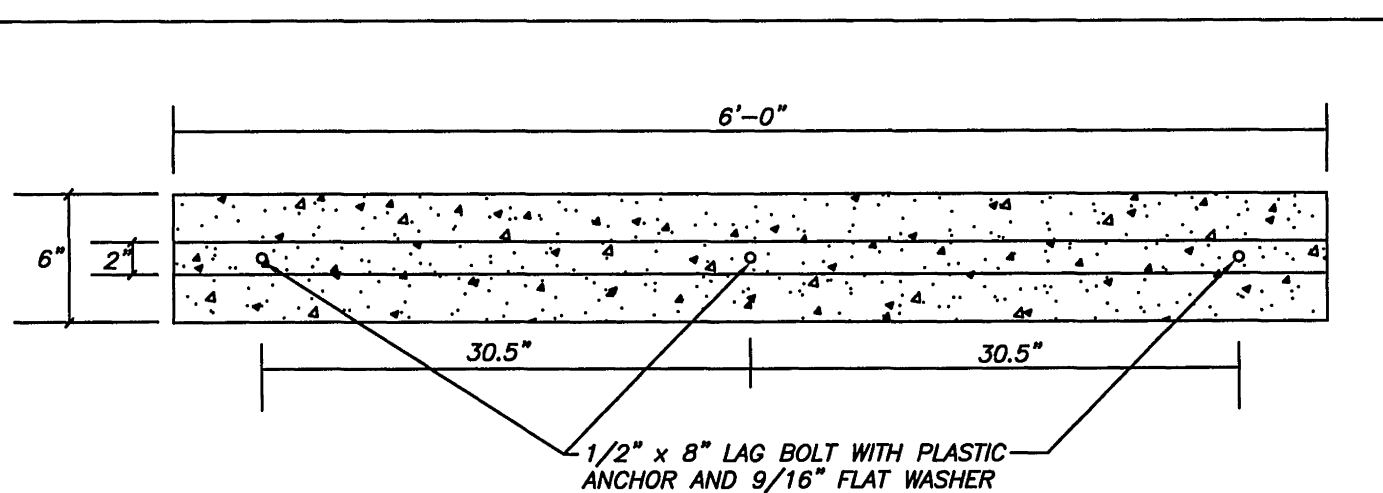

PLASTIC WHEEL STOP


(6'L x 6"W x 4"H)
10/23/09

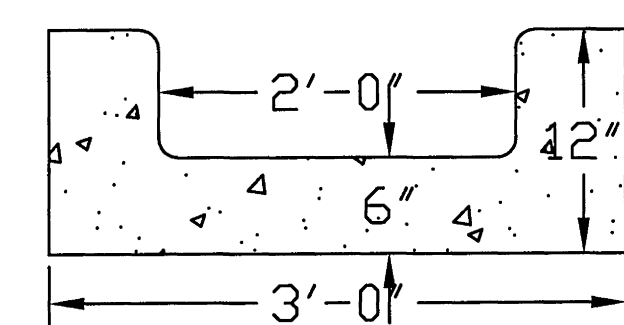

CONCRETE FLUME

1. FLUME TO BE CONSTRUCTED WITH CLASS A, 3000 PSI CONCRETE.
2. FLUME TO BE BROOM FINISHED.
3. FLUME TO HAVE 1/4" WIDE BY 1/2" DEEP CONTRACTION JOINT EVERY 10 FEET.
4. INSTALL 1/2" WIDE FIBER ISOLATION JOINT EVERY 100 FEET. ISOLATION JOINT MATERIAL TO BE FLEXIBLE AND NOT OF A MATERIAL THAT WILL SWELL WHEN WET. ISOLATION JOINTS SHALL CONFORM TO THE SHAPE AND PROFILE OF THE FLUME.
5. INSTALL ISOLATION JOINT BETWEEN FLUME AND BUILDING.


WH09

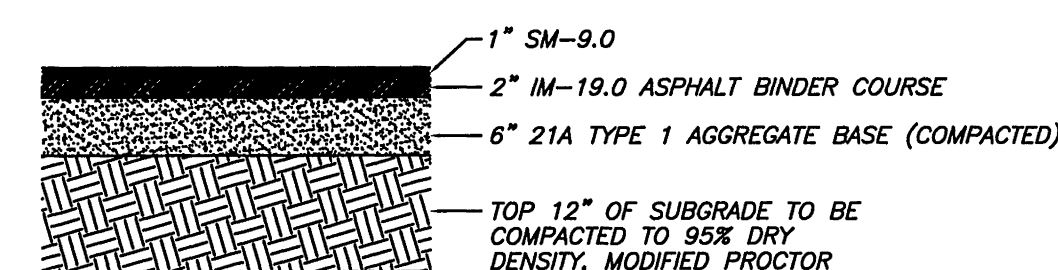

PAVEMENT DETAIL


DETAIL - 15

WH15-MODIFIED



CONCRETE DETAIL


NOTE: CONFIRM CONCRETE DESIGN W/ GEOTECHNICAL REPORT

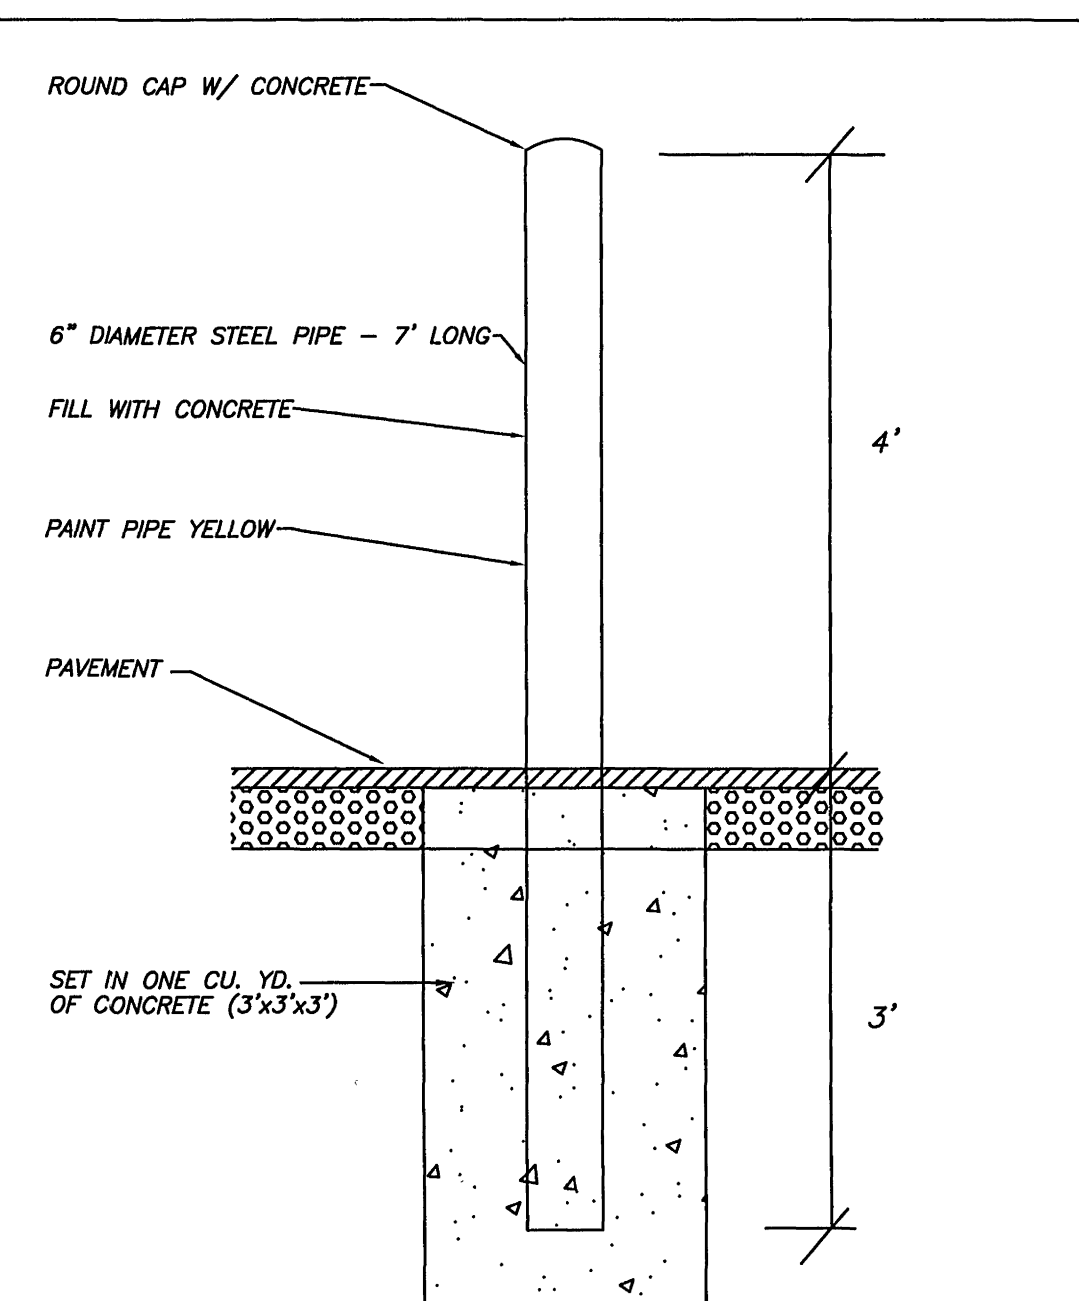

BUMPER POST DETAIL

DETAIL - 3

WH03

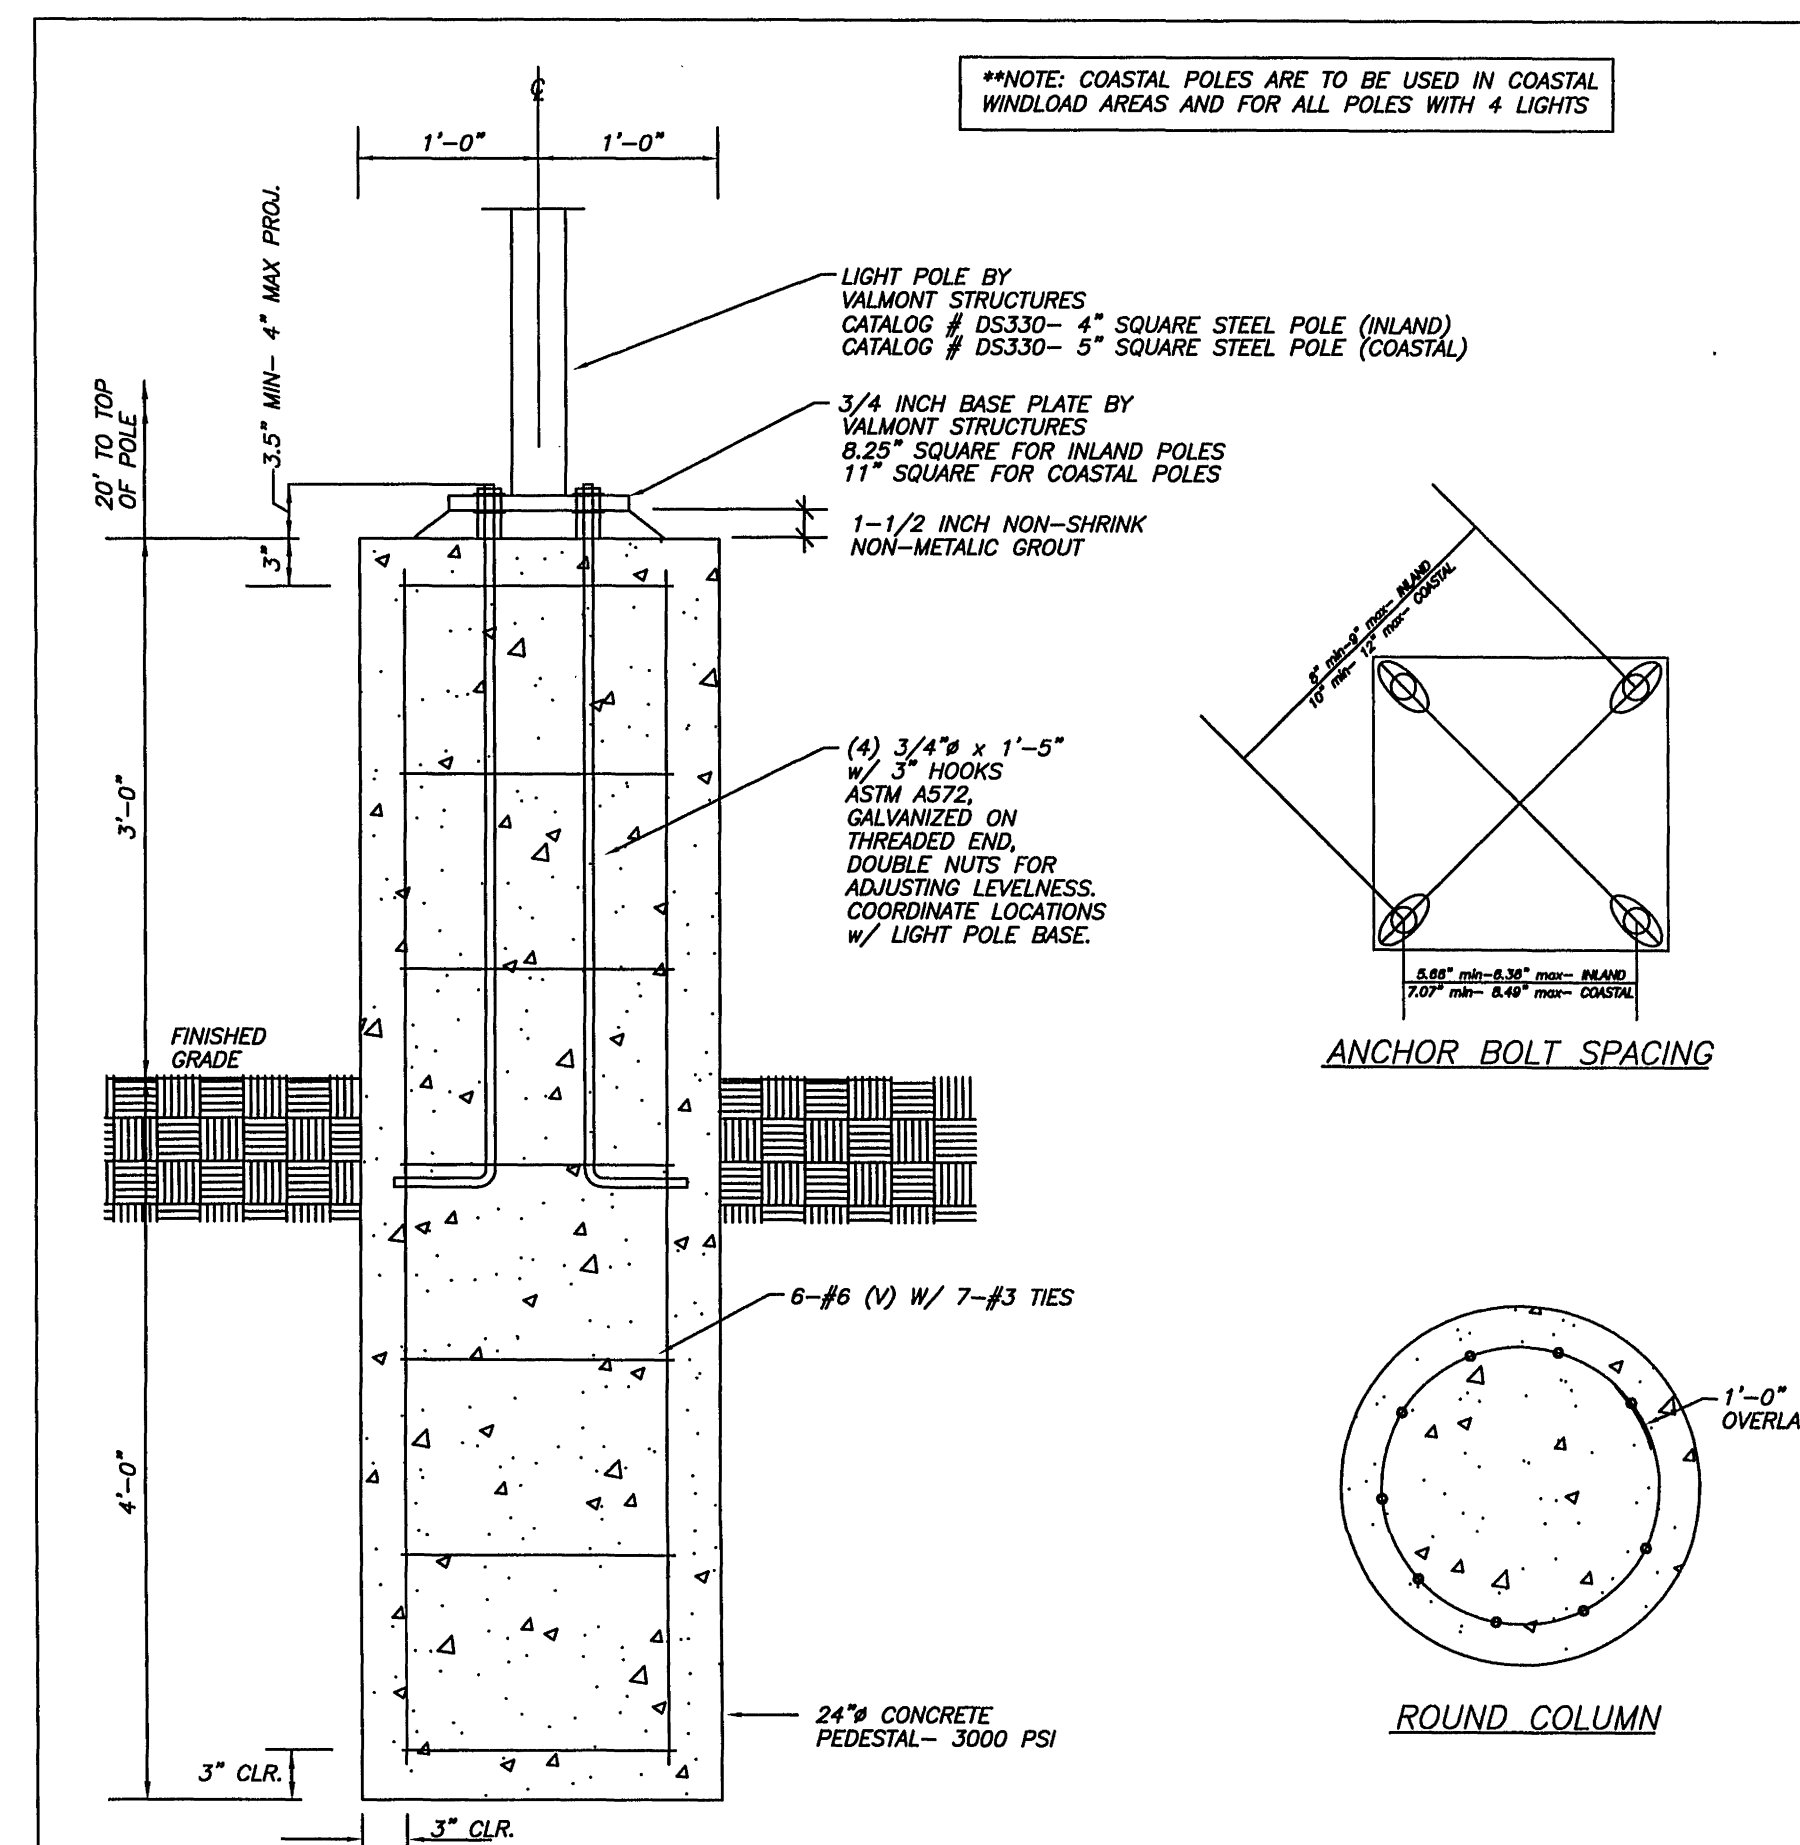

LIGHT BASE DETAIL

Revised - 1/20/09