


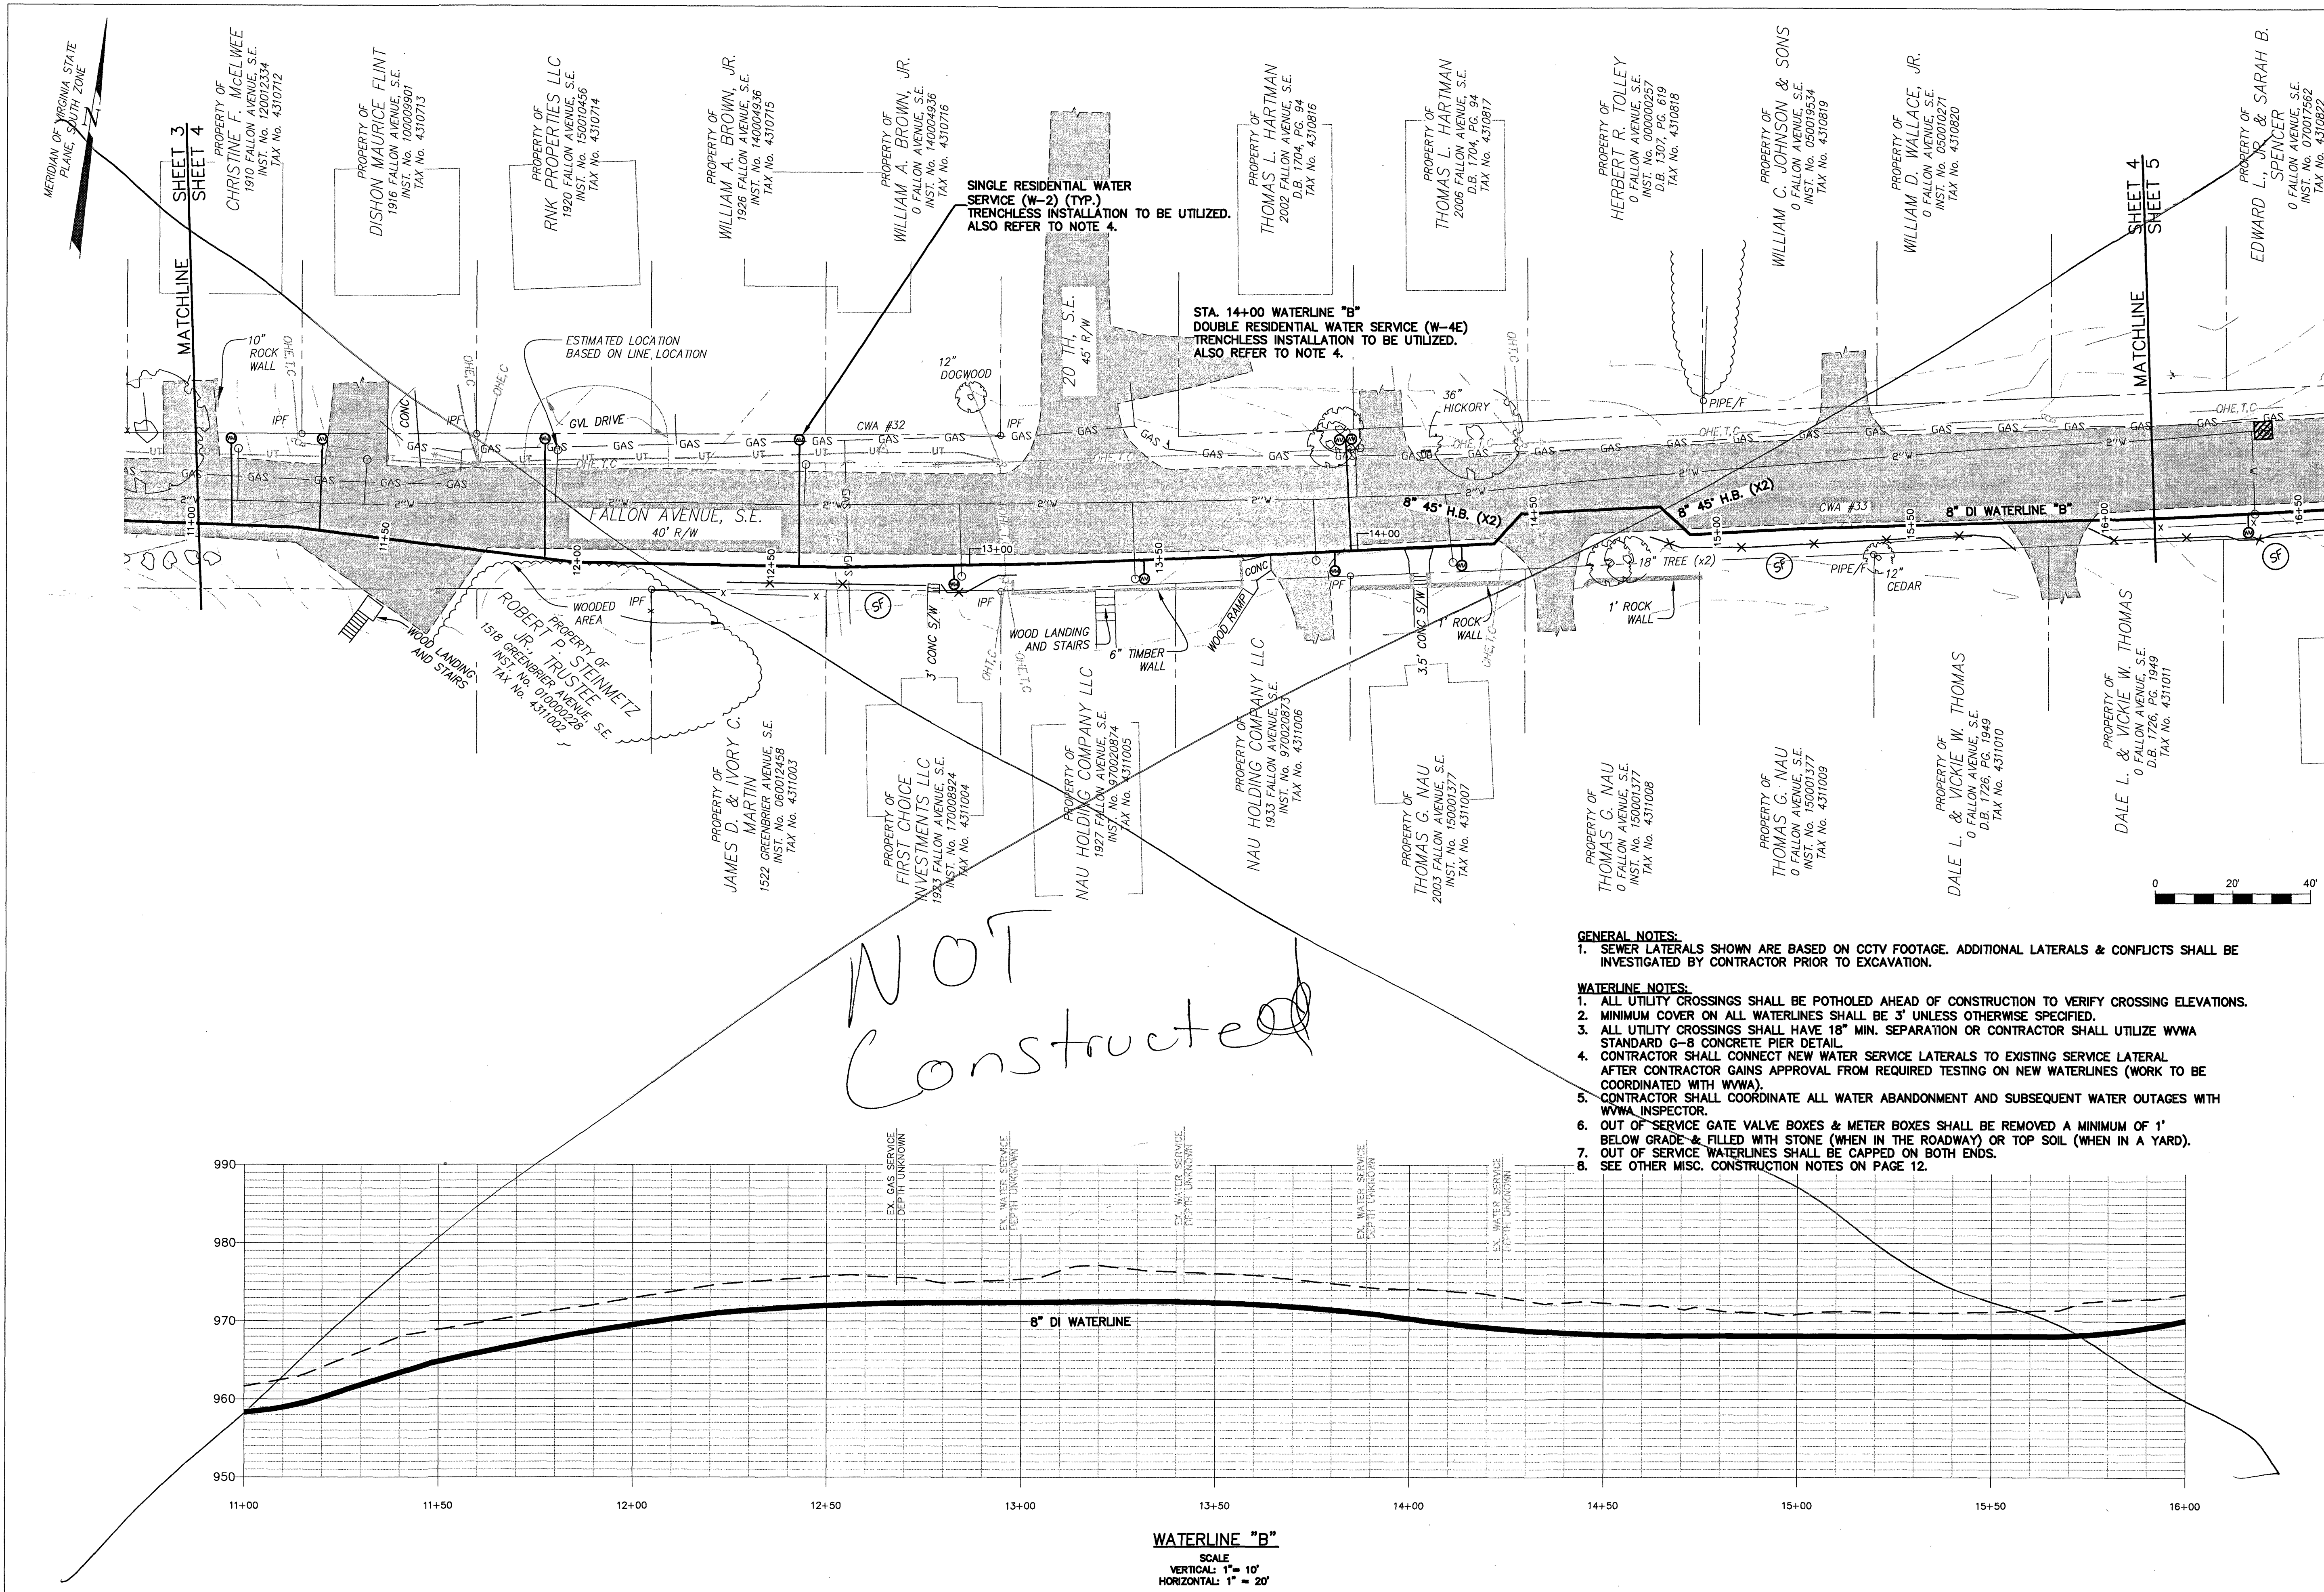

NOT
Constructed

- GENERAL NOTES:**
- SEWER LATERALS SHOWN ARE BASED ON CCTV FOOTAGE. ADDITIONAL LATERALS & CONFLICTS SHALL BE INVESTIGATED BY CONTRACTOR PRIOR TO EXCAVATION.
- WATERLINE NOTES:**
- ALL UTILITY CROSSINGS SHALL BE POTHOLED AHEAD OF CONSTRUCTION TO VERIFY CROSSING ELEVATIONS.
 - MINIMUM COVER ON ALL WATERLINES SHALL BE 3' UNLESS OTHERWISE SPECIFIED.
 - ALL UTILITY CROSSINGS SHALL HAVE 18" MIN. SEPARATION OR CONTRACTOR SHALL UTILIZE WYMA STANDARD C-8 CONCRETE PIER DETAIL.
 - CONTRACTOR SHALL CONNECT NEW WATER SERVICE LATERALS TO EXISTING SERVICE LATERAL AFTER CONTRACTOR GAINS APPROVAL FROM REQUIRED TESTING ON NEW WATERLINES (WORK TO BE COORDINATED WITH WYMA).
 - CONTRACTOR SHALL COORDINATE ALL WATER ABANDONMENT AND SUBSEQUENT WATER OUTAGES WITH WYMA INSPECTOR.
 - OUT OF SERVICE GATE VALVE BOXES & METER BOXES SHALL BE REMOVED A MINIMUM OF 1' BELOW GRADE & FILLED WITH STONE (WHEN IN THE ROADWAY) OR TOP SOIL (WHEN IN A YARD).
 - OUT OF SERVICE WATERLINES SHALL BE CAPPED ON BOTH ENDS.
 - SEE OTHER MISC. CONSTRUCTION NOTES ON PAGE 12.

WESTERN VIRGINIA

WATER AUTHORITY

ENGINEERING SERVICES
601 S JEFFERSON ST, SUITE 300
ROANOKE, VA 24011
540-853-5700

WAVELY NEIGHBORHOOD AREA
WATERLINE REPLACEMENT

PLAN & PROFILE

Rev	Description	Date	By

Designed: DRJ, CDA
Drawn: DRJ
Checked: CDA
Approved: CDA
Date: 4/19/18
Project: CIP-250

4
Sheet 4 of 17