


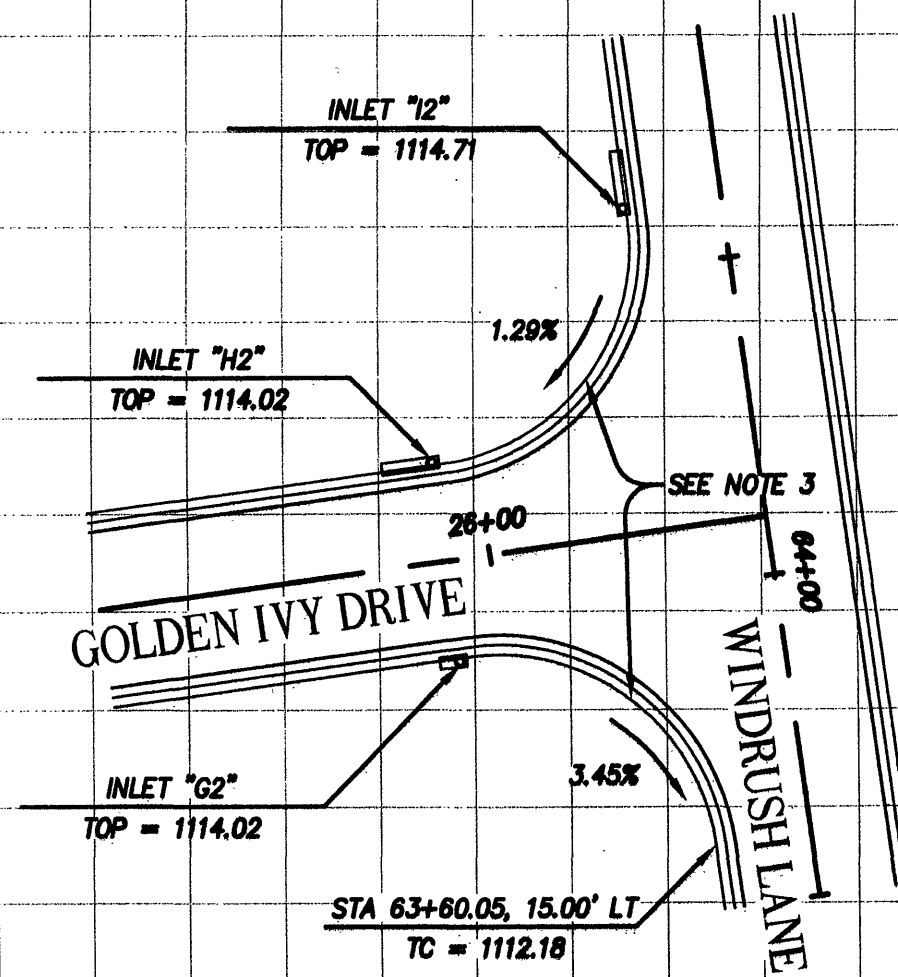

- ## NOTES:
1. ALL WATER AND SANITARY SEWER LINES TO HAVE A MINIMUM OF 3.0 FEET OF COVER.
 2. MAINTAIN A MINIMUM OF 18" CLEARANCE FROM OUTSIDE OF PIPE TO OUTSIDE OF PIPE AT ALL WATER, SANITARY SEWER, AND STORM DRAIN CROSSINGS.
 3. A WESTERN VIRGINIA WATER AUTHORITY INSPECTOR MUST BE ON SITE DURING INSTALLATION OF NEW MANHOLES AT, OR CONNECTIONS TO, TIE IN AT EXISTING SANITARY SEWER LINES.
 4. SANITARY SEWER LINE SHALL BE PVC, SDR-35 UNLESS OTHERWISE NOTED.
 5. WATER LINE SHALL BE C900, DR-14 UNLESS OTHERWISE NOTED.
 6. WATER LINE JOINTS SHALL BE MECHANICALLY RESTRAINED WHERE WATER LINE GRADE EXCEEDS 10%.
 7. SANITARY SEWER CONNECTION TO EXISTING MANHOLE(S) SHALL BE EXCAVATED BY THE CONTRACTOR AND CENTERMARKED FOR TAPPING. TAP TO BE PERFORMED BY THE WESTERN VIRGINIA WATER AUTHORITY AT THE CONTRACTORS EXPENSE.
 8. ALL DROP INLETS SHALL HAVE IS-1 SHAPING.
 9. ALL DRAINAGE STRUCTURES DEEPER THAN 4.0 FEET SHALL HAVE STEPS (VDOT STD. ST-1) INSTALLED.
 10. SAFETY SLABS (VDOT STD. SL-1) ARE REQUIRED IN ALL DRAINAGE STRUCTURES WITH A DEPTH OF 12.0 FEET OR GREATER. THE SPACING OF THE SLABS SHOULD BE 8 TO 12 FEET WITH NO SAFETY SLAB LOCATED WITHIN 6 FEET FROM THE TOP OR BOTTOM OF THE STRUCTURE.


SECTION No. 2
WEDGWOOD
PREPARED FOR
STRAUSS DEVELOPMENT
CORPORATION
HOLLINS MAGISTERIAL DISTRICT
ROANOKE COUNTY, VIRGINIA

PROFILES

LUMSDEN ASSOCIATES, P.C.
ENGINEERS-SURVEYORS-PLANNERS
ROANOKE, VIRGINIA

4664 BRAMBLETON AVENUE
P.O. BOX 20669
ROANOKE, VIRGINIA 24018

PHONE: (540) 774-4411
FAX: (540) 772-9445
E-MAIL: MAIL@LUMSDENPC.COM

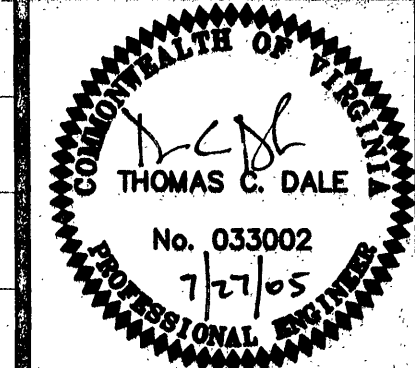

WWW.ID# 80PHHM

REVISIONS	
NO.	DATE DESCRIPTION
1	2/20/16 INVERT AND SEWER TAKE OFF
2	
3	
4	
5	

DATE: July 27, 2005

SCALE: 1:50 (H), 1:10 (V)

COMMISSION NO: 05-013

SHEET 10 OF 13