


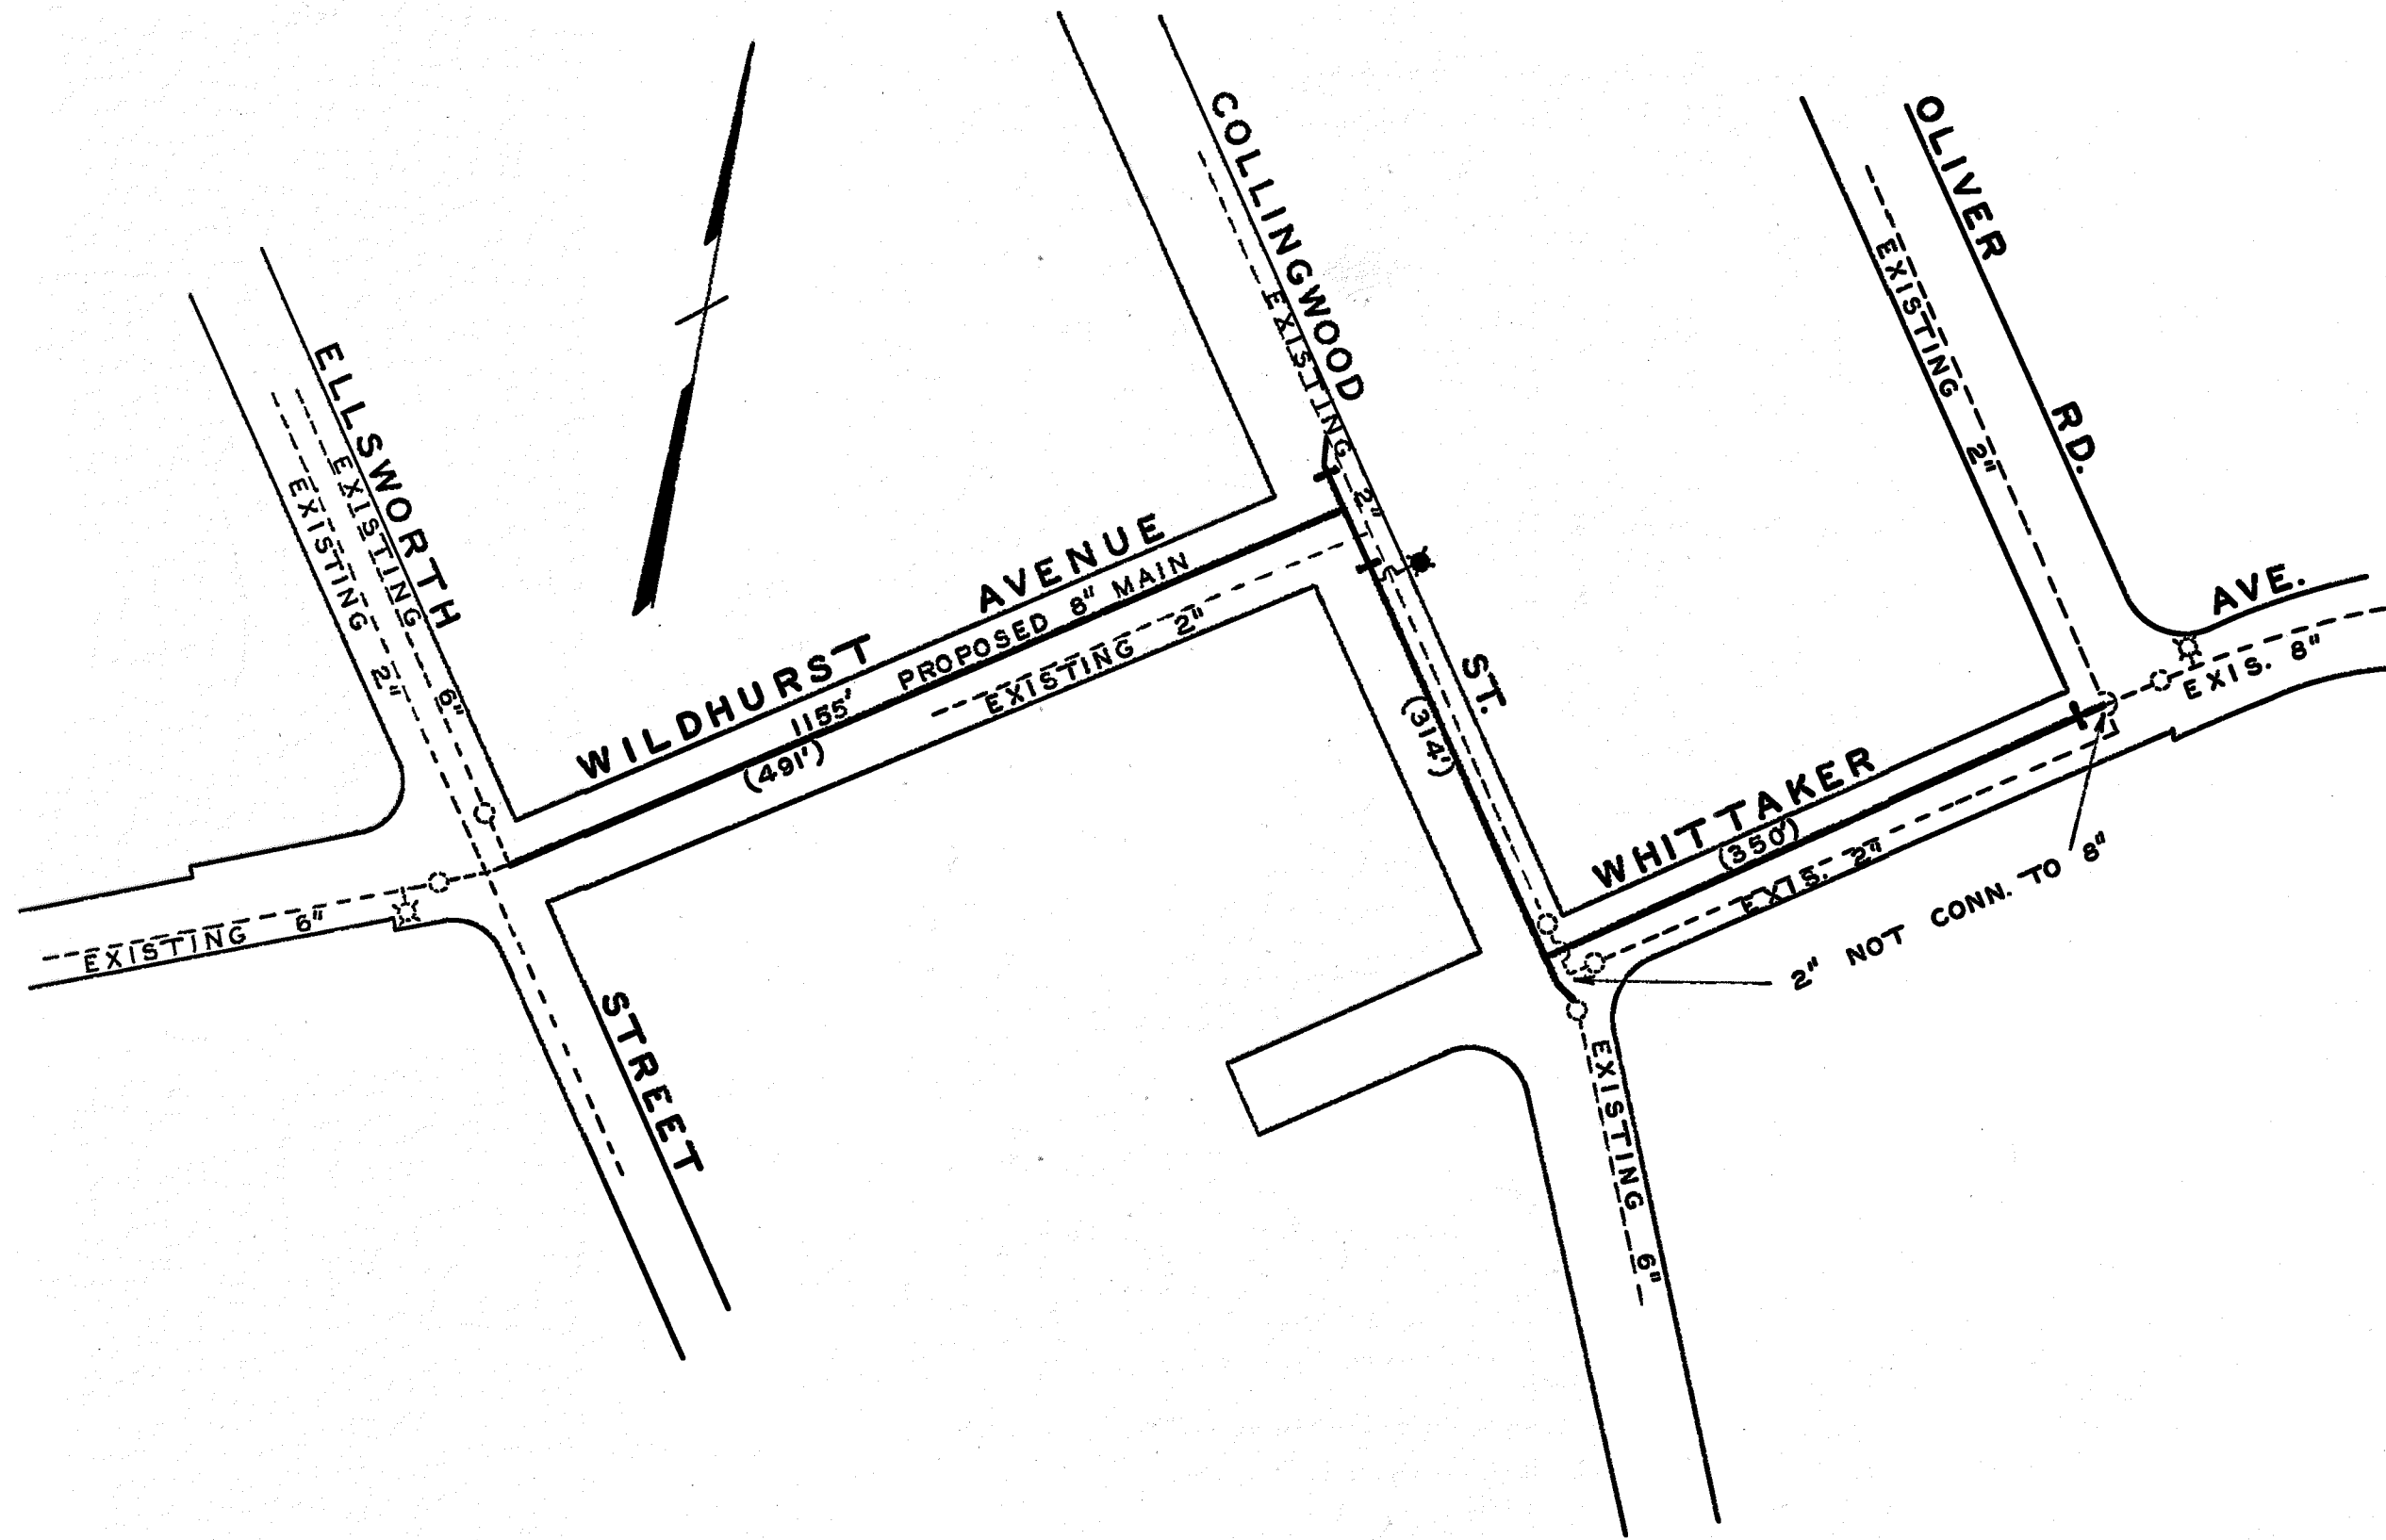

DATE STARTED 8 - 24 - 61				
DATE COMP. 9 - 11 - 61				
FEET MAIN	SIZE	VALVE	VAULT	BOX
1155	8"	3-8"	3	
F. H. COMP. 1	6"	1-6"	1	
F. H. STUB ONLY				
SERV. INS. BY:				
MAINS INS. BY: B. R. H.				
NO. 3/4" SERV. INS.				
CITY OR CO. CITY				
DEPT. INSP.				

WATER DEPARTMENT
 CITY OF ROANOKE, VA.
 WILDHURST AVE. N.E.
 SCALE - 1" = 100'
 DRAWN BY N. H. C. AUG. 15, 1961

61-29